

# Liebert® CRV

50-60 Hz, 20-40 kW

A/W/C Versions



## PRODUCT DOCUMENTATION



# Contents

---

## Contents

|     |   |
|-----|---|
| 1.  | Product Description                               |
| 2.  | Application of Liebert CRV                        |
| 3.  | Liebert CRV                                       |
| 4.  | Operation   |
| 5.  | Microprocessor Controls                           |
| 6.  | Specifications                                    |
| 7.  | Heat Rejections                                   |
| 8.  | Installation drawings                             |
| 9.  | Refrigerant, Hydraulic and Electrical Connections |
| 10. | Refrigeration & Hydraulic Circuits                |

---

The Quality Management System of Emerson Network Power S.r.l. High Performance Air Conditioning has been approved by Lloyd's Register Quality Assurance to the standard ISO 9001:2008



---

The product conforms to European Union directives 2006/42/EC; 2004/108/EC; 2006/95/EC; 97/23/EC. Units are supplied complete with a Test Certificate Conformity Declaration and Component List.

---

Liebert CRV units are CE marked as they comply with the European directives concerning mechanical, electrical, electromagnetic and pressure equipment safety.



# Contents

---

## 1. General Overview

- 1.1. Product Description

## 2. Application of Liebert CRV

- 2.1. First check
- 2.2. Selection of Lieber CRV unit(s)
- 2.3. Operating limits
- 2.4. Positioning - units placement
- 2.5. Temperature sensors

## 3. Liebert CRV

- 3.1. Standard features
- 3.2. Optional features
- 3.3. Digit nomenclature

## 4. Operation

- 4.1. Cooling
- 4.2. Heating
- 4.3. Dehumidification
- 4.4. Humidification - optional

## 5. Microprocessor Controls

- 5.1. iCom Control
- 5.2. CDL Graphic Display (option)

## 6. Specifications

- 6.1. Performances - air cooled
- 6.2. Performances - water cooled
- 6.3. Performances - glycol cooled
- 6.4. Performances - CW units
- 6.5. Electric data
- 6.6. Sound data

## 7. Heat Rejections

- 7.1. Coupling of Liebert CRV (A-type, 50Hz, CE mark) air conditioning units with remote air-cooled condensers (Liebert HCR)
- 7.2. Coupling of Liebert CRV (W-type, 50Hz, CE mark) water cooled air conditioning units with remote Liebert HPD Dry Coolers

## 8. Installation drawings

## 9. Refrigerant, Hydraulic and Electrical Connections

- 9.1. Electrical field connections descriptions - 50 Hz
- 9.2. Electrical field connections descriptions - 60 Hz

## 10. Refrigeration & Hydraulic Circuits

# 1

## Product Description

---

### 1.1 Product Description

The Liebert CRV is a range of full-featured compressorized (air, water, glycol cooled) and chilled water cooling units to be installed within a row of high density computing racks in a “hot-aisle-cold-aisle” configuration. Air heated by room equipment enters the unit from the hot aisle, is filtered, cooled and conditioned, and is returned to the cold aisle. Supply air flow direction can be easily modified to the left side or to the right side or to both directions so it may be placed between the racks or on the end of the row.

The Liebert CRV provides all the necessary functions of a standard precision air conditioner including cooling, heating, humidification, dehumidification, air filtration, condensate management, temperature control, alarm functions and data communications.

It is targeted for small and medium datacenters and is optimized for maximum cooling capacity in a minimal footprint.



# 2

## Application of Liebert CRV

### 2.1 First check

Before proceeding with Liebert CRV application please make sure the unit selected is suitable for your site. Liebert CRV is targeted for small and medium data centers and it is optimized for maximum cooling capacity in a minimal footprint. It is designed for high air inlet temperature (up to 40°C), therefore it is advised to accomplish Hot-Cold aisle configuration.

Liebert CRV is able to modulate the cooling capacity down to minimum 20% of nominal capacity in order to quick adjust to any changing heat load. Under this minimum value there is a risk of cycling (frequent ON/OFF) of the compressor affecting the life time.

Liebert CRV is designed to provide proper control of the room temperature, humidity and air filtration.

The specific design of Liebert CRV is optimized in order to be extremely efficient without providing unnecessary latent cooling (dehumidification) not specifically required for cooling of IT electronic equipments, which enhance the overall cooling system efficiency.

In particular cases when a high dehumidification is required, for example in combination with High Density cooling Liebert XD system, it is suggested to use the Liebert CRV also in combination with Liebert HPM Floor mount units.

#### 2.1.1 Hot-Cold aisle configuration

A best practice is to use rows of equipment racks in an alternating arrangement of cold aisles and hot aisles.

In the cold aisle, the equipment racks are arranged face to face so the cold air discharged from the Liebert CRV unit(s) is drawn into the front of the servers and exhausted out through the rear into the hot aisles. Hot aisles are literally hot because the objective of the alternating cold and hot aisle design is to separate the source of cooling air from hot air discharge which returns to the Liebert CRV unit(s). Therefore, hot and cold aisle should be separated otherwise there would be a mix of hot and cold air and thereby lower the temperature of the air returning to the CRV units, which reduces their usable capacity.

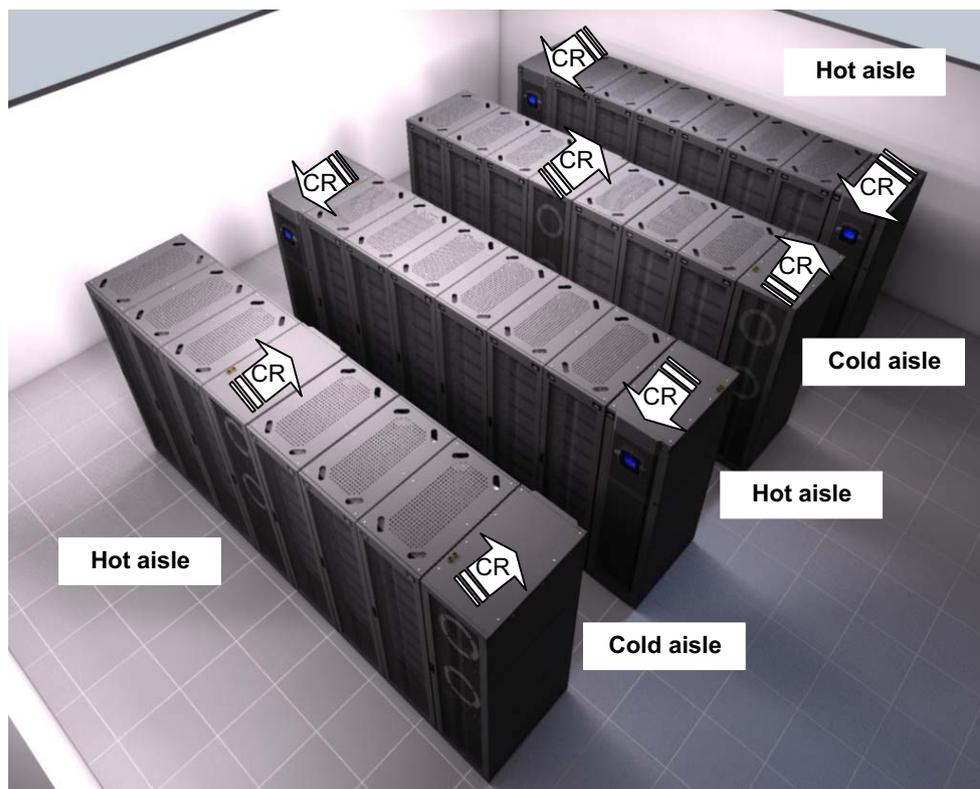


Fig. 2a Example of high density installation with cold aisle and hot aisle alternation

#### 2.1.2 Combination with Liebert XD

Liebert CRV is optimized for maximum cooling capacity in a minimal footprint and it maximizes net sensible cooling capacity used for servers heat load dissipation.

# Application of Liebert CRV

When ever Liebert CRV shall be combined with Liebert XD in order to have the maximum heat load dissipation capability, combination also with Liebert HPM floor mount units may be required in order to have the proper humidity control.

Please refer to suitability map below

**Tab. 2a - Suitability map of Liebert CRV for Liebert XD system\*:**

| Liebert XD unit | XDC            | XDP            | XDP        |
|-----------------|----------------|----------------|------------|
| Heat rejection  | DX cooled      | CW 7/12°C      | CW 10/15°C |
| CR20            | limited**      | limited**      | applicable |
| CR35            | applicable     | applicable     | applicable |
| CR40 CW 7/12°C  | limited**      | applicable     | applicable |
| CR40 CW 10/15°C | not applicable | not applicable | applicable |

Important Notes:

\* Consider this map only when Liebert CRV is the only unit managing humidity control in the server room. In case there is other system, such as CRAC (e.g. Liebert HPM, Liebert DS, Liebert Delux etc.) or Air Handling system, able to control humidity in the server room and to keep dew point under level required by Liebert XD system there are no limitations for application of the Liebert CRV together with Liebert XD

\*\* Liebert CRV may not be able to fully satisfy humidity requirements of Liebert XD system. Suitability to be discussed with Liebert sales representative

## 2.1.3 Combination with other Cooling systems

Liebert CRV may be combined with other cooling systems such as underflow CRAC units (e.g. retrofit of current installation) until there is proper setting of both systems without influencing each other. Otherwise there is a risk of cycling or increased power consumption of both system, in worst case causing malfunction of the units. For details contact Liebert sales representative.

## 2.2 Selection of Liebert CRV unit(s)

### 2.2.1 Heat rejection

Before selecting number and size of Liebert CRV units, carefully consider heat rejection type. If chilled water available for the server room, use CR040RC unit(s). If not, check the distance between Liebert CRV unit(s) and heat rejection unit. In case the distance, either vertical or total, exceeds a limit (refer to para. 2.3 Operation limits) use water / glycol cooled unit(s). Otherwise air cooled unit(s) is recommended.

### 2.2.2 Number and size

When designing a cooling solution using the Liebert CRV unit(s), the initial steps are similar to those required to cool a conventional critical space. The total heat load must be calculated, including sensible and latent cooling requirements. These should be increased by the reserve capacity needed for pull-down situations (e.g. after power failure) where the room temperature must be reduced and to cover unexpected increases in the heat load. Consider also redundant capacity, which is usually not in use in the normal operation, but takes duty if any of the running unit(s) fail. So the different steps are:

- Check the heat load of IT equipment and apply safety margin if required.
- Define size and number of Liebert CRV units in order to provide enough net sensible cooling capacity to cover the heat load. Typical air inlet temperatures to be considered for normal operation of the unit(s) are between 33°C and 37°C. Please refer also to point 2.2.3 Air Flow Requirements
- When N+X (typical N+1) redundancy is required, use more units so if any of the unit(s) fail, the remaining unit(s) will cover the heat load. Always consider the layout of the room when defining number of units, see chapter 2.4 Positioning - unit placement.

### 2.2.3 Air Flow Requirements

Liebert CRV is optimized to provide precision cooling for IT equipment with temperature raise (delta T) of cooling air passing through the equipment around 15 to 20 degrees Celsius or higher. Such temperature raise is typical for Blade servers and standard pizza servers. For applications with very low delta T, around 10 degrees Celsius, typical for old fashion servers, it is necessary to de-rate cooling capacity of the Liebert CRV due to higher air flow equipment.

# Application of Liebert CRV

In case of application with Cold Aisle Containment (Knürr CoolFlex) it is necessary to carefully investigate the air flow through IT equipment and to define number of Liebert CRV units in order to provide at least 5% more airflow, excluding redundant unit(s). Otherwise there may occur a situation with negative pressure in the CoolFlex containment and hot air possibly leaking inside the containment.

## 2.3 Operating limits

The units are designed to operate within working ranges. These limits are referred to new machines or to those that have been correctly installed and serviced. The warranty clauses are no longer valid for any possible damage or malfunction that may occur during or due to operation outside the application values.

### For all units

|                         |                   | From:                  | To                   |
|-------------------------|-------------------|------------------------|----------------------|
| Room air conditions     | Temperature       | 18°C, 64°F             | 40°C, 104°F          |
|                         | Humidity ratio    | 5.5 g/kg, 0.0055 lb/lb | 11 g/kg, 0.011 lb/lb |
|                         | Relative humidity | 20 %                   | 60%                  |
| Storage conditions      | Temperature       | - 20°C, - 4°F          | 50°C, 122°F          |
| Power supply tolerances |                   |                        | V ± 10%              |
|                         |                   |                        | Hz ± 2               |

### For A units

#### Outdoor temperature: lower limit

-20°C / -4°F

To install an air conditioner in places in which external temperature reaches very low values sometime in the year requires some means of control to maintain adequate condensing pressures to ensure proper liquid system operation.

With low temperatures the refrigerant condensates in pipeline and the liquid tends to fulfill the condenser.

It's **mandatory** to install the following components:

1. NON RETURN VALVE (liquid line)

Install a non— return valve in the liquid line directly out of the condenser. It doesn't allow the liquid to come back to the condenser (that means efficiency loss and dangerous stress for the compressor).

2. VARIEX FAN SPEED CONTROL

Use Variex fan speed control to regulate the condensing pressure and have a continuous and better subcooling control.

It's **suggested** to have:

3. HORIZONTAL CONDENSER POSITION

The condenser horizontal disposition (vertical flow) is necessary to reduce subcooling variations due to direct wind exposure. (very important to have a good subcooling control).

For all exceptions contact the Liebert Sales Representative.

#### Outdoor temperature: higher limit

This limit is determined by coupled condenser model. Exceeding of this limit (or a lack of maintenance), will caused a compressor stop by HP safety thermostat. Reset to normal operation can only be carried out manually.

Once the condensing pressure rises at or above the 34 bar / 493 psi value, the capacity of the compressor is reduced by 20% compared to the requested capacity. This because iCOM control tries to maintain the unit's operability reducing the cooling power of digital scroll.

#### Relative position room unit vs. 50 Hz remote condenser

|   |                                     |
|---|-------------------------------------|
| From unit to condenser max distance equivalent length, m (ft) (1) | 50 (330)                            |
| From unit to condenser max geodetic height, m (ft) (1) (2)        | Max above 30 (100) Max below 8 (26) |
| <b>Requirements</b>   |                                     |
| Pipe diameter (1)   | see the User Manual                 |
| Oil traps on vertical line of gas refrigerant, m (ft)             | every 6 (20)                        |

For length higher than 30m (98ft) condenser oversized +15%.

(1) For more details see User Manual

(2) Positive difference in height: condenser above conditioner. Negative difference in height: condenser below conditioner

# Application of Liebert CRV

| Relative position room unit vs. 60 Hz remote condenser         |  |
|--|--|
| From unit to condenser max distance equivalent length, ft. (m) | 150 (46)                                 |
| From unit to VFD condenser max height, ft (m)                  | Max above 100 (30)    Max below 15 (4.5) |
| From unit to lee- temp condenser max height, ft (m) (3)        | Max above 100 (30)    Max below 0 (0)    |
| <b>Requirements</b>  |  |
| Oil traps on vertical line of gas refrigerant, ft (m)          | every 20 (6)                             |

(3) Installations of lee-temp condensers below the level of the room unit will require subcoolers.

## For W units

|  |                 |
|--|-----------------|
| Water or mixture temperature to condenser, lower limit | min. 5°C / 41°F |
|--|-----------------|

## For C and W units

| Max. water pressure 16 bar  |                 |                 |
|---|-----------------|-----------------|
| Max. differential pressure through the closed valve: $Dp_{cv}$                |                 |                 |
| Max. differential pressure across the valve for modulating service: $Dp_{ms}$ |                 |                 |
| Models  | $Dp_{cv}$ (kPa) | $Dp_{ms}$ (kPa) |
| CR020RW   | 300             | 300             |
| CR035RW   | 300             | 300             |
| CR040RC   | 175             | 175             |

## 2.4 Positioning - Units placement

This chapter provides some ideas of typical installation of the Liebert CRV unit(s), shows several examples of the server room layouts and applications using Liebert CRV units.

For best performances of Liebert CRV is important to:

- reduce at minimum recirculation from hot aisle around the ends and/or over the top of the racks, prevent gaps between the racks
- reduce at minimum recirculation from hot aisle through server racks by using blanking panels
- ensure cold air is being distributed across the front of all neighboring equipment racks by properly placed Liebert CRV unit(s)
- distribute load within the rack - it is generally advised to distribute the load as much possible uniformly across the rack height, except for the rack closest to the Liebert CRV unit, where it is suggested to have the higher density load in the bottom and central part of the rack

For more details refer to following details or contact Liebert Sales Representative.

# Application of Liebert CRV


## 2.4.1 Placement in the row of racks

For single row application with one Liebert CRV unit it is not preferred to put the unit in the middle of the row because of possible hot spots at top part of racks, unless in combination with CoolFlex or in application with more Liebert CRV units.


The best approach is to place the Liebert CRV at the end of the row, resulting into much better air distribution. Please refer to the sample case study comparing the same serverroom with different Liebert CRV position.

The CFD (Computational fluid dynamics) analysis results are shown in height 1.8m off the floor (for all following cases).



**Good approach:**

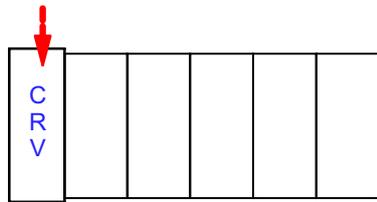

End of row -Preferred


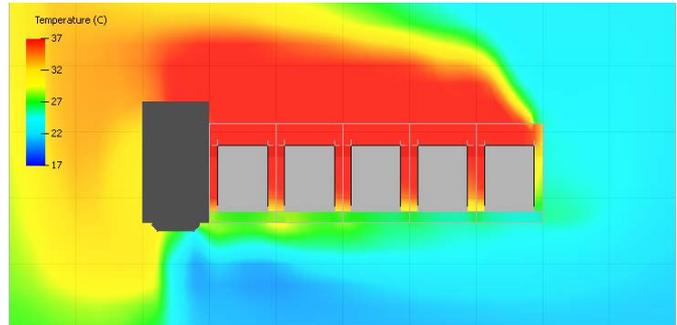


**Not advised approach:**

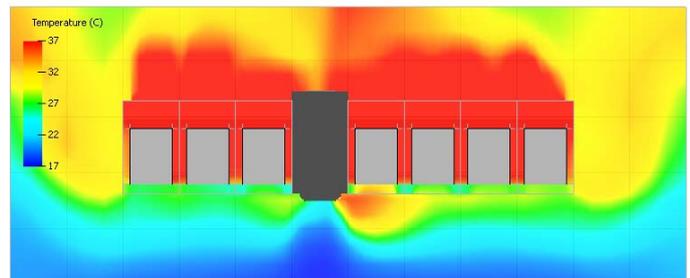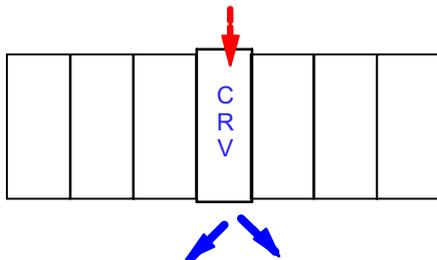

## 2.4.2 Number of racks / length of the row


Standard application with one Liebert CRV unit is with 2-6 racks. The exact number of racks depends on size of Liebert CRV unit used and heat load per rack. Whenever applying more than 6 racks for one CRV or Heat load more than 10kW per rack contact Liebert sales representative

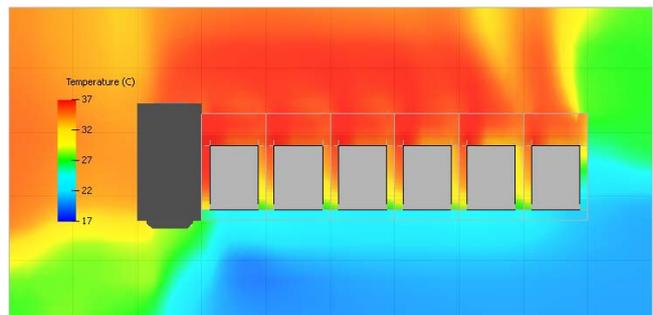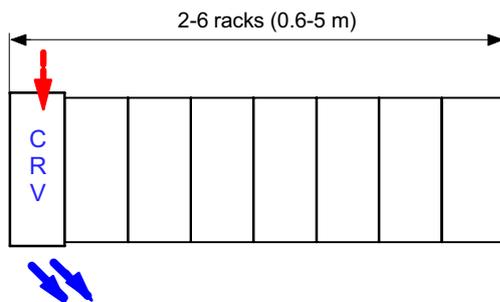

# Application of Liebert CRV

## 2.4.3 Placement in the room

### 1. Width of Hot / Cold aisle


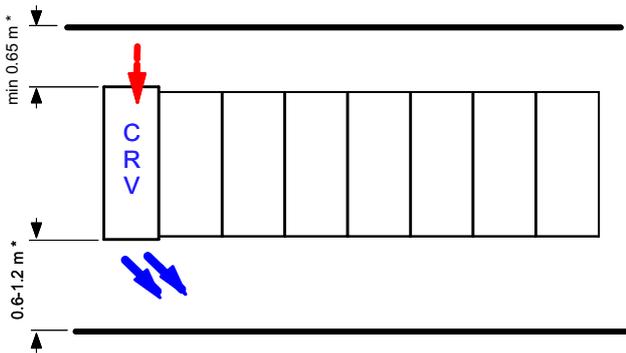


For good air distribution it is recommended to keep width of the cold aisle as small as possible for single row server room. Otherwise the cold air discharged by Liebert CRV unit is being led far from server suction and hot air may by-passed from hot aisle.



Exceptions where wider cold aisle may be used are: applications with CoolFlex (Cold Aisle Containment) or with two rows facing each other.

For width of the hot aisle there are no preferences, there is just minimum requirement needed for enough for service area\*.

#### Good approach:

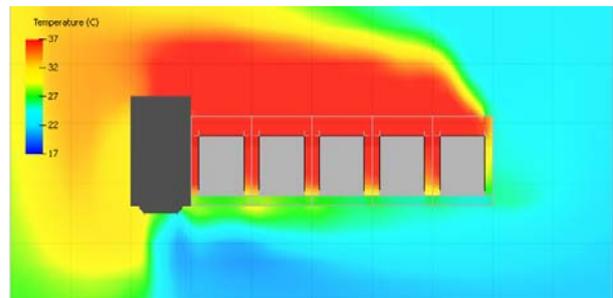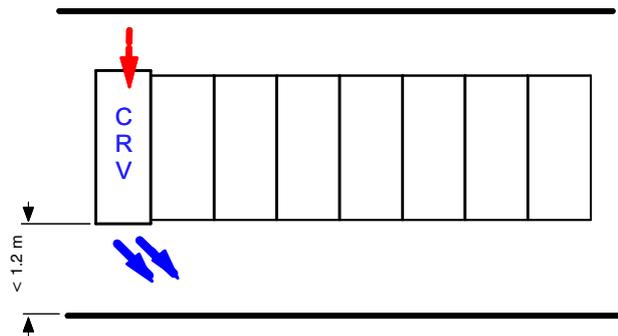

#### Not advised approach:

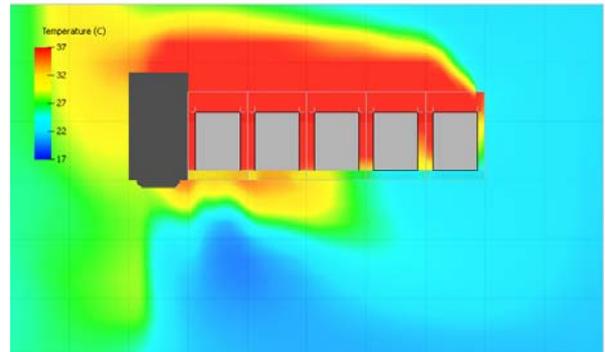
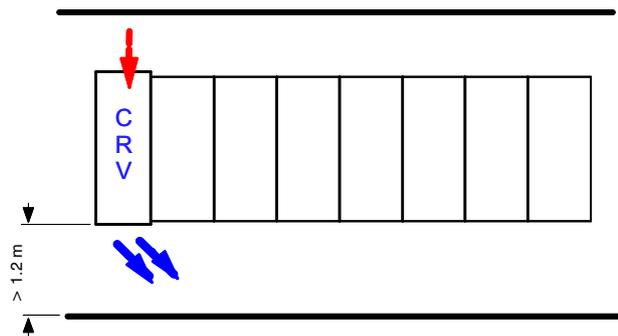


Note:

\* Please refer also to Service area dimensions a - Enclosure C



# Application of Liebert CRV

- Distance between the ends of rows and walls  
 For single row application with one Liebert CRV unit it is not preferred to put the unit at wall because of not proper air paths and possible hot spots at furthest racks, unless in combination with CoolFlex (cold aisle containment) or in application with more Liebert CRV units. The best approach is to keep a gap between at least 0.65m or to use more Liebert CRV units. Good approach is also having wall at the furthest rack. Please refer to the following sample case study comparing various Liebert CRV positions

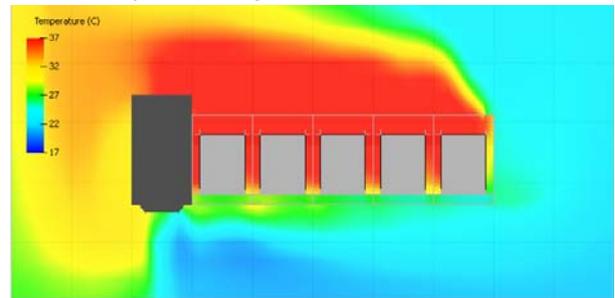
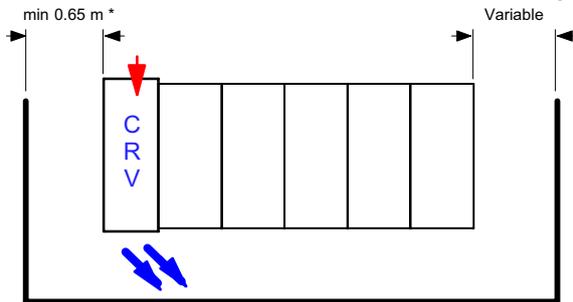


Example of an application with gaps on both sides

**Good approach:**

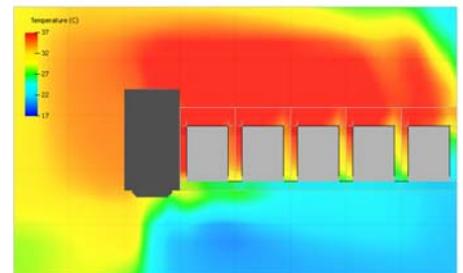
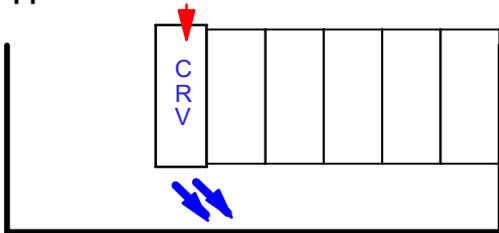


**Not advised approach:**

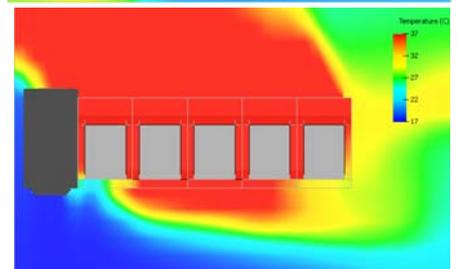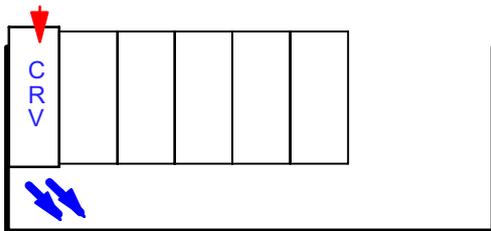

As you can see on CFD result above, it is not advised to place Liebert CRV at the wall in single row layout. On the contrary, it is not an issue in application with two rows and two or more Liebert CRV units.

**Good approach:**

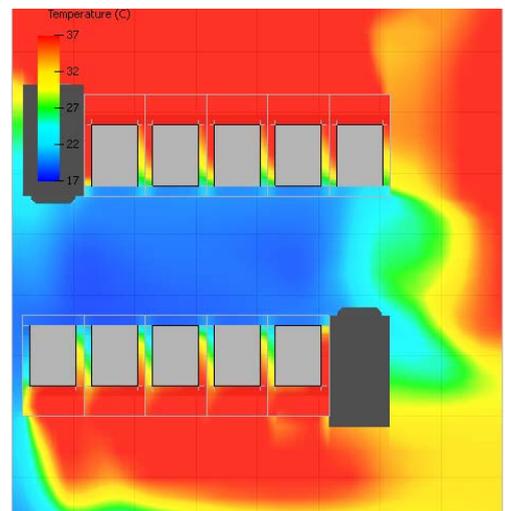
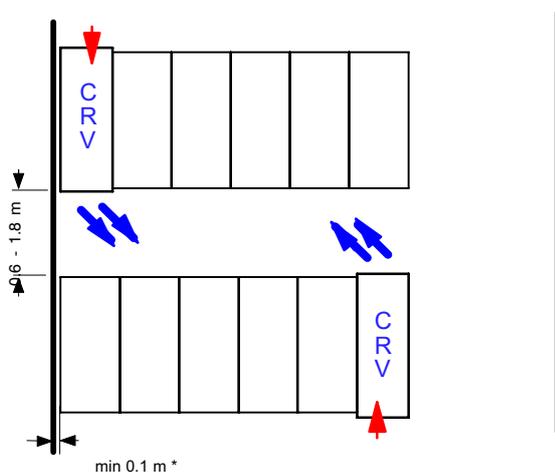


Note:  
 \* Please refer also to Service area dimensions a - Appendix C



# Application of Liebert CRV

## 2.4.4 Solutions with redundancy

Following an example of more complex applications where N+1 redundancy provided. Please note the number and size of Liebert CRV units have to be designed in order to achieve required cooling capacity if any of the units fails. The other option to easily achieve redundancy is CoolFlex (Cold aisle containment), see point 5 below.

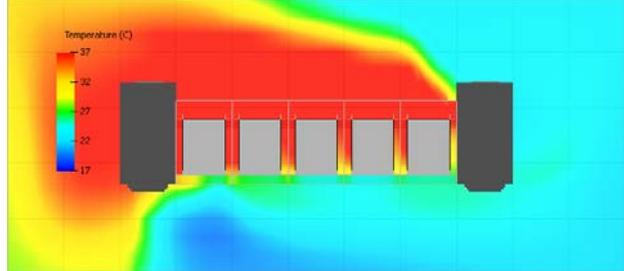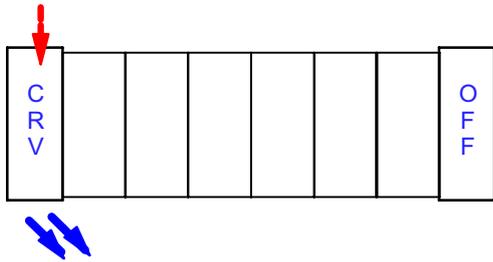

Example of an application with one row and N+1 redundancy (right side unit failed).


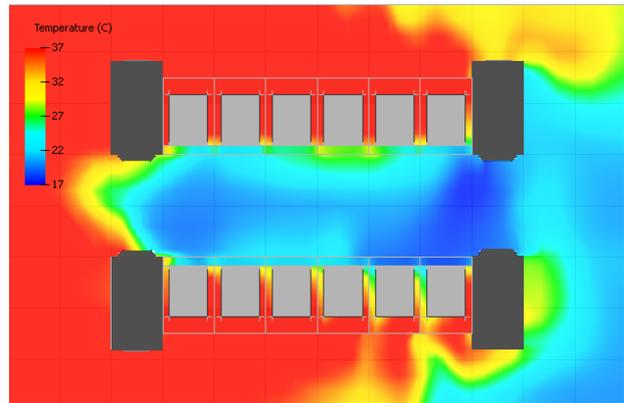
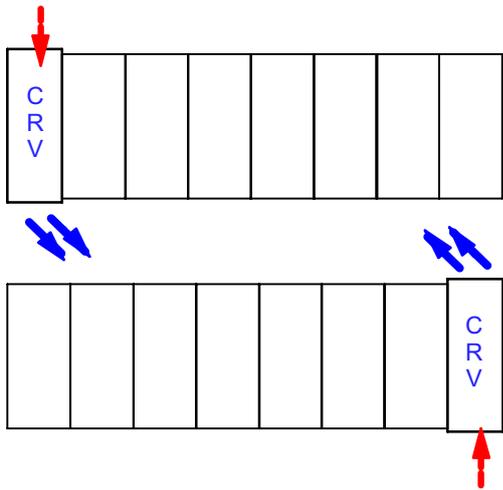


Example of an application with two rows and N+1 redundancy (unit placed right down failed).

# Application of Liebert CRV



## 2.4.5 Example of applications with CoolFlex

When high density IT equipment is used (typically over 10kW per rack) or load distribution in the row(s) of racks is not constant and high energy efficiency is required it is strongly recommended to apply CoolFlex (cold aisle containment) together with Liebert CRV. Other advantage of the CoolFlex application is less limitations, see above points.

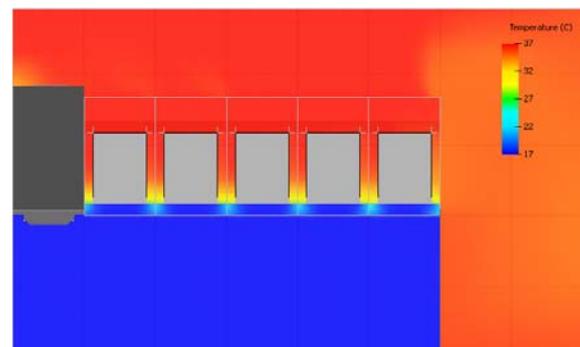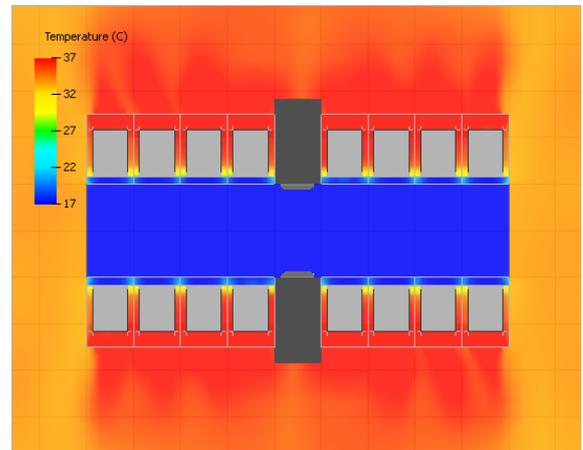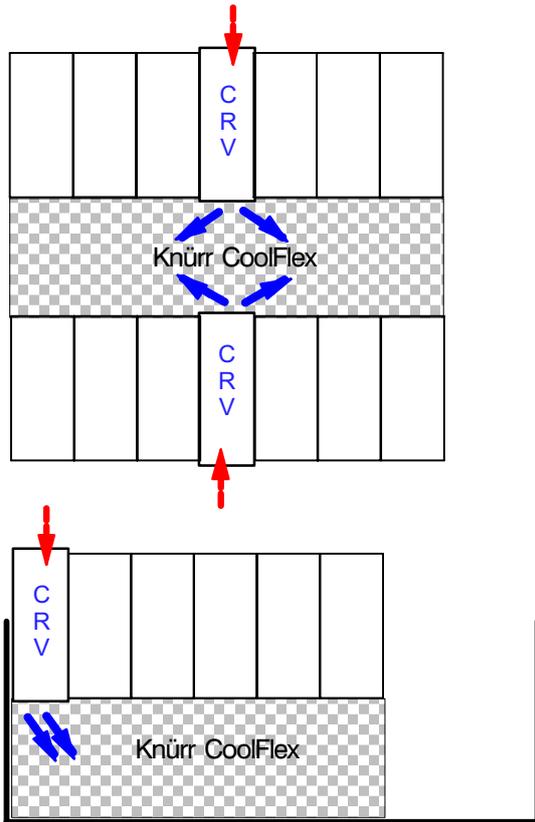

## 2.4.6 Example of applications with Liebert XD

When high density IT equipment is used (typically over 10kW per rack) with less floor space available especially when scalable solution is required (starting from less heat load and ready for future growth), the best answer is Liebert CRV together with Liebert XD system. Please find following an example layout of typical installation with two rows of racks with Liebert XDV modules. Two Liebert CRV units are used to support the Liebert XD system and to ensure N+1 redundancy on humidity control. See also CFD result showing site view of the room.

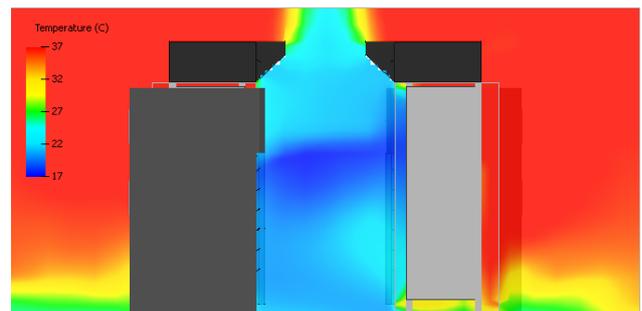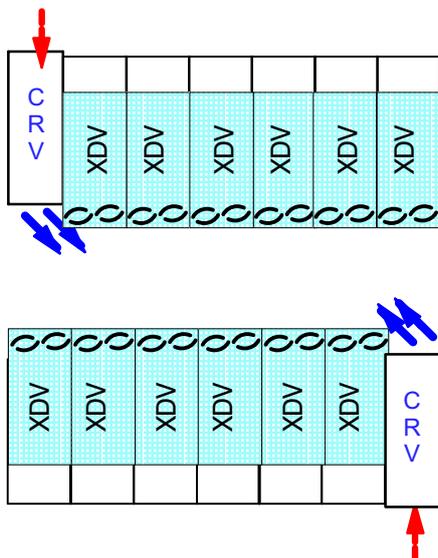

## 2.5 Temperature sensors

The sensor may be placed where desired or left coiled inside the unit. It is recommended that the sensor be routed to the front of the heat load for the most accurate temperature reading. In InRow configuration, the temperature sensor monitors the temperature of the air entering the rack equipment. The reading is used to control the operation of the unit, so the sensor must be placed as directed below or the equipment will not operate properly.

Insert the rack temperature sensor connector in the temperature sensor port at the iCom interface. Secure the temperature sensor in front of the warmest heat source in the enclosure. Do not secure in front of a blanking panel. The sensors must be installed where lack of sufficient cooling air is most likely. The optimum position of the rack temperature sensors will vary from installation to installation. Servers most likely to have insufficient or inadequately cooled cooling air due to the recirculation of hot air from the hot aisle include:

- a. Servers positioned at the top of a rack.
- b. Servers positioned at any height in the last rack at an open end of a row.
- c. Servers positioned behind flow-impairing obstacles such as building elements.
- d. Servers positioned in a bank of high-density racks.
- e. Servers positioned next to racks with air removal units.
- f. Servers positioned very far from the equipment.
- g. Servers positioned very close to the equipment.

### 3.1 Standard features

#### *Air cooled models*

**DX COOLING COIL** The evaporator coil has 7.25 ft<sup>2</sup> (0.674 m<sup>2</sup>) face area, 4 or 5 rows deep. It is constructed of copper tubes and hydrophilic coated aluminium fins. The hydrophilic coating provides superior water carryover resistance. Two stainless steel condensate drain pans are provided.

**REFRIGERATION SYSTEM** Single refrigeration circuit includes a liquid line filter drier, a refrigerant sight glass with moisture indicator, an adjustable externally equalized expansion valve, and a liquid line solenoid valve.

**COMPRESSOR** The compressor is an R-410A scroll-type with variable capacity operation from 20-100%; commonly known as a Digital Scroll. Compressor solenoid valve shall unload the compressor to provide variable capacity operation. The compressor has a suction gas cooled motor, vibration isolators, internal thermal overloads, manual reset high pressure switch, RotoLock service valves, low pressure and high pressure transducer, crankcase heater, internal centrifugal oil pump, and an operating speed of 3500 RPM @ 60Hz (2900RPM @ 50Hz).

**FAN** The unit is equipped with two plug fans: direct driven centrifugal fans with backward curved blades and Electronically Commutated DC motors; commonly referred to as EC plug fans. The fan speed is variable and automatically regulated by the iCOM control through all modes of operation. Each fan has a dedicated motor and speed controller which provides a level of redundancy. The fans push air through the coil and are located on the rear panel of the unit.

**SUPPLY AIR BAFFLE** A field adjustable, modular supply air baffle is located in the discharge air stream. It can be quickly and easily reconfigured to redirect airflow. The angles of the vanes have been optimized to effectively distribute air to heat generating equipment in a wide variety of applications.

**iCOM CONTROL SYSTEM** The Liebert CRV is controlled by the iCOM Control System. The standard user interface is the Large Graphical Display (320x240 pixels, backlit) which presents system information and allows all parameters to be viewed and adjusted. It features push-button navigation, operational status LEDs, and a 3-level password protection system. Unit-to-Unit communication with other Liebert CRVs and two IntelliSlot communication card housings are included as standard.

**2T RACK TEMPERATURE SENSORS** Consist of a vented case with two temperature probes. Up to 10 2T housings (20 temperature probes) can be connected to a Liebert CRV. One 2T housing and both sensor probes are to be attached to a rack the cooling unit is conditioning. The sensors provide real-time, direct feedback to the cooling unit to optimize the amount of cooling and airflow required; increasing energy efficiency and ensuring proper rack inlet air temperatures. The sensor data can also be reported to remote BMS and monitoring systems. The sensor network consists of one CAN wire leaving the cooling unit and connecting to a 2T sensor. Each remaining 2T sensor is connected to the previous sensor; often referred to as a daisy-chain configuration.

**REMOTE SHUTDOWN TERMINAL** Provides the customer with a location to remotely shut down the unit.

**COMMON ALARM CONTACT** Provides the customer with a set of normally open (n/o) contacts for remote indication of unit alarms.

**CABINET** The exterior steel panels are custom powder coated to protect against corrosion. The double wall constructed side panels separate the ½", 2.0 lb/ft<sup>3</sup> insulation from the airstream. The unit is mounted on casters for quick installation and provided with levelling feet. The perforated inlet and outlet panels have 81% open area, and the rear door utilizes a Knürr rack style handle and hinges.

**SERVICE ACCESS** All service and maintenance is performed through the front and rear of the unit; including any component removal. No side access is required. All electrical and piping connections are made through the top and/or bottom of the unit. All units are provided with a Superior Service Access Panel to provide additional access.

**FILTER** The unit is equipped with two deep pleated 4" filters rated MERV8 following ASHRAE 52.2-1999 (45% by ASHRAE 52.1-1992) or G4 following EN779, located within the cabinet, and accessible from the rear of the unit. A filter clog alarm is included.

**LOCKING DISCONNECT SWITCH** A molded case circuit interrupter disrupts the flow of power to the unit. The electric panel high voltage compartment can only be accessed with the switch in the 'off' position. Conveniently located behind the iCOM display door for quick access.

#### *Water/glycol cooled models*

**DX COOLING COIL** The evaporator coil has 7.25 ft<sup>2</sup> (0.674 m<sup>2</sup>) face area, 4 or 5 rows deep. It is constructed of copper tubes and hydrophilic coated aluminium fins. The hydrophilic coating

provides superior water carryover resistance. Two stainless steel condensate drain pans are provided.

**REFRIGERATION SYSTEM** Single refrigeration circuit includes a liquid line filter drier, an adjustable externally equalized expansion valve, and a liquid line solenoid valve.

**COMPRESSOR** The compressor is an R-410A scroll-type with variable capacity operation from 20-100%; commonly known as a Digital Scroll. Compressor solenoid valve shall unload the compressor to provide variable capacity operation. The compressor has a suction gas cooled motor, vibration isolators, internal thermal overloads, manual reset high pressure switch, RotoLock service valves, low pressure and high pressure transducer, crankcase heater, internal centrifugal oil pump, and an operating speed of 3500 RPM @ 60Hz (2900RPM @ 50Hz).

**FAN** The unit is equipped with two plug fans: direct driven centrifugal fans with backward curved blades and Electronically Commutated DC motors; commonly referred to as EC plug fans. The fan speed is variable and automatically regulated by the iCOM control through all modes of operation. Each fan has a dedicated motor and speed controller which provides a level of redundancy. The fans push air through the coil and are located on the rear panel of the unit.

**WATER / GLYCOL CONDENSER** Is an efficient stainless steel brazed-plate condenser. Waterside threaded connections are provided for convenience. Proper filtration must be field supplied when used on open-loop water systems (cooling towers, etc). When operating on a closed-loop, to avoid undesired ice formation in the wintertime, it is advisable to use a water/glycol mixture.

**3-W AY MODULATING VALVE** A 3-way modulating valve controls the water/glycol flow passing through the brazed-plate condenser. The iCOM control manages the valve actuator movement in order to maintain the desired condensing temperature for various entering water flow rates and temperatures. The maximum differential pressure across the closed valve is 300 kPa (43.5 PSI). Maximum system pressure is 230 PSI (1586 kPa).

**SUPPLY AIR BAFFLE** A field adjustable, modular supply air baffle is located in the discharge air stream. It can be quickly and easily reconfigured to redirect airflow. The angles of the vanes have been optimized to effectively distribute air to heat generating equipment in a wide variety of applications.

**iCOM CONTROL SYSTEM** The Liebert CRV is controlled by the iCOM Control System. The standard user interface is the Large Graphical Display (320x240 pixels, backlit) which presents system information and allows all parameters to be viewed and adjusted. It features push-button navigation, operational status LEDs, and a 3-level password protection system. Unit-to-Unit communication with other Liebert CRVs and two IntelliSlot communication card housings are included as standard.

**2T RACK TEMPERATURE SENSORS** Consist of a vented case with two temperature probes. Up to 10 2T housings (20 temperature probes) can be connected to a Liebert CRV. One 2T housing and both sensor probes are to be attached to a rack the cooling unit is conditioning. The sensors provide real-time, direct feedback to the cooling unit to optimize the amount of cooling and airflow required; increasing energy efficiency and ensuring proper rack inlet air temperatures. The sensor data can also be reported to remote BMS and monitoring systems. The sensor network consists of one CAN wire leaving the cooling unit and connecting to a 2T sensor. Each remaining 2T sensor is connected to the previous sensor; often referred to as a daisy-chain configuration.

**REMOTE SHUTDOWN TERMINAL** Provides the customer with a location to remotely shut down the unit.

**COMMON ALARM CONTACT** Provides the customer with a set of normally open (n/o) contacts for remote indication of unit alarms.

**CABINET** The exterior steel panels are custom powder coated to protect against corrosion. The double wall constructed side panels separate the ½", 2.0 lb/ft<sup>3</sup> insulation from the airstream. The unit is mounted on casters for quick installation and provided with leveling feet. The perforated inlet and outlet panels have 81% open area, and the rear door utilizes a Knürr rack style handle and hinges.

**SERVICE ACCESS** All service and maintenance is performed through the front and rear of the unit; including any component removal. No side access is required. All electrical and piping connections are made through the top and/or bottom of the unit. All units are provided with a Superior Service Access Panel to provide additional access.

**FILTER** The unit is equipped with two deep pleated 4" filters rated MERV8 following ASHRAE 52.2-1999 (45% by ASHRAE 52.1-1992) or G4 following EN779, located within the cabinet, and accessible from the rear of the unit. A filter clog alarm is included.

**LOCKING DISCONNECT SWITCH** A molded case circuit interrupter disrupts the flow of power to the unit. The electric panel high voltage compartment can only be accessed with the switch in the 'off' position. Conveniently located behind the iCOM display door for quick access.

## *Chilled water models*

**CW COOLING COIL** The evaporator coil has 0.674 m<sup>2</sup> (7.25 ft<sup>2</sup>) face area, 6 rows deep. It is constructed of copper tubes and hydrophilic coated aluminium fins. The hydrophilic coating provides superior water carryover resistance. Two stainless steel condensate drain pans are provided.

**CHILLED WATER SYSTEM** The water circuit includes a 3-way modulating valve. The Liebert iCOM control positions the valve in response to room conditions. Cooling capacity will be controlled by bypassing chilled water around the coil.

**FAN** The unit is equipped with two plug fans: direct driven centrifugal fans with backward curved blades and Electronically Commutated DC motors; commonly referred to as EC plug fans. The fan speed is variable and automatically regulated by the iCOM control through all modes of operation. Each fan has a dedicated motor and speed controller which provides a level of redundancy. The fans push air through the coil and are located on the rear panel of the unit.

**3-W AY MODULATING VALVE** A 3-way modulating valve controls the chilled water flow passing through the cooling coil. The iCOM control manages the valve actuator movement in order to provide the desired amount of cooling for various entering water flow rates and temperatures. Cooling capacity is regulated by bypassing chilled water around the coil. The maximum differential pressure across the closed valve is 175 kPa (25.4 PSI). Maximum system pressure is 230 PSI (1586 kPa).

**SUPPLY AIR BAFFLE** A field adjustable, modular supply air baffle is located in the discharge air stream. It can be quickly and easily reconfigured to redirect airflow. The angles of the vanes have been optimized to effectively distribute air to heat generating equipment in a wide variety of applications.

**iCOM CONTROL SYSTEM** The Liebert CRV is controlled by the iCOM Control System. The standard user interface is the Large Graphical Display (320x240 pixels, backlit) which presents system information and allows all parameters to be viewed and adjusted. It features push-button navigation, operational status LEDs, and a 3-level password protection system. Unit-to-Unit communication with other Liebert CRVs and two IntelliSlot communication card housings are included as standard.

**2T RACK TEMPERATURE SENSORS** Consist of a vented case with two temperature probes. Up to 10 2T housings (20 temperature probes) can be connected to a Liebert CRV. One 2T housing and both sensor probes are to be attached to a rack the cooling unit is conditioning. The sensors provide real-time, direct feedback to the cooling unit to optimize the amount of cooling and airflow required; increasing energy efficiency and ensuring proper rack inlet air temperatures. The sensor data can also be reported to remote BMS and monitoring systems. The sensor network consists of one CAN wire leaving the cooling unit and connecting to a 2T sensor. Each remaining 2T sensor is connected to the previous sensor; often referred to as a daisy-chain configuration.

**REMOTE SHUTDOWN TERMINAL** Provides the customer with a location to remotely shut down the unit.

**COMMON ALARM CONTACT** Provides the customer with a set of normally open (n/o) contacts for remote indication of unit alarms.

**CABINET** The exterior steel panels are custom powder coated to protect against corrosion. The double wall constructed side panels separate the 1/2", 2.0 lb/ft<sup>3</sup> insulation from the airstream. The unit is mounted on casters for quick installation and provided with leveling feet. The perforated inlet and outlet panels have 81% open area, and the rear door utilizes a Knürr rack style handle and hinges.

**SERVICE ACCESS** All service and maintenance is performed through the front and rear of the unit; including any component removal. No side access is required. All electrical and piping connections are made through the top and/or bottom of the unit. All units are provided with a Superior Service Access Panel to provide additional access.

**FILTER** The unit is equipped with two deep pleated 4" filters rated MERV8 following ASHRAE 52.2-1999 (45% by ASHRAE 52.1-1992) or G4 following EN779, located within the cabinet, and accessible from the rear of the unit. A filter clog alarm is included.

**LOCKING DISCONNECT SWITCH** A molded case circuit interrupter disrupts the flow of power to the unit. The electric panel high voltage compartment can only be accessed with the switch in the 'off' position. Conveniently located behind the iCOM display door for quick access.

## 3.2 Optional features

### *Air cooled models*

**DUAL-FL OAT CONDENSATE PUMP** It has a capacity of 6 GPM (22.7 l/min) at 30ft (9 m) head. Pump is complete with integral primary and secondary float switches, pump, motor assembly and reservoir. The secondary float shall send a signal to the local alarm and shut down the unit upon high water condition.

**HUMIDIFIER** A steam generating canister humidifier is factory-installed in the cooling unit and is operated by the iCOM control system. It is complete with disposable cylinder, all supply and drain valves, steam distributor and electronic controls. The need to change the canister is indicated on the iCOM display. The humidifier is designed to operate with water conductivity from 125-500 (50Hz) or 330-670 (60Hz) microS/cm. System automatically fills and drains as well as maintains the required water level based on conductivity. An air-gap within the humidifier assembly shall prevent backflow of the humidifier supply water. The humidifier is removable from the rear of the cabinet.

**ELECTRIC REHEAT** The electric reheat coils are low watt density, 304 stainless steel fin-tubular construction, protected by thermal safety switches and controlled in one stage.

**INTELLISLOT WEB CARD (IS-WEBL)** Provides 10/100 baseT Ethernet connectivity for unit monitoring and management. The supported management interfaces include: SNMP for Network Management Systems and HTTP for web page viewing.

**INTELLISLOT 485 CARD (IS-485L)** Provides RS-485 Modbus network connectivity to Building Management Systems for unit monitoring and management.

**FILTER** The optional filters are two deep pleated 4" (102 mm) rated MERV11 following ASHRAE 52.2-1999 (60-65% by ASHRAE 52.1-1992) or F5 following EN779, located within the cabinet and accessible from the rear of the unit. A filter clog alarm is included.

**REHEAT/HUMIDIFIER LOCKOUT** Includes the necessary relays to disable the reheat and humidifier from an external 24 volt signal.

**ONE (1) EXTRA COMMON ALARM CONTACT** Provides the customer with a total of two sets of normally open (n/o) contacts for remote indication of unit alarms.

**LIQUI-TECT SENSOR** Is a solid state water sensor that has no moving parts and is hermetically sealed to keep out dust and dirt. When the sensor detects the presence of moisture the alarm system is activated.

### *Water/glycol cooled models*

**DUAL-FL OAT CONDENSATE PUMP** It has a capacity of 6 GPM (22.7 l/min) at 30ft (9 m) head. Pump is complete with integral primary and secondary float switches, pump, motor assembly and reservoir. The secondary float shall send a signal to the local alarm and shut down the unit upon high water condition.

**HUMIDIFIER** A steam generating canister humidifier is factory-installed in the cooling unit and is operated by the iCOM control system. It is complete with disposable cylinder, all supply and drain valves, steam distributor and electronic controls. The need to change the canister is indicated on the iCOM display. The humidifier is designed to operate with water conductivity from 125-500 (50Hz) or 330-670 (60Hz) microS/cm. System automatically fills and drains as well as maintains the required water level based on conductivity. An air-gap within the humidifier assembly shall prevent backflow of the humidifier supply water. The humidifier is removable from the rear of the cabinet.

**ELECTRIC REHEAT** The electric reheat coils are low watt density, 304 stainless steel fin-tubular construction, protected by thermal safety switches and controlled in one stage.

**2-W AY MODULATING VALVE** A 2-way modulating valve controls the water/glycol flow passing through the brazed-plate condenser. The iCOM control manages the valve actuator movement in order to maintain the desired condensing temperature for various entering water flow rates and temperatures. The maximum differential pressure across the closed valve is 300 kPa (43.5 PSI). Maximum system pressure is 230 PSI (1586 kPa).

**INTELLISLOT WEB CARD (IS-WEBL)** Provides 10/100 baseT Ethernet connectivity for unit monitoring and management. The supported management interfaces include: SNMP for Network Management Systems and HTTP for web page viewing.

**INTELLISLOT 485 CARD (IS-485L)** Provides RS-485 Modbus network connectivity to Building Management Systems for unit monitoring and management.

**FILTER** The optional filters are two deep pleated 4" (102 mm) rated MERV11 following ASHRAE 52.2-1999 (60-65% by ASHRAE 52.1-1992) or F5 following EN779, located within the cabinet and accessible from the rear of the unit. A filter clog alarm is included.

**REHEAT/HUMIDIFIER LOCKOUT** Includes the necessary relays to disable the reheat and humidifier from an external 24 volt signal.

**ONE (1) EXTRA COMMON ALARM CONTACT** Provides the customer with a total of two sets of normally open (n/o) contacts for remote indication of unit alarms.

**LIQUI-TECT SENSOR** Is a solid state water sensor that has no moving parts and is hermetically sealed to keep out dust and dirt. When the sensor detects the presence of moisture the alarm system is activated.

### *Chilled water models*

**DUAL-FL OAT CONDENSATE PUMP** It has a capacity of 6 GPM (22.7 l/min) at 30ft (9m) head. Pump is complete with integral primary and secondary float switches, pump, motor assembly and reservoir. The secondary float shall send a signal to the local alarm and shut down the unit upon high water condition.

**HUMIDIFIER** A steam generating canister humidifier is factory-installed in the cooling unit and is operated by the iCOM control system. It is complete with disposable cylinder, all supply and drain valves, steam distributor and electronic controls. The need to change the canister is indicated on the iCOM display. The humidifier is designed to operate with water conductivity from 125-500 (50Hz) or 330-670 (60Hz) microS/cm. System automatically fills and drains as well as maintains the required water level based on conductivity. An air-gap within the humidifier assembly shall prevent backflow of the humidifier supply water. The humidifier is removable from the rear of the cabinet.

**ELECTRIC REHEAT** The electric reheat coils are low watt density, 304 stainless steel fin-tubular construction, protected by thermal safety switches and controlled in one stage.

**2-W AY MODULATING VALVE** A 2-way modulating valve controls the chilled water flow passing through the cooling coil. The iCOM control manages the valve actuator movement in order to provide the desired amount of cooling for various entering water flow rates and temperatures. Cooling capacity is regulated by closing-off the chilled water flow. The maximum differential pressure across the closed valve is 175 kPa (25.4 PSI). Maximum system pressure is 230 PSI (1586 kPa).

**INTELLISLOT WEB CARD (IS-WEBL)** Provides 10/100 baseT Ethernet connectivity for unit monitoring and management. The supported management interfaces include: SNMP for Network Management Systems and HTTP for web page viewing.

**INTELLISLOT 485 CARD (IS-485L)** Provides RS-485 Modbus network connectivity to Building Management Systems for unit monitoring and management.

**FILTER** The optional filters are two deep pleated 4" (102 mm) rated MERV11 following ASHRAE 52.2-1999 (60-65% by ASHRAE 52.1-1992) or F5 following EN779, located within the cabinet and accessible from the rear of the unit. A filter clog alarm is included.


**REHEAT/HUMIDIFIER LOCKOUT** Includes the necessary relays to disable the reheat and humidifier from an external 24 volt signal.

**ONE (1) EXTRA COMMON ALARM CONTACT** Provides the customer with a total of two sets of normally open (n/o) contacts for remote indication of unit alarms.

**LIQUI-TECT SENSOR** Is a solid state water sensor that has no moving parts and is hermetically sealed to keep out dust and dirt. When the sensor detects the presence of moisture the alarm system is activated.

## 3.3 Digit nomenclature

The unit is fully defined by twenty-five digits.B

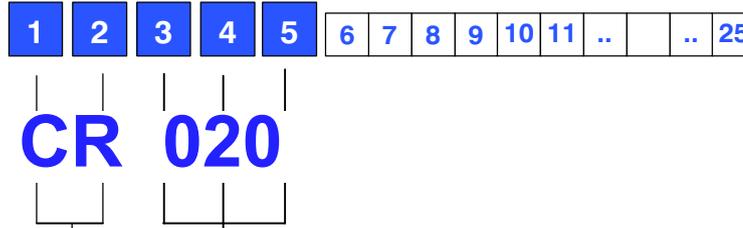

Digit 1 and 2

Digit 3, 4 and 5

**Family**  
**CR**

**Size: Cooling Capacity “kW” (approx.)**  
Nominal Cooling Capacity

### Digit 6 - Air Discharge

**R** Air Discharge Horizontal airflow

### Digit 7 - System Type

**A** System Type air cooled  
**W** System Type water cooled  
**C** System Type Chilled Water

### Digit 8 - Airflow

**1** Airflow - EC Plug Fan

### Digit 9 - Power Supply

**0** Power Supply 400V / 3ph / 50Hz+N  
**C** Power Supply 208V / 3ph / 60Hz  
**A** Power Supply 460V / 3ph / 60Hz

### Digit 10 - Cooling System

**2** Cooling Systems - CW with two way Valve  
**3** Cooling Systems - CW with Three Way  
**7** Cooling Systems - DX with digital scroll Single Circuit R410A

### Digit 11 - Humidification

**0** Humidification - none  
**S** Humidification - electrode humidifier

### Digit 12 - Display

**A** Display - Small Display 1 T+H Sensor  
**N** Display - Small Display 1 Temp Sensor Only  
**D** Display - Large Display 1 T +H sensor  
**C** Display - Large Display 1 Temp sensor Only

### Digit 13 - Re-Heating

**0** Re-heating - none  
**1** Re-heating - electric heating 1 Level

### Digit 14 - Air Filter

**0** Air Filter - G4 (EU4)  
**1** Air Filter - F 5 (EU5)  
**2** Air Filter - G4 (EU4) + Clogged Filter Alarm  
**3** Air Filter - F 5 (EU5) + Clogged Filter Alarm  
**8** Air Filter - Merv 8 + Clogged Filter Alarm  
**9** Air Filter - Merv 11 + Clogged Filter Alarm

### Digit 15 - Coil

**1** Coil - Air cooled - water cooled two ways water valve  
**7** Coil - water cooled 3 ways water valve  
**H** Coil - CW Standard coil

### Digit 16 - Enclosure options

**1** Enclosure - Color Standard  
**2** Enclosure - Color Special

### Digit 17 - Condensate pump

**L** No condensate pump  
**5** Condensate pump

### Digit 18 - Option Package

**0** Option Package None  
**L** Option Package #1 - humidifier and reheat lockout & compressor jacket & one additional alarm  
**H** Option Package - Reheat & Humidifier Lockout  
**C** Option Package #2 - humidifier and reheat lockout & one additional alarm  
**D** Option Package #3 - compressor jacket

### Digit 19 - Monitoring

**N** Without IS housing  
**0** With IS housing / no card  
**1** One IS web card  
**2** Two IS web cards  
**3** One IS485 card  
**4** Two IS485 cards  
**5** IS web & IS 485 cards

### Digit 20 - Sensors

**0** Sensors - None  
**H** Sensors - High Temperature - Firestat  
**S** Sensors - Smoke Sensor - Smokestat  
**F** Sensors - Smoke & High Temp - Smoke and Firestat

### Digit 21 - Packaging

**P** Packaging - PLP and pallet Domestic  
**C** Packaging - PLP and wooden crate Export  
**S** Packaging - seaworthy

### Digit 22 - Special Requirements

**A** SFA - none  
**X** SFA included

### Digit 23-25 -Order Identifier

# 4 Operation

---

Unit operation is completely automatic. The below sequence explains how the unit operates :

- The air, sucked in by the continuously operating fans, enters the unit.
- The air is immediately filtered.
- The TEMPERATURE sensor or HUMITEMP (temperature + rel. humidity) sensor (depends on unit configuration), verifies the state of the inlet air, and relays this information to the control system.
- The air is treated and then blown out of the unit.
- The control system compares the relayed information to the set point and proportional band values programmed into its memory: it then commands the air conditioner to treat the air as follows (see also Control manual).

## 4.1 Cooling

- Direct expansion mode (DX)  
The compressor is started and the cold refrigerant flows through the evaporator, thus cooling the air passing over it. For compressor operation see Control manual.
- Chilled water mode (CW)  
The three ways valve is opened and the chilled water flows through the coil, thus cooling the air passing over it.  
For valve operation see Control manual.

## 4.2 Heating

- Electrical heating (optional): the heating elements heat the air passing over them. There is one heating steps activate in case of dehumidification if supply air temperature is too low (for heating logic see Control manual)

## 4.3 Dehumidification

- DX mode  
The compressors starts and either the air flow or the evaporator surface is reduced (increasing modulation capacity of compressor), thereby causing dehumidification (refer also to Control manual).
  - N.B.: If, during dehumidification, the ambient temperature drops below a specified level, dehumidification will be stopped if necessary (see LOW LIMIT intervention in Control manual).
- In dehumidification mode, the air after passing over the coil it's reheated (if needed) by electrical heater to re-stabilize the initial temperature

## 4.4 Humidification - optional

- The humidifier creates steam, which is distributed into the air via the steam distribution pipe

# 5

## Microprocessor Controls


### 5.1 iCom Control

Liebert CRV models are controlled by iCOM Medium Board (Fig. 10).

The control board is housed in the electrical panel and it is connected to the remote display, to be installed in the container/room (connection cable is included).

- The standard user interface is a graphical display (128 x 64 pixels, backlit) showing parameter values and the relevant symbols/codes in a tree menu. It features navigation push-buttons and status leds. Self-explanatory icons are used for the menu-layout of the display.
- Status Report of the latest 400 event-messages of the unit.
- Graphic Data Records for temperature and humidity
- Both high and low priority alarms activate a visual indicator and buzzer.
- Input for remote on-off and volt-free contacts for simple remote monitoring of low and high priority alarms: high/low temperature, high/low refrigerant pressure, fan/control failure, compressor/control failure and others are available.
- LAN management: functions provided as standard include stand-by (in case of failure of the unit in operation, the second one starts automatically), and automatic rotation.
- All settings are protected through a 3-Level password system (\*).
- Automatic restart is provided after a power failure.

Fig. 5.a

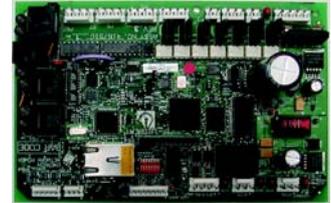

Tab. 5a - Technical Data

| Technical Data                                | iCom Medium   |
|---|---|
| E2prom  | 4Mbit + 512kbit   |
| Flash memory                                  | 32Mbit  |
| RAM memory space                              | 128Mbit   |
| Microcontroller                               | Coldfire 32Mbit   |
| Analogue Input                                | 3 x 0-10V, 0-5V, 4..20mA (selectable) + 2 PTC/NTC + 3 NTC             |
| Digital Input                                 | 9 x opto-coupled  |
| Analogue Output                               | 2 x 0-10V   |
| Digital Output                                | 7 triacs output and 2 relay output                                    |
| Time and date function buffered by LI-battery |   |
| Hirobus Lan connectors                        | 2 RJ45 sockets (for unit in LAN, remote display)                      |
| Ethernet network connectors                   | 1 RJ45 socket   |
| CAN bus connectors                            | 2 RJ12 sockets  |
| Hironet connectors                            | 1 RJ9 socket for RS485 (direct connection to proprietary supervision) |

# Microprocessor Controls

---

## 5.2 CDL Graphic Display (option)

- Large graphic display (320 x 240 pixels)
- Self-explanatory icons are used for the menu-layout of the CDL Display.
- Status Report of the latest 400 event-messages of the unit/system.
- Graphic Data Records for temperature and humidity, selectable timeframes from 8 minutes to 2 weeks.
- Semi or Full Manual Mode software management including all safety devices.
- 4-Level Password system to protect all settings.
- Ergonomic design for use also as portable device (start-up and "flying connections" by service personnel).



### **Technical Data CDL Graphic Display**

- Microcontroller: ..... Coldfire 32Mbit
- Ethernet network connectors ..... 2 RJ45 sockets (for unit in LAN, remote display)
- CAN bus connectors ..... 2 RJ12 sockets
- Power supply: ..... via CAN bus or external 12Vdc supply

# 6

## Specifications - Air cooled

### 6.1 Performances - air cooled

Tab. 6a - Air cooled - 50 Hz

| 50 Hz                          | Cond. Temp. 45°C (113°F) |        |         |        |
|--------------------------------|--------------------------|--------|---------|--------|
|                                | CR035RA                  |        | CR020RA |        |
| <b>40°C DB (104°F) 20% RH</b>  |                          |        |         |        |
| Total kW (BTU/H)               | 38.7                     | 132083 | 24.3    | 82936  |
| Sensible kW (BTU/H)            | 38.7                     | 132083 | 24.3    | 82936  |
| Unit Power Input kW (BTU/H)    | 9.59                     | 32731  | 6.12    | 20888  |
| Heat rejection kW (BTU/H)      | 48.29                    | 164814 | 30.42   | 103823 |
| Supply Air Temperature °C (°F) | 18.1                     | 64.6   | 21.8    | 71.2   |
| <b>37°C DB (98,6°F) 24% RH</b> |                          |        |         |        |
| Total kW (BTU/H)               | 36.8                     | 125598 | 23.1    | 78840  |
| Sensible kW (BTU/H)            | 36.8                     | 125598 | 23.1    | 78840  |
| Unit Power Input kW (BTU/H)    | 9.59                     | 32731  | 6.1     | 20819  |
| Heat rejection kW (BTU/H)      | 46.39                    | 158329 | 29.2    | 99660  |
| Supply Air Temperature °C (°F) | 16.4                     | 61.5   | 19.8    | 67.6   |
| <b>35°C DB (95°F) 26% RH</b>   |                          |        |         |        |
| Total kW (BTU/H)               | 35.8                     | 122185 | 22.3    | 76110  |
| Sensible kW (BTU/H)            | 35.2                     | 120138 | 22.3    | 76110  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.08    | 20751  |
| Heat rejection kW (BTU/H)      | 45.38                    | 154882 | 28.38   | 96861  |
| Supply Air Temperature °C (°F) | 15.4                     | 59.7   | 18.5    | 65.3   |
| <b>32°C DB (89,6°F) 29% RH</b> |                          |        |         |        |
| Total kW (BTU/H)               | 34.3                     | 117066 | 21.1    | 72014  |
| Sensible kW (BTU/H)            | 34.1                     | 116383 | 21.1    | 72014  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.06    | 20683  |
| Heat rejection kW (BTU/H)      | 43.88                    | 149762 | 27.16   | 92697  |
| Supply Air Temperature °C (°F) | 13.2                     | 55.8   | 16.5    | 61.7   |
| <b>30°C DB (86°F) 34% RH</b>   |                          |        |         |        |
| Total kW (BTU/H)               | 33.8                     | 115359 | 20.5    | 69967  |
| Sensible kW (BTU/H)            | 31.5                     | 107510 | 20.5    | 69967  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.04    | 20615  |
| Heat rejection kW (BTU/H)      | 43.38                    | 148056 | 26.54   | 90581  |
| Supply Air Temperature °C (°F) | 12.8                     | 55.0   | 13.8    | 56.8   |
| <b>28°C DB (82,4) 38% RH</b>   |                          |        |         |        |
| Total kW (BTU/H)               | 33.4                     | 113994 | 20.5    | 69967  |
| Sensible kW (BTU/H)            | 29.5                     | 100684 | 20.3    | 69284  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.04    | 20615  |
| Heat rejection kW (BTU/H)      | 42.98                    | 146691 | 26.54   | 90581  |
| Supply Air Temperature °C (°F) | 12                       | 53.6   | 13.4    | 56.1   |
| <b>28°C DB (82,4) 45% RH</b>   |                          |        |         |        |
| Total kW (BTU/H)               | 34.6                     | 118090 | 21.4    | 73038  |
| Sensible kW (BTU/H)            | 27.1                     | 92492  | 18.6    | 63482  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.06    | 20683  |
| Heat rejection kW (BTU/H)      | 44.18                    | 150786 | 27.46   | 93721  |
| Supply Air Temperature °C (°F) | 13.1                     | 55.6   | 14.6    | 58.3   |
| <b>25°C DB (77°F) 45% RH</b>   |                          |        |         |        |
| Total kW (BTU/H)               | 32.3                     | 110240 | 19.9    | 67919  |
| Sensible kW (BTU/H)            | 26.7                     | 91127  | 18.1    | 61775  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.03    | 20580  |
| Heat rejection kW (BTU/H)      | 41.88                    | 142936 | 25.93   | 88499  |
| Supply Air Temperature °C (°F) | 10.6                     | 51.1   | 12.1    | 53.8   |
| <b>25°C DB (77°F) 40% RH</b>   |                          |        |         |        |
| Total kW (BTU/H)               | 31.3                     | 106827 | 19.3    | 65871  |
| Sensible kW (BTU/H)            | 28.1                     | 95905  | 19.1    | 65188  |
| Unit Power Input kW (BTU/H)    | 9.58                     | 32697  | 6.02    | 20546  |
| Heat rejection kW (BTU/H)      | 40.88                    | 139523 | 25.32   | 86417  |
| Supply Air Temperature °C (°F) | 9.9                      | 49.8   | 11.3    | 52.3   |
| <b>22°C DB (71,6°F) 55% RH</b> |                          |        |         |        |
| Total kW (BTU/H)               | 31.3                     | 106827 | 19.3    | 65871  |

## Specifications - Air cooled

|                                |       |        |       |       |
|--------------------------------|-------|--------|-------|-------|
| Sensible kW (BTU/H)            | 23.1  | 78840  | 15.3  | 52219 |
| Unit Power Input kW (BTU/H)    | 9.58  | 32697  | 6.02  | 20546 |
| Heat rejection kW (BTU/H)      | 40.88 | 139523 | 25.32 | 86417 |
| Supply Air Temperature °C (°F) | 9.6   | 49.3   | 11.2  | 52.2  |
| <b>22°C DB (71,6°F) 50% RH</b> |       |        |       |       |
| Total kW (BTU/H)               | 30.5  | 104097 | 18.9  | 64506 |
| Sensible kW (BTU/H)            | 24.4  | 83277  | 16.4  | 55973 |
| Unit Power Input kW (BTU/H)    | 9.57  | 32662  | 6.09  | 20785 |
| Heat rejection kW (BTU/H)      | 40.07 | 136759 | 24.99 | 85291 |
| Supply Air Temperature °C (°F) | 9     | 48.2   | 10.4  | 50.7  |

Record the power consumption of the fan at various operating percentages (min - 100%).

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be  $\pm 5\%$ .

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - Air cooled

Tab. 6b - Air cooled - 60 Hz

| 60 Hz  | Cond. Temp. 120°F (48,9°C) |        |         |        |
|--|----------------------------|--------|---------|--------|
|  | CR035RA                    |        | CR020RA |        |
| <b>105°F DB, 71°F WB (40.6°C DB, 21.6°C WB) 17% RH</b>   |                            |        |         |        |
| Total kW (BTU/H)   | 40.4                       | 137885 | 24.6    | 83960  |
| Sensible kW (BTU/H)                                      | 40.4                       | 137885 | 24.6    | 83960  |
| Unit Power Input kW (BTU/H)                              | 11.09                      | 37850  | 6.9     | 23550  |
| Heat rejection kW (BTU/H)                                | 51.5                       | 175770 | 31.5    | 107510 |
| Supply Air Temperature °C (°F)                           | 17.7                       | 63.9   | 22.1    | 71.8   |
| <b>100°F DB, 69.5°F WB (37.8°C DB, 20.8°C WB) 20% RH</b> |                            |        |         |        |
| Total kW (BTU/H)   | 38.5                       | 131401 | 23.4    | 79864  |
| Sensible kW (BTU/H)                                      | 38.5                       | 131401 | 23.4    | 79864  |
| Unit Power Input kW (BTU/H)                              | 11.1                       | 37884  | 6.86    | 23413  |
| Heat rejection kW (BTU/H)                                | 49.6                       | 169285 | 30.3    | 103414 |
| Supply Air Temperature °C (°F)                           | 16.1                       | 61.0   | 20.3    | 68.5   |
| <b>95°F DB, 67.9°F WB (35°C DB, 19.9°C WB) 23% RH</b>    |                            |        |         |        |
| Total kW (BTU/H)   | 36.7                       | 125257 | 22.3    | 76110  |
| Sensible kW (BTU/H)                                      | 36.7                       | 125257 | 22.3    | 76110  |
| Unit Power Input kW (BTU/H)                              | 11.11                      | 37918  | 6.82    | 23277  |
| Heat rejection kW (BTU/H)                                | 47.8                       | 163141 | 29.1    | 99318  |
| Supply Air Temperature °C (°F)                           | 14.5                       | 58.1   | 18.5    | 65.3   |
| <b>90°F DB, 66.2°F WB (32.2°C DB, 19.0°C WB) 27% RH</b>  |                            |        |         |        |
| Total kW (BTU/H)   | 35.2                       | 120138 | 21.2    | 72356  |
| Sensible kW (BTU/H)                                      | 35.2                       | 120138 | 21.2    | 72356  |
| Unit Power Input kW (BTU/H)                              | 11.11                      | 37918  | 6.78    | 23140  |
| Heat rejection kW (BTU/H)                                | 46.3                       | 158022 | 28      | 95564  |
| Supply Air Temperature °C (°F)                           | 12.5                       | 54.5   | 16.6    | 61.9   |
| <b>85°F DB, 64.5°F WB (29.4°C DB, 18.1°C WB) 31% RH</b>  |                            |        |         |        |
| Total kW (BTU/H)   | 34.3                       | 117066 | 20.1    | 68601  |
| Sensible kW (BTU/H)                                      | 33.4                       | 113994 | 20.1    | 68601  |
| Unit Power Input kW (BTU/H)                              | 11.12                      | 37953  | 6.74    | 23004  |
| Heat rejection kW (BTU/H)                                | 45.4                       | 154950 | 26.8    | 91468  |
| Supply Air Temperature °C (°F)                           | 11.1                       | 52.0   | 14.8    | 58.6   |
| <b>80°F DB, 62.8°F WB (26.7°C DB, 17.1°C WB) 37% RH</b>  |                            |        |         |        |
| Total kW (BTU/H)   | 33.4                       | 113994 | 19.9    | 67919  |
| Sensible kW (BTU/H)                                      | 30.3                       | 103414 | 19.9    | 67919  |
| Unit Power Input kW (BTU/H)                              | 11.12                      | 37953  | 6.73    | 22969  |
| Heat rejection kW (BTU/H)                                | 44.5                       | 151879 | 26.6    | 90786  |
| Supply Air Temperature °C (°F)                           | 10.3                       | 50.5   | 12.2    | 54.0   |
| <b>80°F DB, 66.5°F WB (26.7°C DB, 19.2°C WB) 50% RH</b>  |                            |        |         |        |
| Total kW (BTU/H)   | 35.6                       | 121503 | 21.3    | 72697  |
| Sensible kW (BTU/H)                                      | 26                         | 88738  | 17.3    | 59045  |
| Unit Power Input kW (BTU/H)                              | 11.11                      | 37918  | 6.79    | 23174  |
| Heat rejection kW (BTU/H)                                | 46.7                       | 159387 | 28.1    | 95905  |
| Supply Air Temperature °C (°F)                           | 12.4                       | 54.3   | 14.3    | 57.7   |
| <b>75°F DB, 62.5°F WB (23.9°C DB, 16.9°C WB) 50% RH</b>  |                            |        |         |        |
| Total kW (BTU/H)   | 33.4                       | 113994 | 19.9    | 67919  |
| Sensible kW (BTU/H)                                      | 25.7                       | 87714  | 16.8    | 57338  |
| Unit Power Input kW (BTU/H)                              | 11.12                      | 37953  | 6.73    | 22969  |
| Heat rejection kW (BTU/H)                                | 44.52                      | 151947 | 26.63   | 90888  |
| Supply Air Temperature °C (°F)                           | 10.1                       | 50.2   | 12      | 53.6   |
| <b>75°F DB, 61°F WB (23.9°C DB, 16.1°C WB) 45% RH</b>    |                            |        |         |        |
| Total kW (BTU/H)   | 32.4                       | 110581 | 19.4    | 66212  |
| Sensible kW (BTU/H)                                      | 27.1                       | 92492  | 17.7    | 60410  |
| Unit Power Input kW (BTU/H)                              | 11.12                      | 37953  | 6.71    | 22901  |
| Heat rejection kW (BTU/H)                                | 43.52                      | 148534 | 26.11   | 89113  |
| Supply Air Temperature °C (°F)                           | 9.4                        | 48.9   | 11.3    | 52.3   |
| <b>72°F DB, 60.1°F WB (22.2°C DB, 15.6°C WB) 50% RH</b>  |                            |        |         |        |
| Total kW (BTU/H)   | 31.8                       | 108533 | 19      | 64847  |
| Sensible kW (BTU/H)                                      | 25.2                       | 86008  | 16.4    | 55973  |
| Unit Power Input kW (BTU/H)                              | 11.12                      | 37953  | 6.7     | 22867  |

## Specifications - Air cooled

|   |       |        |       |       |
|---|-------|--------|-------|-------|
| Heat rejection kW (BTU/H)                               | 42.92 | 146486 | 25.7  | 87714 |
| Supply Air Temperature °C (°F)                          | 8.8   | 47.8   | 10.6  | 51.1  |
| <b>72°F DB, 58.7°F WB (22.2°C DB, 14.8°C WB) 45% RH</b> |       |        |       |       |
| Total kW (BTU/H)  | 30.9  | 105462 | 18.5  | 63141 |
| Sensible kW (BTU/H)                                     | 26.4  | 90103  | 17.4  | 59386 |
| Unit Power Input kW (BTU/H)                             | 11.11 | 37918  | 6.67  | 22765 |
| Heat rejection kW (BTU/H)                               | 42.01 | 143380 | 25.17 | 85905 |
| Supply Air Temperature °C (°F)                          | 8.1   | 46.6   | 9.9   | 49.8  |

Record the power consumption of the fan at various operating percentages (min - 100%).

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be  $\pm 5\%$ .

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - Water cooled

## 6.2 Performances - water cooled

Tab. 6c - Water cooled - 50 Hz

| 50 Hz                                    | 18°C (64,4°F) EWT - 40°C (104°F)<br>Cond. Temp. |        |         |        | 24°C (75,2°F) EWT - 40°C (104°F)<br>Cond. Temp. |        |         |        | 30°C (86°F) EWT - 45°C (113°F)<br>Cond. Temp. |        |         |        |
|--|---|--------|---------|--------|---|--------|---------|--------|---|--------|---------|--------|
|  | CR035RW   |        | CR020RW |        | CR035RW   |        | CR020RW |        | CR035RW                                       |        | CR020RW |        |
| <b>40°C DB (104°F) 20% RH</b>            |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 39.9  | 136179 | 24.3    | 82936  | 39.9  | 136179 | 24.3    | 82936  | 38.7  | 132083 | 24.3    | 82936  |
| Sensible kW (BTU/H)                      | 39.9  | 136179 | 24.3    | 82936  | 39.9  | 136179 | 24.3    | 82936  | 38.7  | 132083 | 24.3    | 82936  |
| Unit Power Input kW (BTU/H)              | 8.62  | 29420  | 5.37    | 18328  | 8.62  | 29420  | 5.37    | 18328  | 9.59  | 32731  | 6.12    | 20888  |
| Heat rejection kW (BTU/H)                | 48.5  | 165531 | 29.7    | 101366 | 48.5  | 165531 | 29.7    | 101366 | 48.3  | 164848 | 30.4    | 103755 |
| Flow Rate, l/s (GPM)                     | 0.63  | 9.99   | 0.385   | 6.10   | 1.042   | 16.52  | 0.634   | 10.05  | 1.149   | 18.21  | 0.722   | 11.44  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 26  | 8.70   | 18      | 6.02   | 66  | 22.08  | 44      | 14.72  | 79  | 26.43  | 55      | 18.40  |
| Supply Air Temperature °C (°F)           | 17.4  | 63.3   | 19.8    | 67.6   | 17.4  | 63.3   | 19.8    | 67.6   | 18.1  | 64.6   | 21.8    | 71.2   |
| <b>37°C DB (98,6°F) 24% RH</b>           |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 39.9  | 136179 | 25.1    | 85666  | 39.9  | 136179 | 25.1    | 85666  | 36.8  | 125598 | 23.1    | 78840  |
| Sensible kW (BTU/H)                      | 39.9  | 136179 | 25.1    | 85666  | 39.9  | 136179 | 25.1    | 85666  | 36.8  | 125598 | 23.1    | 78840  |
| Unit Power Input kW (BTU/H)              | 8.62  | 29420  | 5.53    | 18874  | 8.62  | 29420  | 5.53    | 18874  | 9.59  | 32731  | 6.1     | 20819  |
| Heat rejection kW (BTU/H)                | 48.5  | 165531 | 30.6    | 104438 | 48.5  | 165531 | 30.6    | 104438 | 46.4  | 158363 | 29.2    | 99660  |
| Flow Rate, l/s (GPM)                     | 0.63  | 9.99   | 0.398   | 6.31   | 1.007   | 15.96  | 0.627   | 9.94   | 1.095   | 17.36  | 0.688   | 10.91  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 26  | 8.70   | 19      | 6.36   | 62  | 20.74  | 43      | 14.39  | 72  | 24.09  | 50      | 16.73  |
| Supply Air Temperature °C (°F)           | 17.4  | 63.3   | 21.1    | 70.0   | 17.4  | 63.3   | 21.1    | 70.0   | 16.4  | 61.5   | 19.8    | 67.6   |
| <b>35°C DB (95°F) 26% RH</b>             |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 37.4  | 127646 | 23.1    | 78840  | 37.4  | 127646 | 23.1    | 78840  | 36.9  | 125940 | 22.3    | 76110  |
| Sensible kW (BTU/H)                      | 37.4  | 127646 | 23.1    | 78840  | 37.4  | 127646 | 23.1    | 78840  | 36.3  | 123892 | 22.3    | 76110  |
| Unit Power Input kW (BTU/H)              | 8.6   | 29352  | 5.49    | 18737  | 8.6   | 29352  | 5.49    | 18737  | 9.58  | 32697  | 6.08    | 20751  |
| Heat rejection kW (BTU/H)                | 46  | 156998 | 28.6    | 97612  | 46  | 156998 | 28.6    | 97612  | 45.4  | 154950 | 28.4    | 96929  |
| Flow Rate, l/s (GPM)                     | 0.594   | 9.42   | 0.369   | 5.85   | 0.978   | 15.50  | 0.606   | 9.61   | 1.068   | 16.93  | 0.665   | 10.54  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 22  | 7.36   | 16      | 5.35   | 58  | 19.40  | 40      | 13.38  | 68  | 22.75  | 47      | 15.72  |
| Supply Air Temperature °C (°F)           | 14.2  | 57.6   | 17.9    | 64.2   | 14.2  | 57.6   | 17.9    | 64.2   | 15.4  | 59.7   | 18.5    | 65.3   |
| <b>32°C DB (89,6°F) 29% RH</b>           |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 35.7  | 121844 | 21.9    | 74745  | 35.7  | 121844 | 21.9    | 74745  | 34.3  | 117066 | 21.1    | 72014  |
| Sensible kW (BTU/H)                      | 34.6  | 118090 | 21.9    | 74745  | 34.6  | 118090 | 21.9    | 74745  | 34.1  | 116383 | 21.1    | 72014  |
| Unit Power Input kW (BTU/H)              | 8.59  | 29318  | 5.46    | 18635  | 8.59  | 29318  | 5.46    | 18635  | 9.58  | 32697  | 6.06    | 20683  |
| Heat rejection kW (BTU/H)                | 44.3  | 151196 | 27.4    | 93516  | 44.3  | 151196 | 27.4    | 93516  | 43.8  | 149489 | 27.2    | 92834  |
| Flow Rate, l/s (GPM)                     | 0.57  | 9.03   | 0.352   | 5.58   | 0.937   | 14.85  | 0.576   | 9.13   | 1.025   | 16.25  | 0.633   | 10.03  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 22  | 7.36   | 15      | 5.02   | 54  | 18.07  | 37      | 12.38  | 63  | 21.08  | 43      | 14.39  |
| Supply Air Temperature °C (°F)           | 12.9  | 55.2   | 16      | 60.8   | 12.9  | 55.2   | 16      | 60.8   | 13.2  | 55.8   | 16.6    | 61.9   |
| <b>30°C DB (86°F) 34% RH</b>             |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 35.7  | 121844 | 21.9    | 74745  | 35.7  | 121844 | 21.9    | 74745  | 33.8  | 115359 | 20.9    | 71332  |
| Sensible kW (BTU/H)                      | 32.3  | 110240 | 21.5    | 73380  | 32.3  | 110240 | 21.5    | 73380  | 31.5  | 107510 | 20.9    | 71332  |
| Unit Power Input kW (BTU/H)              | 8.59  | 29318  | 5.46    | 18635  | 8.59  | 29318  | 5.46    | 18635  | 9.58  | 32697  | 6.05    | 20649  |
| Heat rejection kW (BTU/H)                | 44.3  | 151196 | 27.3    | 93175  | 44.3  | 151196 | 27.3    | 93175  | 43.3  | 147783 | 27      | 92151  |
| Flow Rate, l/s (GPM)                     | 0.57  | 9.03   | 0.351   | 5.56   | 0.935   | 14.82  | 0.575   | 9.11   | 1.011   | 16.02  | 0.627   | 9.94   |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 22  | 7.36   | 15      | 5.02   | 53  | 17.73  | 37      | 12.38  | 61  | 20.41  | 42      | 14.05  |
| Supply Air Temperature °C (°F)           | 12.3  | 54.1   | 14.4    | 57.9   | 12.3  | 54.1   | 14.4    | 57.9   | 12.8  | 55.0   | 14.6    | 58.3   |
| <b>28°C DB (82,4) 38% RH</b>             |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 35.1  | 119796 | 21.6    | 73721  | 35.1  | 119796 | 21.6    | 73721  | 33.4  | 113994 | 20.4    | 69625  |
| Sensible kW (BTU/H)                      | 30.3  | 103414 | 20.1    | 68601  | 30.3  | 103414 | 20.1    | 68601  | 29.5  | 100684 | 19.5    | 66554  |
| Unit Power Input kW (BTU/H)              | 8.59  | 29318  | 5.46    | 18635  | 8.59  | 29318  | 5.46    | 18635  | 9.58  | 32697  | 6.04    | 20615  |
| Heat rejection kW (BTU/H)                | 43.7  | 149148 | 27.1    | 92492  | 43.7  | 149148 | 27.1    | 92492  | 43  | 146759 | 26.5    | 90445  |
| Flow Rate, l/s (GPM)                     | 0.562   | 8.91   | 0.348   | 5.52   | 0.922   | 14.61  | 0.569   | 9.02   | 1.001   | 15.87  | 0.614   | 9.73   |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 20  | 6.69   | 15      | 5.02   | 53  | 17.73  | 36      | 12.04  | 61  | 20.41  | 40      | 13.38  |
| Supply Air Temperature °C (°F)           | 11.6  | 52.9   | 13.5    | 56.3   | 11.6  | 52.9   | 13.5    | 56.3   | 12  | 53.6   | 13.9    | 57.0   |
| <b>28°C DB (82,4) 45% RH</b>             |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 36.1  | 123209 | 22.4    | 76451  | 36.1  | 123209 | 22.4    | 76451  | 34.6  | 118090 | 21.4    | 73038  |
| Sensible kW (BTU/H)                      | 27.8  | 94881  | 18.4    | 62799  | 27.8  | 94881  | 18.4    | 62799  | 27.2  | 92834  | 18      | 61434  |
| Unit Power Input kW (BTU/H)              | 8.59  | 29318  | 5.47    | 18669  | 8.59  | 29318  | 5.47    | 18669  | 9.58  | 32697  | 6.06    | 206828 |
| Heat rejection kW (BTU/H)                | 44.7  | 152561 | 27.9    | 95223  | 44.7  | 152561 | 27.9    | 95223  | 44.2  | 150855 | 27.5    | 93858  |
| Flow Rate, l/s (GPM)                     | 0.576   | 9.13   | 0.359   | 5.69   | 0.947   | 15.01  | 0.589   | 9.34   | 1.034   | 16.39  | 0.641   | 10.16  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 22  | 7.36   | 15      | 5.02   | 55  | 18.40  | 38      | 12.71  | 65  | 21.75  | 44      | 14.72  |
| Supply Air Temperature °C (°F)           | 12.8  | 55.0   | 14.7    | 58.5   | 12.8  | 55.0   | 14.7    | 58.5   | 13.2  | 55.8   | 15      | 59.0   |
| <b>25°C DB (77°F) 45% RH</b>             |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)                         | 33.7  | 115018 | 20.8    | 70990  | 33.7  | 115018 | 20.8    | 70990  | 32.3  | 110240 | 19.9    | 67919  |
| Sensible kW (BTU/H)                      | 27.4  | 93516  | 17.9    | 61093  | 27.4  | 93516  | 17.9    | 61093  | 26.7  | 91127  | 17.5    | 59728  |

# Specifications - Water cooled

|  |       |        |       |       |       |        |       |       |       |        |       |       |
|--|-------|--------|-------|-------|-------|--------|-------|-------|-------|--------|-------|-------|
| Unit Power Input kW (BTU/H)              | 8.58  | 29284  | 5.44  | 18567 | 8.58  | 29284  | 5.44  | 18567 | 9.58  | 32697  | 6.03  | 20580 |
| Heat rejection kW (BTU/H)                | 42.3  | 144370 | 26.3  | 89762 | 42.3  | 144370 | 26.3  | 89762 | 41.9  | 143005 | 25.9  | 88397 |
| Flow Rate, l/s (GPM)                     | 0.542 | 8.59   | 0.336 | 5.33  | 0.888 | 14.08  | 0.549 | 8.70  | 0.971 | 15.39  | 0.598 | 9.48  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 20    | 6.69   | 14    | 4.68  | 49    | 16.39  | 34    | 11.37 | 57    | 19.07  | 39    | 13.05 |
| Supply Air Temperature °C (°F)           | 10.3  | 50.5   | 12.2  | 54.0  | 10.3  | 50.5   | 12.2  | 54.0  | 10.7  | 51.3   | 12.5  | 54.5  |
| <b>25°C DB (77°F) 40% RH</b>             |       |        |       |       |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)                         | 32.7  | 111605 | 20.3  | 69284 | 32.7  | 111605 | 20.3  | 69284 | 31.3  | 106827 | 19.4  | 66212 |
| Sensible kW (BTU/H)                      | 28.8  | 98294  | 19    | 64847 | 28.8  | 98294  | 19    | 64847 | 28.1  | 95905  | 18.6  | 63482 |
| Unit Power Input kW (BTU/H)              | 8.58  | 29284  | 5.43  | 18533 | 8.58  | 29284  | 5.43  | 18533 | 9.58  | 32697  | 6.02  | 20546 |
| Heat rejection kW (BTU/H)                | 41.3  | 140957 | 25.7  | 87714 | 41.3  | 140957 | 25.7  | 87714 | 40.9  | 139592 | 25.4  | 86690 |
| Flow Rate, l/s (GPM)                     | 0.528 | 8.37   | 0.329 | 5.21  | 0.863 | 13.68  | 0.536 | 8.50  | 0.943 | 14.95  | 0.585 | 9.27  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 18    | 6.02   | 14    | 4.68  | 46    | 15.39  | 32    | 10.71 | 54    | 18.07  | 37    | 12.38 |
| Supply Air Temperature °C (°F)           | 9.5   | 49.1   | 11.4  | 52.5  | 9.5   | 49.1   | 11.4  | 52.5  | 9.9   | 49.8   | 11.7  | 53.1  |
| <b>22°C DB (71,6°F) 55% RH</b>           |       |        |       |       |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)                         | 32.7  | 111605 | 20.3  | 69284 | 32.7  | 111605 | 20.3  | 69284 | 31.3  | 106827 | 19.4  | 66212 |
| Sensible kW (BTU/H)                      | 23.9  | 81571  | 15.4  | 52560 | 23.9  | 81571  | 15.4  | 52560 | 23.2  | 79182  | 15    | 51195 |
| Unit Power Input kW (BTU/H)              | 8.58  | 29284  | 5.43  | 18533 | 8.58  | 29284  | 5.43  | 18533 | 9.58  | 32697  | 6.02  | 20546 |
| Heat rejection kW (BTU/H)                | 41.3  | 140957 | 25.8  | 88055 | 41.3  | 140957 | 25.8  | 88055 | 40.9  | 139592 | 25.4  | 86690 |
| Flow Rate, l/s (GPM)                     | 0.528 | 8.37   | 0.329 | 5.21  | 0.864 | 13.69  | 0.537 | 8.51  | 0.944 | 14.96  | 0.586 | 9.29  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 18    | 6.02   | 14    | 4.68  | 46    | 15.39  | 32    | 10.71 | 54    | 18.07  | 37    | 12.38 |
| Supply Air Temperature °C (°F)           | 9.3   | 48.7   | 11.1  | 52.0  | 9.3   | 48.7   | 11.1  | 52.0  | 9.7   | 49.5   | 11.4  | 52.5  |
| <b>22°C DB (71,6°F) 50% RH</b>           |       |        |       |       |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)                         | 31.9  | 108875 | 19.8  | 67577 | 31.9  | 108875 | 19.8  | 67577 | 30.5  | 104097 | 18.9  | 64506 |
| Sensible kW (BTU/H)                      | 25    | 85325  | 16.3  | 55632 | 25    | 85325  | 16.3  | 55632 | 24.4  | 83277  | 15.9  | 54267 |
| Unit Power Input kW (BTU/H)              | 8.58  | 29284  | 5.42  | 18498 | 8.58  | 29284  | 5.42  | 18498 | 9.57  | 32662  | 6.01  | 20512 |
| Heat rejection kW (BTU/H)                | 40.5  | 138227 | 25.2  | 86008 | 40.5  | 138227 | 25.2  | 86008 | 40.1  | 136861 | 24.9  | 84984 |
| Flow Rate, l/s (GPM)                     | 0.516 | 8.18   | 0.322 | 5.10  | 0.843 | 13.36  | 0.524 | 8.31  | 0.921 | 14.60  | 0.572 | 9.07  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 18    | 6.02   | 12    | 4.01  | 44    | 14.72  | 31    | 10.37 | 52    | 17.40  | 36    | 12.04 |
| Supply Air Temperature °C (°F)           | 8.7   | 47.7   | 10.5  | 50.9  | 8.7   | 47.7   | 10.5  | 50.9  | 9.1   | 48.4   | 10.8  | 51.4  |

Record the power consumption of the fan at various operating percentages (min - 100%).

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be ±5%.

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - Water cooled

Tab. 6d - Water cooled - 60 Hz

| 60 Hz  | 65°F (18.3°C) EWT - 105°F (40.6°C)<br>Cond. Temp. |        |         |        | 75°F (23.9°C) EWT - 105°F (40.6°C)<br>Cond. Temp. |        |         |        | 85°F (29.4°C) EWT - 110°F (43.3°C)<br>Cond. Temp. |        |         |        |
|--|---|--------|---------|--------|---|--------|---------|--------|---|--------|---------|--------|
|  | CR035RW   |        | CR020RW |        | CR035RW   |        | CR020RW |        | CR035RW   |        | CR020RW |        |
| <b>105°F DB, 71°F WB (40.6°C DB, 21.6°C WB) 17% RH</b>   |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 42.9  | 146418 | 26      | 88738  | 42.9  | 146418 | 26      | 88738  | 42.2  | 144029 | 25.5    | 87032  |
| Sensible kW (BTU/H)                                      | 42.9  | 146418 | 26      | 88738  | 42.9  | 146418 | 26      | 88738  | 42.2  | 144029 | 25.5    | 87032  |
| Flow Rate, l/s (GPM)                                     | 0.669   | 10.60  | 0.408   | 6.47   | 1.05  | 16.64  | 0.638   | 10.11  | 1.483   | 23.51  | 0.896   | 14.20  |
| Pressure Drop, kPa (ft H2O)                              | 29  | 9.70   | 19      | 6.36   | 67  | 22.42  | 44      | 14.72  | 128   | 42.82  | 82      | 27.43  |
| Unit Power Input kW (BTU/H)                              | 9.42  | 32150  | 5.98    | 20410  | 9.42  | 32150  | 5.98    | 20410  | 9.97  | 34028  | 6.29    | 21468  |
| Heat rejection kW (BTU/H)                                | 52.2  | 178159 | 31.9    | 108875 | 52.5  | 179183 | 31.9    | 108875 | 52.1  | 177817 | 31.8    | 108533 |
| Supply Air Temperature °C (°F)                           | 16.2  | 61.2   | 21      | 69.8   | 16.2  | 61.2   | 21      | 69.8   | 16.6  | 61.9   | 21.3    | 70.3   |
| <b>100°F DB, 69.5°F WB (37.8°C DB, 20.8°C WB) 20% RH</b> |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 41  | 139933 | 24.8    | 84642  | 41  | 139933 | 24.8    | 84642  | 40.3  | 137544 | 24.4    | 83277  |
| Sensible kW (BTU/H)                                      | 41  | 139933 | 24.8    | 84642  | 41  | 139933 | 24.8    | 84642  | 40.3  | 137544 | 24.4    | 83277  |
| Flow Rate, l/s (GPM)                                     | 0.643   | 10.19  | 0.391   | 6.20   | 1.006   | 15.95  | 0.61    | 9.67   | 1.418   | 22.48  | 0.855   | 13.55  |
| Pressure Drop, kPa (ft H2O)                              | 26  | 8.70   | 18      | 6.02   | 62  | 20.74  | 41      | 13.72  | 118   | 39.48  | 76      | 25.43  |
| Unit Power Input kW (BTU/H)                              | 9.43  | 32185  | 5.95    | 20307  | 9.43  | 32185  | 5.95    | 20307  | 9.98  | 34062  | 6.26    | 21365  |
| Heat rejection kW (BTU/H)                                | 50.4  | 172015 | 30.7    | 104779 | 50.4  | 172015 | 30.7    | 104779 | 50.2  | 171333 | 30.6    | 104438 |
| Supply Air Temperature °C (°F)                           | 14.7  | 58.5   | 19.3    | 66.7   | 14.7  | 58.5   | 19.3    | 66.7   | 15.1  | 59.2   | 19.6    | 67.3   |
| <b>95°F DB, 67.9°F WB (35°C DB, 19.9°C WB) 23% RH</b>    |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 39.1  | 133448 | 23.7    | 80888  | 39.1  | 133448 | 23.7    | 80888  | 38.5  | 131401 | 23.2    | 79182  |
| Sensible kW (BTU/H)                                      | 39.1  | 133448 | 23.7    | 80888  | 39.1  | 133448 | 23.7    | 80888  | 38.5  | 131401 | 23.2    | 79182  |
| Flow Rate, l/s (GPM)                                     | 0.617   | 9.78   | 0.374   | 5.93   | 0.963   | 15.26  | 0.583   | 9.24   | 1.354   | 21.46  | 0.814   | 12.90  |
| Pressure Drop, kPa (ft H2O)                              | 24  | 8.03   | 17      | 5.69   | 57  | 19.07  | 37      | 12.38  | 108   | 36.13  | 69      | 23.08  |
| Unit Power Input kW (BTU/H)                              | 9.44  | 32219  | 5.91    | 20171  | 9.44  | 32219  | 5.91    | 20171  | 9.99  | 34096  | 6.22    | 21229  |
| Heat rejection kW (BTU/H)                                | 48.5  | 165531 | 29.5    | 100684 | 48.5  | 165531 | 29.5    | 100684 | 48.4  | 165189 | 29.4    | 100342 |
| Supply Air Temperature °C (°F)                           | 13.2  | 55.8   | 17.5    | 63.5   | 13.2  | 55.8   | 17.5    | 63.5   | 13.6  | 56.5   | 17.8    | 64.0   |
| <b>90°F DB, 66.2°F WB (32.2°C DB, 19.0°C WB) 27% RH</b>  |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 39.6  | 135155 | 22.5    | 76793  | 39.6  | 135155 | 22.5    | 76793  | 37.3  | 127305 | 22.1    | 75427  |
| Sensible kW (BTU/H)                                      | 38.6  | 131742 | 22.5    | 76793  | 38.6  | 131742 | 22.5    | 76793  | 36.8  | 125598 | 22.1    | 75427  |
| Flow Rate, l/s (GPM)                                     | 0.609   | 9.65   | 0.358   | 5.67   | 0.95  | 15.06  | 0.556   | 8.81   | 1.314   | 20.83  | 0.775   | 12.28  |
| Pressure Drop, kPa (ft H2O)                              | 24  | 8.03   | 15      | 5.02   | 55  | 18.40  | 34      | 11.37  | 102   | 34.12  | 62      | 20.74  |
| Unit Power Input kW (BTU/H)                              | 9.45  | 32253  | 5.87    | 20034  | 9.45  | 32253  | 5.87    | 20034  | 10  | 34130  | 6.18    | 21092  |
| Heat rejection kW (BTU/H)                                | 47.9  | 163483 | 28.3    | 96588  | 47.9  | 163483 | 28.3    | 96588  | 47.2  | 161094 | 28.2    | 96247  |
| Supply Air Temperature °C (°F)                           | 11.5  | 52.7   | 15.7    | 60.3   | 11.5  | 52.7   | 15.7    | 60.3   | 11.9  | 53.4   | 16      | 60.8   |
| <b>85°F DB, 64.5°F WB (29.4°C DB, 18.1°C WB) 31% RH</b>  |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 37.1  | 126622 | 22.5    | 76793  | 37.1  | 126622 | 22.5    | 76793  | 36.3  | 123892 | 21.8    | 74403  |
| Sensible kW (BTU/H)                                      | 34.8  | 118772 | 21.4    | 73038  | 34.8  | 118772 | 21.4    | 73038  | 34.4  | 117407 | 21.8    | 74403  |
| Flow Rate, l/s (GPM)                                     | 0.589   | 9.34   | 0.35    | 5.55   | 0.917   | 14.53  | 0.542   | 8.59   | 1.28  | 20.29  | 0.744   | 11.79  |
| Pressure Drop, kPa (ft H2O)                              | 22  | 7.36   | 15      | 5.02   | 51  | 17.06  | 33      | 11.04  | 97  | 32.45  | 58      | 19.40  |
| Unit Power Input kW (BTU/H)                              | 9.45  | 32253  | 5.86    | 20000  | 9.45  | 32253  | 5.86    | 20000  | 10  | 34130  | 6.15    | 20990  |
| Heat rejection kW (BTU/H)                                | 46.5  | 158705 | 27.7    | 94540  | 46.5  | 158705 | 27.7    | 94540  | 46.2  | 157681 | 27.3    | 93175  |
| Supply Air Temperature °C (°F)                           | 10.4  | 50.7   | 14.3    | 57.7   | 10.4  | 50.7   | 14.3    | 57.7   | 10.6  | 51.1   | 13.1    | 55.6   |
| <b>80°F DB, 62.8°F WB (26.7°C DB, 17.1°C WB) 37% RH</b>  |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 36.1  | 123209 | 21.6    | 73721  | 36.1  | 123209 | 21.6    | 73721  | 35.3  | 120479 | 21      | 71673  |
| Sensible kW (BTU/H)                                      | 31.7  | 108192 | 20.3    | 69284  | 31.7  | 108192 | 20.3    | 69284  | 31.3  | 106827 | 20      | 68260  |
| Flow Rate, l/s (GPM)                                     | 0.575   | 9.11   | 0.344   | 5.45   | 0.894   | 14.17  | 0.533   | 8.45   | 1.247   | 19.77  | 0.737   | 11.68  |
| Pressure Drop, kPa (ft H2O)                              | 22  | 7.36   | 14      | 4.68   | 49  | 16.39  | 31      | 10.37  | 92  | 30.78  | 57      | 19.07  |
| Unit Power Input kW (BTU/H)                              | 9.46  | 32287  | 5.84    | 19932  | 9.46  | 32287  | 5.84    | 19932  | 10  | 34130  | 6.15    | 20990  |
| Heat rejection kW (BTU/H)                                | 45.5  | 155292 | 27.3    | 93175  | 45.5  | 155292 | 27.3    | 93175  | 45.2  | 154268 | 27.1    | 92492  |
| Supply Air Temperature °C (°F)                           | 9.5   | 49.1   | 12.1    | 53.8   | 9.5   | 49.1   | 12.1    | 53.8   | 9.8   | 49.6   | 12.3    | 54.1   |
| <b>80°F DB, 66.5°F WB (26.7°C DB, 19.2°C WB) 50% RH</b>  |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 38.9  | 132766 | 23      | 78499  | 38.9  | 132766 | 23      | 78499  | 37.9  | 129353 | 22.5    | 76793  |
| Sensible kW (BTU/H)                                      | 27.5  | 93858  | 17.4    | 59386  | 27.5  | 93858  | 17.4    | 59386  | 27.1  | 92492  | 17.2    | 58704  |
| Flow Rate, l/s (GPM)                                     | 0.614   | 9.73   | 0.365   | 5.79   | 0.958   | 15.18  | 0.566   | 8.97   | 1.336   | 21.18  | 0.787   | 12.47  |
| Pressure Drop, kPa (ft H2O)                              | 24  | 8.03   | 16      | 5.35   | 56  | 18.73  | 35      | 11.71  | 105   | 35.13  | 64      | 21.41  |
| Unit Power Input kW (BTU/H)                              | 9.45  | 32253  | 5.89    | 20103  | 9.45  | 32253  | 5.89    | 20103  | 9.99  | 34096  | 6.19    | 21126  |
| Heat rejection kW (BTU/H)                                | 48.3  | 164848 | 28.8    | 98294  | 48.3  | 164848 | 28.8    | 98294  | 47.8  | 163141 | 28.6    | 97612  |
| Supply Air Temperature °C (°F)                           | 11.7  | 53.1   | 14.2    | 57.6   | 11.7  | 53.1   | 14.2    | 57.6   | 11.9  | 53.4   | 14.3    | 57.7   |
| <b>75°F DB, 62.5°F WB (23.9°C DB, 16.9°C WB) 50% RH</b>  |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 36.1  | 123209 | 21.6    | 73721  | 36.1  | 123209 | 21.6    | 73721  | 35.3  | 120479 | 21      | 71673  |
| Sensible kW (BTU/H)                                      | 27.1  | 92492  | 17      | 58021  | 27.1  | 92492  | 17      | 58021  | 26.7  | 91127  | 16.7    | 56997  |
| Flow Rate, l/s (GPM)                                     | 0.575   | 9.11   | 0.345   | 5.47   | 0.895   | 14.19  | 0.534   | 8.46   | 1.247   | 19.77  | 0.737   | 11.68  |
| Pressure Drop, kPa (ft H2O)                              | 22  | 7.36   | 14      | 4.68   | 49  | 16.39  | 31      | 10.37  | 93  | 31.11  | 57      | 19.07  |
| Unit Power Input kW (BTU/H)                              | 9.46  | 32287  | 5.85    | 19966  | 9.46  | 32287  | 5.85    | 19966  | 10  | 34130  | 6.15    | 20990  |
| Heat rejection kW (BTU/H)                                | 45.5  | 155292 | 27.3    | 93175  | 45.5  | 155292 | 27.3    | 93175  | 45.3  | 154609 | 27.1    | 92492  |
| Supply Air Temperature °C (°F)                           | 9.4   | 48.9   | 11.8    | 53.2   | 9.4   | 48.9   | 11.8    | 53.2   | 9.6   | 49.3   | 12      | 53.6   |
| <b>75°F DB, 61°F WB (23.9°C DB, 16.1°C WB) 45% RH</b>    |   |        |         |        |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 35.1  | 119796 | 20.9    | 71332  | 35.1  | 119796 | 20.9    | 71332  | 34.3  | 117066 | 20.5    | 69967  |

# Specifications - Water cooled

|   |       |        |       |       |       |        |       |       |       |        |       |       |
|---|-------|--------|-------|-------|-------|--------|-------|-------|-------|--------|-------|-------|
| Sensible kW (BTU/H)                                     | 28.4  | 96929  | 18    | 61434 | 28.4  | 96929  | 18    | 61434 | 28    | 95564  | 17.8  | 60751 |
| Flow Rate, l/s (GPM)                                    | 0.561 | 8.89   | 0.336 | 5.33  | 0.871 | 13.81  | 0.519 | 8.23  | 1.214 | 19.24  | 0.719 | 11.40 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 20    | 6.69   | 14    | 4.68  | 47    | 15.72  | 30    | 10.04 | 88    | 29.44  | 55    | 18.40 |
| Unit Power Input kW (BTU/H)                             | 9.46  | 32287  | 5.83  | 19898 | 9.46  | 32287  | 5.83  | 19898 | 10.01 | 34164  | 6.13  | 20922 |
| Heat rejection kW (BTU/H)                               | 44.5  | 151879 | 26.7  | 91127 | 44.5  | 151879 | 26.7  | 91127 | 44.2  | 150855 | 26.5  | 90445 |
| Supply Air Temperature °C (°F)                          | 8.7   | 47.7   | 11.1  | 52.0  | 8.7   | 47.7   | 11.1  | 52.0  | 8.9   | 48.0   | 11.3  | 52.3  |
| <b>72°F DB, 60.1°F WB (22.2°C DB, 15.6°C WB) 50% RH</b> |       |        |       |       |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)  | 34.4  | 117407 | 20.5  | 69967 | 34.4  | 117407 | 20.5  | 69967 | 33.6  | 114677 | 20    | 68260 |
| Sensible kW (BTU/H)                                     | 26.5  | 90445  | 16.7  | 56997 | 26.5  | 90445  | 16.7  | 56997 | 26.1  | 89079  | 16.5  | 56315 |
| Flow Rate, l/s (GPM)                                    | 0.552 | 8.75   | 0.33  | 5.23  | 0.855 | 13.55  | 0.509 | 8.07  | 1.19  | 18.86  | 0.704 | 11.16 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 20    | 6.69   | 14    | 4.68  | 46    | 15.39  | 29    | 9.70  | 84    | 28.10  | 52    | 17.40 |
| Unit Power Input kW (BTU/H)                             | 9.47  | 32321  | 5.81  | 19830 | 9.47  | 32321  | 5.81  | 19830 | 10.01 | 34164  | 6.11  | 20853 |
| Heat rejection kW (BTU/H)                               | 43.8  | 149489 | 26.2  | 89421 | 43.8  | 149489 | 26.2  | 89421 | 43.5  | 148466 | 26.1  | 89079 |
| Supply Air Temperature °C (°F)                          | 8.1   | 46.6   | 10.4  | 50.7  | 8.1   | 46.6   | 10.4  | 50.7  | 8.3   | 46.9   | 10.6  | 51.1  |
| <b>72°F DB, 58.7°F WB (22.2°C DB, 14.8°C WB) 45% RH</b> |       |        |       |       |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)  | 33.4  | 113994 | 20    | 68260 | 33.4  | 113994 | 20    | 68260 | 32.7  | 111605 | 19.5  | 66554 |
| Sensible kW (BTU/H)                                     | 27.7  | 94540  | 17.6  | 60069 | 27.7  | 94540  | 17.6  | 60069 | 27.3  | 93175  | 17.4  | 59386 |
| Flow Rate, l/s (GPM)                                    | 0.539 | 8.54   | 0.322 | 5.10  | 0.835 | 13.24  | 0.496 | 7.86  | 0.116 | 1.84   | 0.686 | 10.87 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 19    | 6.36   | 12    | 4.01  | 44    | 14.72  | 28    | 9.37  | 81    | 27.10  | 50    | 16.73 |
| Unit Power Input kW (BTU/H)                             | 9.47  | 32321  | 5.79  | 19761 | 9.47  | 32321  | 5.79  | 19761 | 10.01 | 34164  | 6.09  | 20785 |
| Heat rejection kW (BTU/H)                               | 42.8  | 146076 | 25.7  | 87714 | 42.8  | 146076 | 25.7  | 87714 | 42.6  | 145394 | 25.5  | 87032 |
| Supply Air Temperature °C (°F)                          | 7.5   | 45.5   | 9.8   | 49.6  | 7.5   | 45.5   | 9.8   | 49.6  | 7.6   | 45.7   | 9.9   | 49.8  |

Record the power consumption of the fan at various operating percentages (min - 100%).

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be ±5%.

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - Glycol cooled

## 6.3 Performances - glycol cooled

Tab. 6e - Glycol cooled - 50Hz

| 50 Hz                          | 30°C (86°F) EWT - 45°C (113°F) Cond. Temp. |        |         |        | 40°C (104°F) EWT - 55°C (131°F) Cond. Temp. |        |         |       |
|--------------------------------|--|--------|---------|--------|---|--------|---------|-------|
|                                | CR035RW                                    |        | CR020RW |        | CR035RW                                     |        | CR020RW |       |
| <b>40°C DB (104°F) 20% RH</b>  |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 38.7                                       | 132083 | 24.3    | 82936  | 35.9  | 122527 | 21.8    | 74403 |
| Sensible kW (BTU/H)            | 38.7                                       | 132083 | 24.3    | 82936  | 35.9  | 122527 | 21.8    | 74403 |
| Unit Power Input kW (BTU/H)    | 9.59                                       | 32731  | 6.12    | 20888  | 11.72                                       | 40000  | 7.23    | 24676 |
| Heat rejection kW (BTU/H)      | 48.3                                       | 164848 | 30.4    | 103755 | 47.6  | 162459 | 29.2    | 99660 |
| Flow Rate, l/s (GPM)           | 1.418                                      | 22.48  | 0.893   | 14.15  | 1.289                                       | 20.43  | 0.787   | 12.47 |
| Pressure Drop, kPa (ft H2O)    | 136  | 45.50  | 98      | 32.79  | 111   | 37.14  | 76      | 25.43 |
| Supply Air Temperature °C (°F) | 18.1                                       | 64.6   | 21.8    | 71.2   | 19.7  | 67.5   | 21.9    | 71.4  |
| <b>37°C DB (98,6°F) 24% RH</b> |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 36.8                                       | 125598 | 23.1    | 78840  | 34  | 116042 | 21.4    | 73038 |
| Sensible kW (BTU/H)            | 36.8                                       | 125598 | 23.1    | 78840  | 34  | 116042 | 21.4    | 73038 |
| Unit Power Input kW (BTU/H)    | 9.59                                       | 32731  | 6.1     | 20819  | 11.75                                       | 40103  | 7.4     | 25256 |
| Heat rejection kW (BTU/H)      | 46.4                                       | 158363 | 29.2    | 99660  | 45.8  | 156315 | 28.8    | 98294 |
| Flow Rate, l/s (GPM)           | 1.35                                       | 21.40  | 0.849   | 13.46  | 1.229                                       | 19.48  | 0.774   | 12.27 |
| Pressure Drop, kPa (ft H2O)    | 123  | 41.15  | 89      | 29.78  | 101   | 33.79  | 73      | 24.42 |
| Supply Air Temperature °C (°F) | 16.4                                       | 61.5   | 19.8    | 67.6   | 18  | 64.4   | 21.1    | 70.0  |
| <b>35°C DB (95°F) 26% RH</b>   |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 36.9                                       | 125940 | 22.3    | 76110  | 32.8  | 111946 | 20.6    | 70308 |
| Sensible kW (BTU/H)            | 36.3                                       | 123892 | 22.3    | 76110  | 32.8  | 111946 | 20.6    | 70308 |
| Unit Power Input kW (BTU/H)    | 9.58                                       | 32697  | 6.08    | 20751  | 11.76                                       | 40137  | 7.38    | 25188 |
| Heat rejection kW (BTU/H)      | 45.4                                       | 154950 | 28.4    | 96929  | 44.5  | 151879 | 28      | 95564 |
| Flow Rate, l/s (GPM)           | 1.315                                      | 20.84  | 0.821   | 13.01  | 1.191                                       | 18.88  | 0.749   | 11.87 |
| Pressure Drop, kPa (ft H2O)    | 117  | 39.14  | 84      | 28.10  | 95  | 31.78  | 69      | 23.08 |
| Supply Air Temperature °C (°F) | 15.4                                       | 59.7   | 18.5    | 65.3   | 16.8  | 62.2   | 19.8    | 67.6  |
| <b>32°C DB (89,6°F) 29% RH</b> |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 34.3                                       | 117066 | 21.1    | 72014  | 31  | 105803 | 19.5    | 66554 |
| Sensible kW (BTU/H)            | 34.1                                       | 116383 | 21.1    | 72014  | 31  | 105803 | 19.5    | 66554 |
| Unit Power Input kW (BTU/H)    | 9.58                                       | 32697  | 6.06    | 20683  | 11.78                                       | 40205  | 7.36    | 25120 |
| Heat rejection kW (BTU/H)      | 43.8                                       | 149489 | 27.2    | 92834  | 42.7  | 145735 | 26.8    | 91468 |
| Flow Rate, l/s (GPM)           | 1.26                                       | 19.97  | 0.779   | 12.35  | 1.134                                       | 17.97  | 0.712   | 11.29 |
| Pressure Drop, kPa (ft H2O)    | 108  | 36.13  | 76      | 25.43  | 87  | 29.11  | 63      | 21.08 |
| Supply Air Temperature °C (°F) | 13.2                                       | 55.8   | 16.6    | 61.9   | 14.9  | 58.8   | 17.8    | 64.0  |
| <b>30°C DB (86°F) 34% RH</b>   |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 33.8                                       | 115359 | 20.9    | 71332  | 30.4  | 103755 | 18.7    | 63823 |
| Sensible kW (BTU/H)            | 31.5                                       | 107510 | 20.9    | 71332  | 30.4  | 103755 | 18.7    | 63823 |
| Unit Power Input kW (BTU/H)    | 9.58                                       | 32697  | 6.05    | 20649  | 11.78                                       | 40205  | 7.34    | 25051 |
| Heat rejection kW (BTU/H)      | 43.3                                       | 147783 | 27      | 92151  | 42.2  | 144029 | 26.1    | 89079 |
| Flow Rate, l/s (GPM)           | 1.242                                      | 19.69  | 0.771   | 12.22  | 1.116                                       | 17.69  | 0.688   | 10.91 |
| Pressure Drop, kPa (ft H2O)    | 105  | 35.13  | 74      | 24.76  | 84  | 28.10  | 59      | 19.74 |
| Supply Air Temperature °C (°F) | 12.8                                       | 55.0   | 14.6    | 58.3   | 13.5  | 56.3   | 16.4    | 61.5  |
| <b>28°C DB (82,4) 38% RH</b>   |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 33.4                                       | 113994 | 20.4    | 69625  | 29.7  | 101366 | 18.5    | 63141 |
| Sensible kW (BTU/H)            | 29.5                                       | 100684 | 19.5    | 66554  | 27.9  | 95223  | 18.5    | 63141 |
| Unit Power Input kW (BTU/H)    | 9.58                                       | 32697  | 6.04    | 20615  | 11.79                                       | 40239  | 7.33    | 25017 |
| Heat rejection kW (BTU/H)      | 43   | 146759 | 26.5    | 90445  | 41.5  | 141640 | 25.8    | 88055 |
| Flow Rate, l/s (GPM)           | 1.23                                       | 19.50  | 0.755   | 11.97  | 1.095                                       | 17.36  | 0.681   | 10.79 |
| Pressure Drop, kPa (ft H2O)    | 103  | 34.46  | 71      | 23.75  | 82  | 27.43  | 58      | 19.40 |
| Supply Air Temperature °C (°F) | 12   | 53.6   | 13.9    | 57.0   | 12.8  | 55.0   | 14.5    | 58.1  |
| <b>28°C DB (82,4) 45% RH</b>   |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 34.6                                       | 118090 | 21.4    | 73038  | 31.2  | 106486 | 19.4    | 66212 |
| Sensible kW (BTU/H)            | 27.2                                       | 92834  | 18      | 61434  | 25.8  | 88055  | 17.2    | 58704 |
| Unit Power Input kW (BTU/H)    | 9.58                                       | 32697  | 6.06    | 206828 | 11.78                                       | 40205  | 7.35    | 25086 |
| Heat rejection kW (BTU/H)      | 44.2                                       | 150855 | 27.5    | 93858  | 43  | 146759 | 26.8    | 91468 |
| Flow Rate, l/s (GPM)           | 1.272                                      | 20.16  | 0.79    | 12.52  | 1.141                                       | 18.09  | 0.71    | 11.25 |
| Pressure Drop, kPa (ft H2O)    | 110  | 36.80  | 77      | 25.76  | 88  | 29.44  | 63      | 21.08 |
| Supply Air Temperature °C (°F) | 13.2                                       | 55.8   | 15      | 59.0   | 13.9  | 57.0   | 15.6    | 60.1  |
| <b>25°C DB (77°F) 45% RH</b>   |  |        |         |        |   |        |         |       |
| Total kW (BTU/H)               | 32.3                                       | 110240 | 19.9    | 67919  | 28.8  | 98294  | 17.9    | 61093 |
| Sensible kW (BTU/H)            | 26.7                                       | 91127  | 17.5    | 59728  | 25  | 85325  | 16.7    | 56997 |

# Specifications - Glycol cooled

|  |       |        |       |       |       |        |       |       |
|--|-------|--------|-------|-------|-------|--------|-------|-------|
| Unit Power Input kW (BTU/H)              | 9.58  | 32697  | 6.03  | 20580 | 11.8  | 40273  | 7.31  | 24949 |
| Heat rejection kW (BTU/H)                | 41.9  | 143005 | 25.9  | 88397 | 40.6  | 138568 | 25.2  | 86008 |
| Flow Rate, l/s (GPM)                     | 1.192 | 18.89  | 0.734 | 11.63 | 1.065 | 16.88  | 0.66  | 10.46 |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 97    | 32.45  | 68    | 22.75 | 77    | 25.76  | 55    | 18.40 |
| Supply Air Temperature °C (°F)           | 10.7  | 51.3   | 12.5  | 54.5  | 11.6  | 52.9   | 13.1  | 55.6  |
| <b>25°C DB (77°F) 40% RH</b>             |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)                         | 31.3  | 106827 | 19.4  | 66212 | 28.1  | 95905  | 17.4  | 59386 |
| Sensible kW (BTU/H)                      | 28.1  | 95905  | 18.6  | 63482 | 26.5  | 90445  | 17.4  | 59386 |
| Unit Power Input kW (BTU/H)              | 9.58  | 32697  | 6.02  | 20546 | 11.8  | 40273  | 7.3   | 24915 |
| Heat rejection kW (BTU/H)                | 40.9  | 139592 | 25.4  | 86690 | 39.9  | 136179 | 24.7  | 84301 |
| Flow Rate, l/s (GPM)                     | 1.157 | 18.34  | 0.719 | 11.40 | 1.043 | 16.53  | 0.645 | 10.22 |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 92    | 30.78  | 66    | 22.08 | 74    | 24.76  | 52    | 17.40 |
| Supply Air Temperature °C (°F)           | 9.9   | 49.8   | 11.7  | 53.1  | 10.7  | 51.3   | 12.4  | 54.3  |
| <b>22°C DB (71,6°F) 55% RH</b>           |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)                         | 31.3  | 106827 | 19.4  | 66212 | 28.1  | 95905  | 17.4  | 59386 |
| Sensible kW (BTU/H)                      | 23.2  | 79182  | 15    | 51195 | 21.6  | 73721  | 14.1  | 48123 |
| Unit Power Input kW (BTU/H)              | 9.58  | 32697  | 6.02  | 20546 | 11.8  | 40273  | 7.3   | 24915 |
| Heat rejection kW (BTU/H)                | 40.9  | 139592 | 25.4  | 86690 | 39.9  | 136179 | 24.7  | 84301 |
| Flow Rate, l/s (GPM)                     | 1.158 | 18.35  | 0.719 | 11.40 | 1.044 | 16.55  | 0.646 | 10.24 |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 92    | 30.78  | 66    | 22.08 | 74    | 24.76  | 52    | 17.40 |
| Supply Air Temperature °C (°F)           | 9.7   | 49.5   | 11.4  | 52.5  | 10.5  | 50.9   | 12.1  | 53.8  |
| <b>22°C DB (71,6°F) 50% RH</b>           |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)                         | 30.5  | 104097 | 18.9  | 64506 | 27.3  | 93175  | 17.1  | 58362 |
| Sensible kW (BTU/H)                      | 24.4  | 83277  | 15.9  | 54267 | 22.9  | 78158  | 15    | 51195 |
| Unit Power Input kW (BTU/H)              | 9.57  | 32662  | 6.01  | 20512 | 11.8  | 40273  | 7.29  | 24881 |
| Heat rejection kW (BTU/H)                | 40.1  | 136861 | 24.9  | 84984 | 39.1  | 133448 | 24.4  | 83277 |
| Flow Rate, l/s (GPM)                     | 1.129 | 17.90  | 0.701 | 11.11 | 1.021 | 16.18  | 0.635 | 10.06 |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 87    | 29.11  | 63    | 21.08 | 71    | 23.75  | 51    | 17.06 |
| Supply Air Temperature °C (°F)           | 9.1   | 48.4   | 10.8  | 51.4  | 9.9   | 49.8   | 11.4  | 52.5  |

Record the power consumption of the fan at various operating percentages (min - 100%).

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be ±5%.

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - Glycol cooled

Tab. 6f - Glycol cooled - 60Hz

| 60 Hz  | GLYCOL (30% Propylene)                          |        |         |        | GLYCOL (40% Propylene)                          |        |         |        |
|--|---|--------|---------|--------|---|--------|---------|--------|
|  | 110°F (43.3°C) EWT - 135°F (57.2°C) Cond. Temp. |        |         |        | 110°F (43.3°C) EWT - 135°F (57.2°C) Cond. Temp. |        |         |        |
|  | CR035RW   |        | CR020RW |        | CR035RW   |        | CR020RW |        |
| <b>105°F DB, 71°F WB (40.6°C DB, 21.6°C WB) 17% RH</b>   |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 38.1  | 130035 | 22.2    | 75769  | 38.1  | 130035 | 22.2    | 75769  |
| Sensible kW (BTU/H)                                      | 38.1  | 130035 | 22.2    | 75769  | 38.1  | 130035 | 22.2    | 75769  |
| Flow Rate, l/s (GPM)                                     | 1.552   | 24.60  | 0.907   | 14.38  | 1.681   | 26.64  | 0.983   | 15.58  |
| Pressure Drop, kPa (ft H2O)                              | 148   | 49.51  | 91      | 30.44  | 177   | 59.22  | 110     | 36.80  |
| Unit Power Input kW (BTU/H)                              | 13.05   | 44540  | 7.89    | 26929  | 13.05   | 44540  | 7.89    | 26929  |
| Heat rejection kW (BTU/H)                                | 51  | 174063 | 30.2    | 103073 | 51  | 174063 | 30.2    | 103073 |
| Supply Air Temperature °C (°F)                           | 19  | 66.2   | 22      | 71.6   | 19  | 66.2   | 22      | 71.6   |
| <b>100°F DB, 69.5°F WB (37.8°C DB, 20.8°C WB) 20% RH</b> |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 36.2  | 123551 | 21.9    | 74745  | 36.2  | 123551 | 21.9    | 74745  |
| Sensible kW (BTU/H)                                      | 36.2  | 123551 | 21.9    | 74745  | 36.2  | 123551 | 21.9    | 74745  |
| Flow Rate, l/s (GPM)                                     | 1.487   | 23.57  | 0.896   | 14.20  | 1.609   | 25.50  | 0.971   | 15.39  |
| Pressure Drop, kPa (ft H2O)                              | 136   | 45.50  | 88      | 29.44  | 163   | 54.53  | 107     | 35.80  |
| Unit Power Input kW (BTU/H)                              | 13.08   | 44642  | 8.08    | 27577  | 13.08   | 44642  | 8.08    | 27577  |
| Heat rejection kW (BTU/H)                                | 49.2  | 167920 | 29.9    | 102049 | 49.2  | 167920 | 29.9    | 102049 |
| Supply Air Temperature °C (°F)                           | 17.4  | 63.3   | 21.4    | 70.5   | 17.4  | 63.3   | 21.4    | 70.5   |
| <b>95°F DB, 67.9°F WB (35°C DB, 19.9°C WB) 23% RH</b>    |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 34.5  | 117749 | 20.8    | 70990  | 34.5  | 117749 | 20.8    | 70990  |
| Sensible kW (BTU/H)                                      | 34.5  | 117749 | 20.8    | 70990  | 34.5  | 117749 | 20.8    | 70990  |
| Flow Rate, l/s (GPM)                                     | 1.422   | 22.54  | 0.855   | 13.55  | 1.539   | 24.39  | 0.926   | 14.68  |
| Pressure Drop, kPa (ft H2O)                              | 125   | 41.82  | 81      | 27.10  | 150   | 50.18  | 98      | 32.79  |
| Unit Power Input kW (BTU/H)                              | 13.09   | 44676  | 8.04    | 27441  | 13.09   | 44676  | 8.04    | 27441  |
| Heat rejection kW (BTU/H)                                | 47.5  | 162118 | 28.8    | 98294  | 47.5  | 162118 | 28.8    | 98294  |
| Supply Air Temperature °C (°F)                           | 15.8  | 60.4   | 19.6    | 67.3   | 15.8  | 60.4   | 19.6    | 67.3   |
| <b>90°F DB, 66.2°F WB (32.2°C DB, 19.0°C WB) 27% RH</b>  |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 32.7  | 111605 | 19.7    | 67236  | 32.7  | 111605 | 19.7    | 67236  |
| Sensible kW (BTU/H)                                      | 32.7  | 111605 | 19.7    | 67236  | 32.7  | 111605 | 19.7    | 67236  |
| Flow Rate, l/s (GPM)                                     | 1.359   | 21.54  | 0.815   | 12.92  | 1.47  | 23.30  | 0.882   | 13.98  |
| Pressure Drop, kPa (ft H2O)                              | 114   | 38.14  | 75      | 25.09  | 137   | 45.83  | 90      | 30.11  |
| Unit Power Input kW (BTU/H)                              | 13.11   | 44744  | 7.99    | 27270  | 13.11   | 44744  | 7.99    | 27270  |
| Heat rejection kW (BTU/H)                                | 45.7  | 155974 | 27.6    | 94199  | 45.7  | 155974 | 27.6    | 94199  |
| Supply Air Temperature °C (°F)                           | 14.1  | 57.4   | 17.7    | 63.9   | 14.1  | 57.4   | 17.7    | 63.9   |
| <b>85°F DB, 64.5°F WB (29.4°C DB, 18.1°C WB) 31% RH</b>  |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 32.1  | 109557 | 18.7    | 63823  | 32.1  | 109557 | 18.7    | 63823  |
| Sensible kW (BTU/H)                                      | 32.1  | 109557 | 18.7    | 63823  | 32.1  | 109557 | 18.7    | 63823  |
| Flow Rate, l/s (GPM)                                     | 1.3   | 20.61  | 0.777   | 12.32  | 1.406   | 22.29  | 0.84    | 13.31  |
| Pressure Drop, kPa (ft H2O)                              | 105   | 35.13  | 68      | 22.75  | 126   | 42.15  | 82      | 27.43  |
| Unit Power Input kW (BTU/H)                              | 13.11   | 44744  | 7.94    | 27099  | 13.11   | 44744  | 7.94    | 27099  |
| Heat rejection kW (BTU/H)                                | 44.1  | 150513 | 26.6    | 90786  | 44.1  | 150513 | 26.6    | 90786  |
| Supply Air Temperature °C (°F)                           | 12.5  | 54.5   | 15.8    | 60.4   | 12.5  | 54.5   | 15.8    | 60.4   |
| <b>80°F DB, 62.8°F WB (26.7°C DB, 17.1°C WB) 37% RH</b>  |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 30.6  | 104438 | 18.5    | 63141  | 30.6  | 104438 | 18.5    | 63141  |
| Sensible kW (BTU/H)                                      | 29  | 98977  | 18      | 61434  | 29  | 98977  | 18      | 61434  |
| Flow Rate, l/s (GPM)                                     | 1.283   | 20.34  | 0.749   | 11.87  | 1.387   | 21.98  | 0.809   | 12.82  |
| Pressure Drop, kPa (ft H2O)                              | 103   | 34.46  | 63      | 21.08  | 122   | 40.82  | 77      | 25.76  |
| Unit Power Input kW (BTU/H)                              | 13.11   | 44744  | 7.9     | 26963  | 13.11   | 44744  | 7.9     | 26963  |
| Heat rejection kW (BTU/H)                                | 43.6  | 148807 | 25.8    | 88055  | 43.6  | 148807 | 25.8    | 88055  |
| Supply Air Temperature °C (°F)                           | 11  | 51.8   | 14.2    | 57.6   | 11  | 51.8   | 14.2    | 57.6   |
| <b>80°F DB, 66.5°F WB (26.7°C DB, 19.2°C WB) 50% RH</b>  |   |        |         |        |   |        |         |        |
| Total kW (BTU/H)   | 32.7  | 111605 | 19.5    | 66554  | 32.7  | 111605 | 19.5    | 66554  |
| Sensible kW (BTU/H)                                      | 25  | 85325  | 16      | 54608  | 25  | 85325  | 16      | 54608  |
| Flow Rate, l/s (GPM)                                     | 1.36  | 21.56  | 0.808   | 12.81  | 1.471   | 23.32  | 0.874   | 13.85  |
| Pressure Drop, kPa (ft H2O)                              | 115   | 38.47  | 73      | 24.42  | 137   | 45.83  | 88      | 29.44  |
| Unit Power Input kW (BTU/H)                              | 13.11   | 44744  | 7.98    | 27236  | 13.11   | 44744  | 7.98    | 27236  |
| Heat rejection kW (BTU/H)                                | 45.8  | 156315 | 27.4    | 93516  | 45.8  | 156315 | 27.4    | 93516  |
| Supply Air Temperature °C (°F)                           | 13.1  | 55.6   | 15.2    | 59.4   | 13.1  | 55.6   | 15.2    | 59.4   |
| <b>75°F DB, 62.5°F WB (23.9°C DB, 16.9°C WB) 50% RH</b>  |   |        |         |        |   |        |         |        |

# Specifications - Glycol cooled

|   |       |        |       |       |       |        |       |       |
|---|-------|--------|-------|-------|-------|--------|-------|-------|
| Total kW (BTU/H)  | 30.6  | 104438 | 18.1  | 61775 | 30.6  | 104438 | 18.1  | 61775 |
| Sensible kW (BTU/H)                                     | 24.4  | 83277  | 15.6  | 53243 | 24.4  | 83277  | 15.6  | 53243 |
| Flow Rate, l/s (GPM)                                    | 1.283 | 20.34  | 0.756 | 11.98 | 1.387 | 21.98  | 0.816 | 12.93 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 103   | 34.46  | 65    | 21.75 | 122   | 40.82  | 78    | 26.10 |
| Unit Power Input kW (BTU/H)                             | 13.11 | 44744  | 7.91  | 26997 | 13.11 | 44744  | 7.91  | 26997 |
| Heat rejection kW (BTU/H)                               | 43.6  | 148807 | 25.9  | 88397 | 43.6  | 148807 | 25.9  | 88397 |
| Supply Air Temperature °C (°F)                          | 10.8  | 51.4   | 12.9  | 55.2  | 10.8  | 51.4   | 12.9  | 55.2  |
| <b>75°F DB, 61°F WB (23.9°C DB, 16.1°C WB) 45% RH</b>   |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)  | 29.7  | 101366 | 17.6  | 60069 | 29.7  | 101366 | 17.6  | 60069 |
| Sensible kW (BTU/H)                                     | 25.8  | 88055  | 16.4  | 55973 | 25.8  | 88055  | 16.4  | 55973 |
| Flow Rate, l/s (GPM)                                    | 1.253 | 19.86  | 0.736 | 11.67 | 1.353 | 21.45  | 0.795 | 12.60 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 98    | 32.79  | 62    | 20.74 | 117   | 39.14  | 74    | 24.76 |
| Unit Power Input kW (BTU/H)                             | 13.11 | 44744  | 7.88  | 26894 | 13.11 | 44744  | 7.88  | 26894 |
| Heat rejection kW (BTU/H)                               | 42.7  | 145735 | 25.4  | 86690 | 42.7  | 145735 | 25.4  | 86690 |
| Supply Air Temperature °C (°F)                          | 10.1  | 50.2   | 12.2  | 54.0  | 10.1  | 50.2   | 12.2  | 54.0  |
| <b>72°F DB, 60.1°F WB (22.2°C DB, 15.6°C WB) 50% RH</b> |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)  | 29.1  | 99318  | 17.4  | 59386 | 29.1  | 99318  | 17.4  | 59386 |
| Sensible kW (BTU/H)                                     | 24    | 81912  | 15.2  | 51878 | 24    | 81912  | 15.2  | 51878 |
| Flow Rate, l/s (GPM)                                    | 1.232 | 19.53  | 0.728 | 11.54 | 1.33  | 21.08  | 0.786 | 12.46 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 95    | 31.78  | 60    | 20.07 | 113   | 37.80  | 72    | 24.09 |
| Unit Power Input kW (BTU/H)                             | 13.11 | 44744  | 7.86  | 26826 | 13.11 | 44744  | 7.86  | 26826 |
| Heat rejection kW (BTU/H)                               | 42.1  | 143687 | 25.2  | 86008 | 42.1  | 143687 | 25.2  | 86008 |
| Supply Air Temperature °C (°F)                          | 9.4   | 48.9   | 11.5  | 52.7  | 9.4   | 48.9   | 11.5  | 52.7  |
| <b>72°F DB, 58.7°F WB (22.2°C DB, 14.8°C WB) 45% RH</b> |       |        |       |       |       |        |       |       |
| Total kW (BTU/H)  | 28.3  | 96588  | 16.9  | 57680 | 28.3  | 96588  | 16.9  | 57680 |
| Sensible kW (BTU/H)                                     | 25.2  | 86008  | 16.1  | 54949 | 25.2  | 86008  | 16.1  | 54949 |
| Flow Rate, l/s (GPM)                                    | 1.202 | 19.05  | 0.711 | 11.27 | 1.298 | 20.57  | 0.767 | 12.16 |
| Pressure Drop, kPa (ft H <sub>2</sub> O)                | 90    | 30.11  | 58    | 19.40 | 108   | 36.13  | 69    | 23.08 |
| Unit Power Input kW (BTU/H)                             | 13.11 | 44744  | 7.84  | 26758 | 13.11 | 44744  | 7.84  | 26758 |
| Heat rejection kW (BTU/H)                               | 41.3  | 140957 | 24.7  | 84301 | 41.3  | 140957 | 24.7  | 84301 |
| Supply Air Temperature °C (°F)                          | 8.8   | 47.8   | 10.8  | 51.4  | 8.8   | 47.8   | 10.8  | 51.4  |

Record the power consumption of the fan at various operating percentages (min - 100%).

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be ±5%.

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - CW

## 6.4 Performances - CW units

Tab. 6g - CW - 60 Hz

| CW - 60Hz  | CR040RC                                   |        |   |        |   |        |   |        |
|--|---|--------|---|--------|---|--------|---|--------|
|  | 45°F (7.2°C) EWT, 10°F (5.6°C) Water Rise |        | 45°F (7.2°C) EWT, 14°F (7.7°C) Water Rise |        | 48°F (8.9°C) EWT, 10°F (5.6°C) Water Rise |        | 48°F (8.9°C) EWT, 14°F (7.7°C) Water Rise |        |
| <b>105°F DB, 71°F WB (40.6°C DB, 21.6°C WB) 17% RH</b>   |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 49.6                                      | 169285 | 48  | 163824 | 47  | 160411 | 45.4                                      | 154950 |
| Sensible kW (BTU/H)                                      | 49.6                                      | 169285 | 48  | 163824 | 47  | 160411 | 45.4                                      | 154950 |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 2.11                                      | 33.44  | 1.49                                      | 23.62  | 2   | 31.70  | 1.41                                      | 22.35  |
| Pressure Drop, kPa (ft H2O)                              | 142                                       | 47.51  | 75  | 25.09  | 128                                       | 42.82  | 67  | 22.42  |
| Supply Air Temperature °C (°F)                           | 13.6                                      | 56.5   | 14.5                                      | 58.1   | 15.1                                      | 59.2   | 16  | 60.8   |
| <b>100°F DB, 69.5°F WB (37.8°C DB, 20.8°C WB) 20% RH</b> |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 45.5                                      | 155292 | 43.8                                      | 149489 | 42.8                                      | 146076 | 41.2                                      | 140616 |
| Sensible kW (BTU/H)                                      | 45.5                                      | 155292 | 43.8                                      | 149489 | 42.8                                      | 146076 | 41.2                                      | 140616 |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.94                                      | 30.75  | 1.36                                      | 21.56  | 1.83                                      | 29.01  | 1.28                                      | 20.29  |
| Pressure Drop, kPa (ft H2O)                              | 121                                       | 40.48  | 64  | 21.41  | 108                                       | 36.13  | 56  | 18.73  |
| Supply Air Temperature °C (°F)                           | 13.4                                      | 56.1   | 14.3                                      | 57.7   | 14.8                                      | 58.6   | 15.8                                      | 60.4   |
| <b>95°F DB, 67.9°F WB (35°C DB, 19.9°C WB) 23% RH</b>    |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 41.3                                      | 140957 | 39.5                                      | 134814 | 38.6                                      | 131742 | 36.8                                      | 125598 |
| Sensible kW (BTU/H)                                      | 41.3                                      | 140957 | 39.5                                      | 134814 | 38.6                                      | 131742 | 36.8                                      | 125598 |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.76                                      | 27.90  | 1.23                                      | 19.50  | 1.64                                      | 25.99  | 1.14                                      | 18.07  |
| Pressure Drop, kPa (ft H2O)                              | 102                                       | 34.12  | 53  | 17.73  | 90  | 30.11  | 46  | 15.39  |
| Supply Air Temperature °C (°F)                           | 13.1                                      | 55.6   | 14.1                                      | 57.4   | 14.6                                      | 58.3   | 15.6                                      | 60.1   |
| <b>90°F DB, 66.2°F WB (32.2°C DB, 19.0°C WB) 27% RH</b>  |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 37  | 126281 | 35.1                                      | 119796 | 34.3                                      | 117066 | 32.4                                      | 110581 |
| Sensible kW (BTU/H)                                      | 37  | 126281 | 35.1                                      | 119796 | 34.3                                      | 117066 | 32.4                                      | 110581 |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.58                                      | 25.04  | 1.09                                      | 17.28  | 1.46                                      | 23.14  | 1.01                                      | 16.01  |
| Pressure Drop, kPa (ft H2O)                              | 84  | 28.10  | 43  | 14.39  | 72  | 24.09  | 37  | 12.38  |
| Supply Air Temperature °C (°F)                           | 12.9                                      | 55.2   | 13.9                                      | 57.0   | 14.3                                      | 57.7   | 15.3                                      | 59.5   |
| <b>85°F DB, 64.5°F WB (29.4°C DB, 18.1°C WB) 31% RH</b>  |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 32.6                                      | 111264 | 30.6                                      | 104438 | 29.9                                      | 102049 | 27.9                                      | 95223  |
| Sensible kW (BTU/H)                                      | 32.6                                      | 111264 | 30.6                                      | 104438 | 29.9                                      | 102049 | 27.9                                      | 95223  |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.39                                      | 22.03  | 0.95                                      | 15.06  | 1.28                                      | 20.29  | 0.86                                      | 13.63  |
| Pressure Drop, kPa (ft H2O)                              | 67  | 22.42  | 33  | 11.04  | 57  | 19.07  | 28  | 9.37   |
| Supply Air Temperature °C (°F)                           | 12.6                                      | 54.7   | 13.7                                      | 56.7   | 14.1                                      | 57.4   | 15.1                                      | 59.2   |
| <b>80°F DB, 62.8°F WB (26.7°C DB, 17.1°C WB) 37% RH</b>  |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 28.3                                      | 96588  | 26.2                                      | 89421  | 25.6                                      | 87373  | 23.4                                      | 79864  |
| Sensible kW (BTU/H)                                      | 28.3                                      | 96588  | 26.2                                      | 89421  | 25.6                                      | 87373  | 23.4                                      | 79864  |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.21                                      | 19.18  | 0.81                                      | 12.84  | 1.09                                      | 17.28  | 0.73                                      | 11.57  |
| Pressure Drop, kPa (ft H2O)                              | 52  | 17.40  | 25  | 8.36   | 43  | 14.39  | 20  | 6.69   |
| Supply Air Temperature °C (°F)                           | 12.3                                      | 54.1   | 13.5                                      | 56.3   | 13.8                                      | 56.8   | 15  | 59.0   |
| <b>80°F DB, 66.5°F WB (26.7°C DB, 19.2°C WB) 50% RH</b>  |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 35.6                                      | 121503 | 28.7                                      | 97953  | 29.5                                      | 100684 | 23.4                                      | 79864  |
| Sensible kW (BTU/H)                                      | 26.8                                      | 91468  | 23.6                                      | 80547  | 24.3                                      | 82936  | 21.6                                      | 73721  |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.28                                      | 4369   |
| Flow Rate, l/s (GPM)                                     | 1.52                                      | 24.09  | 0.89                                      | 14.11  | 1.26                                      | 19.97  | 0.73                                      | 11.57  |
| Pressure Drop, kPa (ft H2O)                              | 78  | 26.10  | 30  | 10.04  | 55  | 18.40  | 21  | 7.03   |
| Supply Air Temperature °C (°F)                           | 13  | 55.4   | 14.8                                      | 58.6   | 14.5                                      | 58.1   | 16  | 60.8   |
| <b>75°F DB, 62.5°F WB (23.9°C DB, 16.9°C WB) 50% RH</b>  |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 24.7                                      | 84301  | 21.4                                      | 73038  | 21  | 71673  | 18.4                                      | 62799  |
| Sensible kW (BTU/H)                                      | 22.4                                      | 76451  | 21.4                                      | 73038  | 21  | 71673  | 18.4                                      | 62799  |
| Unit Power Input kW (BTU/H)                              | 1.28                                      | 4369   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.05                                      | 16.64  | 0.66                                      | 10.46  | 0.89                                      | 14.11  | 0.57                                      | 9.03   |
| Pressure Drop, kPa (ft H2O)                              | 40  | 13.38  | 18  | 6.02   | 30  | 10.04  | 13  | 4.35   |
| Supply Air Temperature °C (°F)                           | 12.8                                      | 55.0   | 13.4                                      | 56.1   | 13.6                                      | 56.5   | 15  | 59.0   |
| <b>75°F DB, 61°F WB (23.9°C DB, 16.1°C WB) 45% RH</b>    |   |        |   |        |   |        |   |        |
| Total kW (BTU/H)   | 23.8                                      | 81229  | 21.4                                      | 73038  | 21  | 71673  | 18.4                                      | 62799  |
| Sensible kW (BTU/H)                                      | 23.8                                      | 81229  | 21.4                                      | 73038  | 21  | 71673  | 18.4                                      | 62799  |
| Unit Power Input kW (BTU/H)                              | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   | 1.26                                      | 4300   |
| Flow Rate, l/s (GPM)                                     | 1.01                                      | 16.01  | 0.66                                      | 10.46  | 0.89                                      | 14.11  | 0.57                                      | 9.03   |
| Pressure Drop, kPa (ft H2O)                              | 38  | 12.71  | 18  | 6.02   | 30  | 10.04  | 13  | 4.35   |
| Supply Air Temperature °C (°F)                           | 12.1                                      | 53.8   | 13.4                                      | 56.1   | 13.6                                      | 56.5   | 15  | 59.0   |

## Specifications - CW

### 72°F DB, 60.1°F WB (22.2°C DB, 15.6°C WB) 50% RH

|  |      |       |      |       |      |       |      |       |
|--|------|-------|------|-------|------|-------|------|-------|
| Total kW (BTU/H)                         | 20.9 | 71332 | 18.3 | 62458 | 18.1 | 61775 | 15.1 | 51536 |
| Sensible kW (BTU/H)                      | 20.9 | 71332 | 18.3 | 62458 | 18.1 | 61775 | 15.1 | 51536 |
| Unit Power Input kW (BTU/H)              | 1.26 | 4300  | 1.26 | 4300  | 1.26 | 4300  | 1.26 | 4300  |
| Flow Rate, l/s (GPM)                     | 0.89 | 14.11 | 0.57 | 9.03  | 0.77 | 12.20 | 0.47 | 7.45  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 30   | 10.04 | 13   | 4.35  | 23   | 7.69  | 9    | 3.01  |
| Supply Air Temperature °C (°F)           | 12   | 53.6  | 13.4 | 56.1  | 13.5 | 56.3  | 15.1 | 59.2  |

### 72°F DB, 58.7°F WB (22.2°C DB, 14.8°C WB) 45% RH

|  |      |       |      |       |      |       |      |       |
|--|------|-------|------|-------|------|-------|------|-------|
| Total kW (BTU/H)                         | 20.9 | 71332 | 18.2 | 62117 | 18.1 | 61775 | 15.1 | 51536 |
| Sensible kW (BTU/H)                      | 20.9 | 71332 | 18.2 | 62117 | 18.1 | 61775 | 15.1 | 51536 |
| Unit Power Input kW (BTU/H)              | 1.26 | 4300  | 1.26 | 4300  | 1.26 | 4300  | 1.26 | 4300  |
| Flow Rate, l/s (GPM)                     | 0.89 | 14.11 | 0.57 | 9.03  | 0.77 | 12.20 | 0.47 | 7.45  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 30   | 10.04 | 13   | 4.35  | 23   | 7.69  | 9    | 3.01  |
| Supply Air Temperature °C (°F)           | 12   | 53.6  | 13.4 | 56.1  | 13.5 | 56.3  | 15   | 59.0  |

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be ±5%.

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - CW

Tab. 6h - CW - 50 Hz

| CW - 50Hz                      | CR040RC                                   |        |  |        |  |        |
|--------------------------------|---|--------|--|--------|--|--------|
|                                | 7°C (44.6°F) EWT, 5°C (9°F)<br>Water Rise |        | 10°C (50°F) EWT, 5°C (9°F)<br>Water Rise |        | 13°C (55.4°F) EWT, 5°C (9°F)<br>Water Rise |        |
| <b>40°C DB (104°F) 20% RH</b>  |   |        |  |        |  |        |
| Total kW (BTU/H)               | 51.1                                      | 174404 | 44.9                                     | 153244 | 40.3                                       | 137544 |
| Sensible kW (BTU/H)            | 49.7                                      | 169626 | 44.9                                     | 153244 | 40.3                                       | 137544 |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 2.44                                      | 38.67  | 2.14                                     | 33.92  | 1.93                                       | 30.59  |
| Pressure Drop, kPa (ft H2O)    | 184                                       | 61.56  | 144                                      | 48.18  | 116  | 38.81  |
| Supply Air Temperature °C (°F) | 13.1                                      | 55.6   | 15.7                                     | 60.3   | 18.3                                       | 64.9   |
| <b>37°C DB (98.6°F) 24% RH</b> |   |        |  |        |  |        |
| Total kW (BTU/H)               | 47.9                                      | 163483 | 40.4                                     | 137885 | 35.7                                       | 121844 |
| Sensible kW (BTU/H)            | 45  | 153585 | 40.4                                     | 137885 | 35.7                                       | 121844 |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 2.28                                      | 36.14  | 1.93                                     | 30.59  | 1.71                                       | 27.10  |
| Pressure Drop, kPa (ft H2O)    | 163                                       | 54.53  | 119                                      | 39.81  | 94   | 31.45  |
| Supply Air Temperature °C (°F) | 12.9                                      | 55.2   | 15.5                                     | 59.9   | 18.1                                       | 64.6   |
| <b>35°C DB (95°F) 26% RH</b>   |   |        |  |        |  |        |
| Total kW (BTU/H)               | 43.7                                      | 149148 | 37.4                                     | 127646 | 32.7                                       | 111605 |
| Sensible kW (BTU/H)            | 42  | 143346 | 37.4                                     | 127646 | 32.7                                       | 111605 |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 2.08                                      | 32.97  | 1.79                                     | 28.37  | 1.56                                       | 24.73  |
| Pressure Drop, kPa (ft H2O)    | 139                                       | 46.50  | 103                                      | 34.46  | 80   | 26.76  |
| Supply Air Temperature °C (°F) | 12.8                                      | 55.0   | 15.3                                     | 59.5   | 17.9                                       | 64.2   |
| <b>32°C DB (89.6°F) 29% RH</b> |   |        |  |        |  |        |
| Total kW (BTU/H)               | 37.6                                      | 128329 | 32.7                                     | 111605 | 28   | 95564  |
| Sensible kW (BTU/H)            | 37.2                                      | 126964 | 32.7                                     | 111605 | 28   | 95564  |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 1.79                                      | 28.37  | 1.56                                     | 24.73  | 1.34                                       | 21.24  |
| Pressure Drop, kPa (ft H2O)    | 106                                       | 35.46  | 81                                       | 27.10  | 60   | 20.07  |
| Supply Air Temperature °C (°F) | 12.5                                      | 54.5   | 15                                       | 59.0   | 17.6                                       | 63.7   |
| <b>30°C DB (86°F) 34% RH</b>   |   |        |  |        |  |        |
| Total kW (BTU/H)               | 35.9                                      | 122527 | 29.6                                     | 101025 | 24.8                                       | 84642  |
| Sensible kW (BTU/H)            | 34  | 116042 | 29.6                                     | 101025 | 24.8                                       | 84642  |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 1.71                                      | 27.10  | 1.41                                     | 22.35  | 1.19                                       | 18.86  |
| Pressure Drop, kPa (ft H2O)    | 97  | 32.45  | 68                                       | 22.75  | 49   | 16.39  |
| Supply Air Temperature °C (°F) | 12.4                                      | 54.3   | 14.8                                     | 58.6   | 17.4                                       | 63.3   |
| <b>28°C DB (82.4) 38% RH</b>   |   |        |  |        |  |        |
| Total kW (BTU/H)               | 33  | 112629 | 26.5                                     | 90445  | 21.6                                       | 73721  |
| Sensible kW (BTU/H)            | 30.7                                      | 104779 | 26.5                                     | 90445  | 21.6                                       | 73721  |
| Unit Power Input kW (BTU/H)    | 1.28                                      | 4369   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 1.58                                      | 25.04  | 1.26                                     | 19.97  | 1.03                                       | 16.33  |
| Pressure Drop, kPa (ft H2O)    | 84  | 28.10  | 55                                       | 18.40  | 38   | 12.71  |
| Supply Air Temperature °C (°F) | 12.3                                      | 54.1   | 14.6                                     | 58.3   | 17.2                                       | 63.0   |
| <b>28°C DB (82.4) 45% RH</b>   |   |        |  |        |  |        |
| Total kW (BTU/H)               | 38.9                                      | 132766 | 28.6                                     | 97612  | 21.6                                       | 73721  |
| Sensible kW (BTU/H)            | 30.1                                      | 102731 | 25.6                                     | 87373  | 21.6                                       | 73721  |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.28                                     | 4369   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 1.86                                      | 29.48  | 1.36                                     | 21.56  | 1.03                                       | 16.33  |
| Pressure Drop, kPa (ft H2O)    | 113                                       | 37.80  | 64                                       | 21.41  | 38   | 12.71  |
| Supply Air Temperature °C (°F) | 12.4                                      | 54.3   | 15                                       | 59.0   | 17.2                                       | 63.0   |
| <b>25°C DB (77°F) 45% RH</b>   |   |        |  |        |  |        |
| Total kW (BTU/H)               | 27.8                                      | 94881  | 21.6                                     | 73721  | 16.6                                       | 56656  |
| Sensible kW (BTU/H)            | 25.8                                      | 88055  | 21.6                                     | 73721  | 16.6                                       | 56656  |
| Unit Power Input kW (BTU/H)    | 1.28                                      | 4369   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 1.33                                      | 21.08  | 1.03                                     | 16.33  | 0.79                                       | 12.52  |
| Pressure Drop, kPa (ft H2O)    | 62  | 20.74  | 38                                       | 12.71  | 24   | 8.03   |
| Supply Air Temperature °C (°F) | 12.1                                      | 53.8   | 14.3                                     | 57.7   | 17   | 62.6   |
| <b>25°C DB (77°F) 40% RH</b>   |   |        |  |        |  |        |
| Total kW (BTU/H)               | 26.5                                      | 90445  | 21.6                                     | 73721  | 16.6                                       | 56656  |
| Sensible kW (BTU/H)            | 26.5                                      | 90445  | 21.6                                     | 73721  | 16.6                                       | 56656  |
| Unit Power Input kW (BTU/H)    | 1.26                                      | 4300   | 1.26                                     | 4300   | 1.26                                       | 4300   |
| Flow Rate, l/s (GPM)           | 1.26                                      | 19.97  | 1.03                                     | 16.33  | 0.79                                       | 12.52  |
| Pressure Drop, kPa (ft H2O)    | 56  | 18.73  | 38                                       | 12.71  | 24   | 8.03   |
| Supply Air Temperature °C (°F) | 11.7                                      | 53.1   | 14.3                                     | 57.7   | 17   | 62.6   |
| <b>22°C DB (71.6°F) 55% RH</b> |   |        |  |        |  |        |
| Total kW (BTU/H)               | 23.9                                      | 81571  | 16.6                                     | 56656  | 11.3                                       | 38567  |

## Specifications - CW

|  |      |       |      |       |      |       |
|--|------|-------|------|-------|------|-------|
| Sensible kW (BTU/H)                      | 20.5 | 69967 | 16.6 | 56656 | 11.3 | 38567 |
| Unit Power Input kW (BTU/H)              | 1.26 | 4300  | 1.26 | 4300  | 1.26 | 4300  |
| Flow Rate, l/s (GPM)                     | 1.14 | 18.07 | 0.79 | 12.52 | 0.54 | 8.56  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 47   | 15.72 | 24   | 8.03  | 12   | 4.01  |
| Supply Air Temperature °C (°F)           | 11.9 | 53.4  | 14.1 | 57.4  | 16.9 | 62.4  |
| <b>22°C DB (71,6°F) 50% RH</b>           |      |       |      |       |      |       |
| Total kW (BTU/H)                         | 21.6 | 73721 | 16.6 | 56656 | 11.3 | 38567 |
| Sensible kW (BTU/H)                      | 21.3 | 72697 | 16.6 | 56656 | 11.3 | 38567 |
| Unit Power Input kW (BTU/H)              | 1.26 | 4300  | 1.26 | 4300  | 1.26 | 4300  |
| Flow Rate, l/s (GPM)                     | 1.03 | 16.33 | 0.79 | 12.52 | 0.54 | 8.56  |
| Pressure Drop, kPa (ft H <sub>2</sub> O) | 39   | 13.05 | 24   | 8.03  | 12   | 4.01  |
| Supply Air Temperature °C (°F)           | 11.6 | 52.9  | 14.1 | 57.4  | 16.9 | 62.4  |

\* Cooling capacities are net values. All capacities are nominal values; actual performance will be ±5%.

\*\* NOTE: Data rated with Standard (MERV 8/ G4) filter. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.

\*\*\* Refer to Tab 6j for standard air flow

# Specifications - Electrical data

## 6.5 Electric data

Tab. 6i - Electrical data

| Configuration   | Model | Power supply     | FLA [A] | LRA [A] | RESIDUAL-CURRENT CIRCUIT BREAKERS I $\Delta$ n = 0.3A (400V) |
|---|-------|------------------|---------|---------|--|
| <b>Cooling</b><br>Fan + compressor  | CR020 | 400 / 3N / 50 Hz | 22.3    | 107     | 40 A Curve C   |
|   | CR035 |                  | 28.0    | 121     | 50 A Curve C   |
| <b>Cooling + Electrical heating (dehumidification)</b><br>Fan + compressor + electrical heaters | CR020 | 400 / 3N / 50 Hz | 31.0    | 116     | 50 A Curve C   |
|   | CR035 |                  | 36.7    | 130     | 63 A Curve C   |
| <b>Cooling + Humidification</b><br>Fan + compressor + humidifier                                | CR020 | 400 / 3N / 50 Hz | 31.0    | 116     | 50 A Curve C   |
|   | CR035 |                  | 36.7    | 130     | 63 A Curve C   |

| Configuration   | Model | Power supply     | FLA [A] | LRA [A] | RESIDUAL-CURRENT CIRCUIT BREAKERS I $\Delta$ n = 0.3A (400V) |
|---|-------|------------------|---------|---------|--|
| <b>Cooling</b><br>Fan   | CR040 | 400 / 3N / 50 Hz | 3       | 3       | 10 A Curve C   |
| <b>Cooling + Electrical heating</b><br>Fan + electrical heaters | CR040 | 400 / 3N / 50 Hz | 11,7    | 11,7    | 20 A Curve C   |
| <b>Cooling + Humidification</b><br>Fan + humidifier             | CR040 | 400 / 3N / 50 Hz | 9,5     | 9,5     | 20 A Curve C   |

Without condensate pump option

The cables have to be sized in compliance with local standards and according to the type and characteristics (e.g. Amperes) of installation. The specific power of the user-installed switch, must be lower than 300,000 A<sup>2</sup> x s.

Prescriptions on the differential relay required to the user:

- For special places (healthcare facilities, etc...) comply with the local regulations;
- For ordinary places, a low sensitivity is suggested (300mA) coordinated with the value of the ground heater (IEC364):  $R_a \leq 50/I_a$  (Art. 413.1.4.1, CEI 64-8);
- In case of frequent over-voltages with mains impulse, it is advisable to install a selective differential and to evaluate the need for adopting other devices.

| COMPONENT                | POWER SUPPLY    | MODEL | OA* [A] | FLA** [A] | LRA** [A] | NOMINAL POWER [kW] |
|--------------------------|-----------------|-------|---------|-----------|-----------|--------------------|
| <b>FAN</b>               | 400 V/3 N/50 Hz | CR020 | 2x1,95  | 2x3,1     | 2x0,1     | 2x0,30             |
|                          |                 | CR035 | 2x0,85  | 2x1,5     | 2x0,1     | 2x0,53             |
|                          |                 | CR040 | 2x1     | 2x1,5     | 2x0,1     | 2x0,63             |
| <b>COMPRESSOR</b>        | 400 V/3 N/50 Hz | CR020 | 11,13   | 16,1      | 101       | 5,99               |
|                          |                 | CR035 | 16,70   | 25,0      | 118       | 9,34               |
|                          |                 | CR040 | 6,5     | 6,5       | -         | 1,50               |
| <b>HUMIDIFIER</b>        | 400 V/3 N/50 Hz | CR035 | 6,5     | 6,5       | -         | 1,50               |
|                          |                 | CR040 | 6,5     | 6,5       | -         | 1,50               |
|                          |                 | CR020 | 8,7     | 8,7       | -         | 6                  |
| <b>ELECTRICAL HEATER</b> | 400 V/3 N/50 Hz | CR035 | 8,7     | 8,7       | -         | 6                  |
|                          |                 | CR040 | 8,7     | 8,7       | -         | 6                  |
|                          |                 | CR020 | -       | 1,2       | -         | -                  |
| <b>CONDENSATE PUMP</b>   | 400 V/3 N/50 Hz | CR035 | -       | 1,2       | -         | -                  |
|                          |                 | CR040 | -       | 1,2       | -         | -                  |
|                          |                 | CR020 | -       | 1,2       | -         | -                  |

(\*) at nominal operating condition: condensing temperature 120°F/48,9°C - inlet air condition 100°F/37,8°C 20%RH

(\*\*) FLA= Max operating current LRA= Locked rotor Amps

## Specifications - Electrical data

| CONFIGURATION   | Voltage | CR020RA/W |          | CR035RA/W |          | CR040RC  |          |
|---|---------|-----------|----------|-----------|----------|----------|----------|
|   |         | 460\3\60  | 208\3\60 | 460\3\60  | 208\3\60 | 460\3\60 | 208\3\60 |
| With Electric Reheat, Steam Generating Humidifier, & Condensate Pump    | FLA     | 27,4      | 51,0     | 31,7      | 62,0     | 11,7     | 24,9     |
|   | WSA     | 32,4      | 61,6     | 38,6      | 75,4     | 14,3     | 31,1     |
|   | OPD     | 40A       | 80A      | 50A       | 100A     | 15A      | 35A      |
| With Steam Generating Humidifier & Condensate Pump                      | FLA     | 23,6      | 42,8     | 27,9      | 53,8     | 7,9      | 16,7     |
|   | WSA     | 26,7      | 49,3     | 32,9      | 63,1     | 9,9      | 20,9     |
|   | OPD     | 35A       | 70A      | 50A       | 100A     | 15A      | 25A      |
| With Electric Reheat & Condensate Pump                                  | FLA     | 27,4      | 51,0     | 31,7      | 62,0     | 11,7     | 24,9     |
|   | WSA     | 32,4      | 61,6     | 38,6      | 75,4     | 14,3     | 31,1     |
|   | OPD     | 40A       | 80A      | 50A       | 100A     | 15A      | 35A      |
| With Electric Reheat & Steam Generating Humidifier                      | FLA     | 26,2      | 48,7     | 30,5      | 59,7     | 10,5     | 22,6     |
|   | WSA     | 31,2      | 59,3     | 37,4      | 73,1     | 13,1     | 28,3     |
|   | OPD     | 40A       | 80A      | 50A       | 100A     | 15A      | 30A      |
| With Condensate Pump  | FLA     | 19,9      | 34,4     | 24,2      | 45,4     | 4,2      | 8,3      |
|   | WSA     | 23,0      | 40,9     | 29,2      | 54,7     | 4,6      | 9,1      |
|   | OPD     | 30A       | 60A      | 45A       | 90A      | 15A      | 15A      |
| Without Electric Reheat, Steam Generating Humidifier, & Condensate Pump | FLA     | 18,7      | 32,1     | 23,0      | 43,1     | 3,0      | 6,0      |
|   | WSA     | 21,8      | 38,6     | 28,0      | 52,4     | 3,4      | 6,8      |
|   | OPD     | 30A       | 60A      | 45A       | 80A      | 15A      | 15A      |

FLA = Full Load Amps (Input Amps); WSA = Wire Size Amps (Minimum Supply Circuit Ampacity); OPD = Maximum Overcurrent Protective

| Voltage                          | CR020    |          | CR035/CR040 |          |
|----------------------------------|----------|----------|-------------|----------|
|                                  | 460\3\60 | 208\3\60 | 460\3\60    | 208\3\60 |
| <b>Digital Scroll Compressor</b> |          |          |             |          |
| RLA                              | 12,5     | 25,9     | 20          | 37,1     |
| LRA                              | 75       | 164      | 125         | 239      |
| <b>Fans</b>                      |          |          |             |          |
| RLA                              | 6,2      | 6,2      | 3           | 6        |
| LRA                              | 0,2      | 0,2      | 0,2         | 0,2      |
| <b>Humidifier</b>                |          |          |             |          |
| FLA                              | 3,7      | 8,4      | 3,7         | 8,4      |
| <b>Electric Reheat</b>           |          |          |             |          |
| FLA                              | 7,5      | 16,6     | 7,5         | 16,6     |
| <b>Condensate Pump</b>           |          |          |             |          |
| FLA                              | 1,2      | 2,3      | 1,2         | 2,3      |

Device Size RLA = Rated Load Amps; LRA = Locked Rotor Amps

# Specifications - Sound data

## 6.6 Sound data

Tab. 6j - Liebert CRV Sound Data

The following tables show sound levels for every octave band frequency.

### CR020 Air Cooled Tested

| MODEL | Airflow     |      | Octave band frequency (Hz) |       |      |      |      |      |      |      |      |      | Sound Level [dB(A)] | Unit SPL suction (2m, f.f., dBA) |
|-------|-------------|------|----------------------------|-------|------|------|------|------|------|------|------|------|---------------------|----------------------------------|
|       | Fan Speed % | SCFM | m <sup>3</sup> /h          | Level | 31.5 | 63   | 125  | 250  | 500  | 1000 | 2000 | 4000 |                     |                                  |
| 100   | 2454        | 4170 | PWL                        | 73.8  | 69.4 | 71   | 77.3 | 75.9 | 74.2 | 73.5 | 68.2 | 59.2 | 79.6                | 69.2                             |
| 75    | 2166        | 3680 | PWL                        | 71.2  | 66.8 | 68.4 | 74.7 | 73.3 | 71.6 | 70.9 | 65.6 | 56.6 | 77                  | 66.9                             |
| 55    | 1780        | 3025 | PWL                        | 67.6  | 63.2 | 64.8 | 71.1 | 69.7 | 68   | 67.3 | 62   | 53   | 73.4                | 63.9                             |

### CR035 Air Cooled Tested

| MODEL | Airflow     |      | Octave band frequency (Hz) |       |      |      |      |      |      |      |      |      | Sound Level [dB(A)] | Unit SPL suction (2m, f.f., dBA) |
|-------|-------------|------|----------------------------|-------|------|------|------|------|------|------|------|------|---------------------|----------------------------------|
|       | Fan Speed % | SCFM | m <sup>3</sup> /h          | Level | 31.5 | 63   | 125  | 250  | 500  | 1000 | 2000 | 4000 |                     |                                  |
| 100   | 3260        | 5540 | PWL                        | 76    | 76.2 | 80.5 | 82.7 | 77.3 | 73.1 | 74.5 | 69   | 61.9 | 80.9                | 70                               |
| 75    | 2708        | 4600 | PWL                        | 71.3  | 71.5 | 75.8 | 78   | 72.6 | 68.4 | 69.8 | 64.3 | 57.2 | 76.2                | 65.7                             |
| 50    | 2048        | 3480 | PWL                        | 66.3  | 66.5 | 70.8 | 73   | 67.6 | 63.4 | 64.8 | 59.3 | 52.2 | 71.2                | 61.9                             |

### CR040 Water Cooled Tested

| MODEL | Airflow     |      | Octave band frequency (Hz) |       |      |      |      |      |      |      |      |      | Sound Level [dB(A)] | Unit SPL suction (2m, f.f., dBA) |
|-------|-------------|------|----------------------------|-------|------|------|------|------|------|------|------|------|---------------------|----------------------------------|
|       | Fan Speed % | SCFM | m <sup>3</sup> /h          | Level | 31.5 | 63   | 125  | 250  | 500  | 1000 | 2000 | 4000 |                     |                                  |
| 100   | 3325        | 5650 | PWL                        | 86.4  | 78.1 | 82.4 | 84.6 | 79.2 | 75   | 76.4 | 70.9 | 63.8 | 82.8                | 71.6                             |
| 75    | 2708        | 4600 | PWL                        | 80.8  | 72.5 | 76.8 | 79   | 73.6 | 69.4 | 70.8 | 65.3 | 58.2 | 77.2                | 66                               |
| 50    | 1972        | 3350 | PWL                        | 75.1  | 66.8 | 71.1 | 73.3 | 67.9 | 63.7 | 65.1 | 59.6 | 52.5 | 71.5                | 60.3                             |

**Level**

**PWL** sound power level

**SPL** sound pressure level

# 7

## Heat Rejections (A version)

### 7.1 Coupling of Liebert CRV (A–type, 50Hz, CE mark) air conditioning units with remote air–cooled condensers (Liebert HCR)

HCR condensers are especially designed to be coupled with the Liebert CRV (A type) air conditioning units power supplied at 50Hz (CE market), within a standard range of external air temperature from –20 °C to +46 °C.

The HCR family comes with a factory–installed stepless fan speed controller especially designed and setted for usage with R410A refrigerant and digital scroll refrigerant circuit.



**Tab. 7a – Coupling of Liebert HCR Condensers with Liebert CRV (A–type, 50Hz, CE mark) air conditioning units**

| MODEL          | External temperature up to 35°C |           | External temperature up to 40°C |           | External temperature up to 46°C |           |
|----------------|---------------------------------|-----------|---------------------------------|-----------|---------------------------------|-----------|
|                | Standard noise                  | low noise | standard noise                  | low noise | standard noise                  |           |
| <b>CR020RA</b> | 1 x HCR33                       | 1 x HCR43 | 1 x HCR43                       | 1 x HCR51 | 1 x HCR51                       | 1 x HCR59 |
| <b>CR035RA</b> | 1 x HCR51                       | 1 x HCR59 | 1 x HCR51                       | 1 x HCR59 | 1 x HCR76                       | 1 x HCR88 |

The table shows the recommended combinations of the Air cooled Condensers Liebert HCR (50Hz – CE mark) with the air conditioners Liebert CRV (50Hz – CE mark), according to the indicated max external air temperature.

Connecting a too large capacity condenser (50% higher than the nominal capacity indicated in Tab. 7.a) to the HPM unit can cause malfunctioning and incorrect condenser regulation at low ambient temperature (e.g. in cold season).

The above indications are approximate and must be checked on the basis of other specific operating conditions.

For operating conditions other than those indicated in the table, refer to the New Hirating calculation software and to the Liebert HCR service manual.

**Tab. 7b – Technical data and performance of air–cooled condenser Liebert HCR**

| Model        | Power supply [V/Ph/Hz] | Total Heat Rejection (THR)* R410A [kW] | Air Volume [m³/h] | Noise Level ** [dB(A)] @ 5 m, f.f. | Input Power [kW] | Current Absorption [A] | FLA [A] | Refrigerant connections [mm] |                  | Dimensions [mm]           | Weight [kg] |
|--------------|------------------------|--|-------------------|------------------------------------|------------------|------------------------|---------|------------------------------|------------------|---------------------------|-------------|
|              |                        |  |                   |                                    |                  |                        |         | Gas line [mm]                | Liquid line [mm] |                           |             |
| <b>HCR33</b> | 230/1/50               | 32.2                                   | 7400              | 50.0                               | 0.55             | 2.5                    | 2.6     | 16                           | 16               | W 1340<br>D 831<br>H 1112 | 75          |
| <b>HCR43</b> | 230/1/50               | 46.0                                   | 17000             | 53.0                               | 1.10             | 5.0                    | 5.2     | 16                           | 16               | W 2340<br>D 831<br>H 1112 | 92          |
| <b>HCR51</b> | 230/1/50               | 52.0                                   | 17000             | 53.0                               | 1.10             | 5.0                    | 5.2     | 22                           | 16               | W 2340<br>D 831<br>H 1112 | 93          |
| <b>HCR59</b> | 230/1/50               | 62.0                                   | 15600             | 53.0                               | 1.10             | 5.0                    | 5.2     | 22                           | 16               | W 2340<br>D 831<br>H 1112 | 102         |
| <b>HCR76</b> | 230/1/50               | 78.0                                   | 25500             | 55.0                               | 1.65             | 7.5                    | 7.8     | 22                           | 16               | W 3340<br>D 831<br>H 1112 | 136         |
| <b>HCR88</b> | 230/1/50               | 92.0                                   | 23400             | 55.0                               | 1.65             | 7.5                    | 7.8     | 22                           | 16               | W 3340<br>D 831<br>H 1112 | 165         |

(\*) The nominal heat rejection capacities refer to the following operative conditions:

- refrigerant R410A
- temperature differences: 15 K
- (T condensation dew point – Toutdoor).
- liquid sub–cooling 3K
- height of the installation = 0 m, above the sea level.
- for different conditions refer to NewHirating program.
- clean exchange surfaces.

(\*\*) The levels of sound pressure here included are measured in the same operative conditions, and are referred to 5 m far from the unit, at 1.5 m in height, in free field conditions.

**All Liebert HCR air remote condensers are:**

- CE marked
- Conform to the following European Directives:

## Heat Rejections (A version)

---

Machine Directive 98/37/CE

PED 97/23/CEE

LVD 2006/95/EC

EMC 2004/108/EC (EN61000–6–2; EN 61000–6–3)

- Frame is made up of a sturdy aluminium structure
- Units are factory equipped with electric board 230V/1ph/50Hz +T, with main disconnector IP65 and with stepless fan speed controller.  
The electrical board is designed to allow a local or remote switch from high to low fan speed set point (and viceversa) by means of terminal contact 70–71.  
The entire units have IP54 type of protection.
- Motorized fans are IP54 (DIN60529) , protection class F.  
Maintenance–free ball bearings.
- Most important technical data are gathered in Tab. 5b
- Heat rejection capacity have been measured according to the norm EN327;  
Sound power level have been measured according to the norm UNI EN ISO 3741:2001;  
Sound pressure level have been evaluated according to the norm EN13487, at 5m distance, with free field conditions.
- Max working pressure is 43 barg

# Heat Rejections (W version)

## 7.2 Coupling of Liebert CRV (W-type, 50Hz, CE mark) water cooled air conditioning units with remote Liebert HPD Dry Coolers

The water-condensed units are provided with a water/refrigerant exchanger with braze-welded **plates** made of **stainless steel**; this advanced exchanger type gives the highest efficiency in heat exchange. In addition, a certain oversizing of the exchanger has been provided so as to reduce pressure drops (and energy consumption of the water pump) as much as possible and thus to allow the unit to operate with the external chiller in closed circuit, even at high outdoor temperatures.




When operating in a closed circuit, the water is cooled by the outdoor air in a heat exchanger; in this case, to avoid unwanted ice formation during winter, it is advisable to use a water/glycol mixture.

The circulation of the water-glycol mixture is forced (the pump is not supplied). If mains water or tower water is used, when installing the unit fit a mechanical filter on the water line to protect the condenser against possible impurities contained in the water (for condenser cleaning see the service manual).

### Liebert HPD Dry Coolers

Our Liebert HPD Dry Coolers are built with a copper/aluminium cooling coil and axial fan(s). The main data on Dry Coolers is shown in the following table:

**Percentage of ethylene glycol mixed with water**

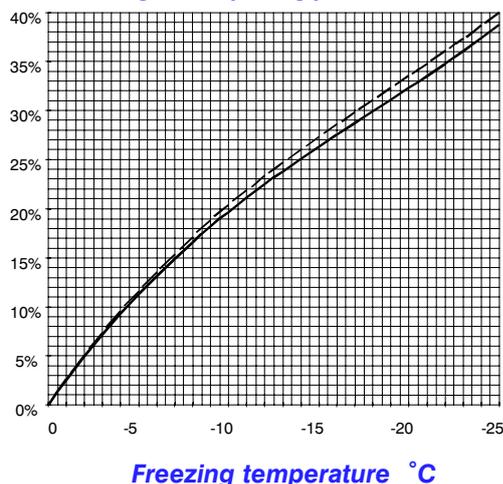

### Note:

**In the closed circuits** to avoid water freezing in the cold seasons, it is strictly recommended to mix water with ethylene glycol. The suggested percentage is given in the Diagram.

For safety reason, **calculate the percentage** at least at 5°C below the minimum ambient temperature.

It is also recommended to check periodically the mixture: in case of leakage of the circuit, the sanitary water, used at compensation, reduces progressively the glycol percentage and increases the freezing point of the mixture!

--- % in weight      — % in volume

### Features and benefits

Liebert HPD Dry Coolers are the new range of liquid coolers, able to cover rated heat exchange capacities from 8 to 400 kW.

They excel above all for their efficiency, versatility and reliability, thanks to the following features:

- possibility of installation with horizontal or vertical air flow with simple operations on site, with the same model of Dry Cooler, without needing any wiring or re-wiring inside the unit.
- modulating fan speed regulator with phase (optional), for a continuous modulation of the fan speed, installed on the machine, wired and factory-set, thus making the connection steps on site and the unit start-up extremely easy; the fan speed regulator with phase cutoff can be selected to control up to two set-point values for the water delivery temperature of the Dry Cooler.

Do not use fan speed regulator other than the approved one supplied by the manufacturer.

When the Dry Cooler is ordered without temperature control, an outer on/off type control (to be arranged by the customer) is anyway allowed and must be connected on site with the suitable terminals available in the electric board Q of the unit (see wiring diagram enclosed to the unit).

## Heat Rejections (W version)

- The axial fans are equipped with protection grid and are statically and dynamically balanced; they can guarantee high efficiency and a low emitted noise level (above all in the low noise version); further, they are equipped with motors able to operate within a wide range of outdoor working temperatures. Protection degree IP 54. Single-phase fans feature an electric condenser incorporated in the terminal board.
  - Heat exchanger with oval-geometry tubes ensuring the best air flow and thus an increase in the efficiency of the heat exchange, for a lower emitted noise level.  
Tubes are in copper and fins in aluminum, with wide heat exchange surface.  
Upon request (optional), the unit can be ordered with fins in epoxy-coated aluminum, with a better protection. The coil manifolds are in copper, with flanged connections in AISI 304 stainless steel for the models with three-phase power supply and male gas threaded connections for the single-phase models.
  - the power supply is:  
230 V single phase 50 Hz in the ESM models (standard noise level) and ELM models (low noise level).  
400 V three-phase 50 Hz in the EST models (standard noise level) and ELT models (low noise level).
  - Electrical boxes and accessories are water proof IP55.
  - The frame is made up of a sturdy structure in galvanized steel, totally painted.
  - The units are equipped with protection electric board Q, with main disconnecter and safety device for fan motors.
  - The most important technical data are gathered in Tab. 5d.  
Tests on thermal performance have been carried out at IMQ laboratories, according to the norm UNI EN 1048:2000, at the following special operating conditions:  
Air inlet T = 35°C  
Water inlet T = 45°C  
Water outlet T = 40°C  
Sound pressure levels have been evaluated according to the norm EN13487, at a 10-m distance, with free field.
  - The working pressure depends on the circuit where the Dry Cooler is connected. Dry Cooler max working pressure = 16 barg.
- All Dry Coolers are CE marked.**
- Conform to the following European Directives:  
Machine Directive 98/37/CE  
PED 97/23/CEE  
LVD 2006/95/EC  
EMC 89/336/CEE (EN61000-6-2; EN 61000-6-3)

**Tab. 7c - Coupling of Liebert HPD Dry Coolers with Liebert CRV (W-type, 50Hz, CE mark) air conditioning units**

| Model          | External temperature up to 30°C |            | External temperature up to 35°C |            | External temperature up to 40°C |            |
|----------------|---------------------------------|------------|---------------------------------|------------|---------------------------------|------------|
|                | Standard noise                  | Low noise  | Standard noise                  | Low noise  | Standard noise                  | Low noise  |
| <b>CR020RW</b> | 1 x ESM018                      | 1 x ELM018 | 1 x EST028                      | 1 x ELM027 | 1 x EST050                      | 1 x ELT047 |
| <b>CR035RW</b> | 1 x EST028                      | 1 x ELM027 | 1 x EST050                      | 1 x ELT055 | 1 x EST070                      | 1 x ELT065 |

*The table shows the recommended combinations of the Dry Coolers Liebert HPD (50Hz - CE mark) with the air conditioners Liebert CRV (50Hz - CE mark), according to the indicated max external air temperature.*

*The combinations have been evaluated considering a mixture of water and ethylene glycol up to 30% as thermal exchange fluid.*

*The above indications are approximate and must be checked on the basis of other specific operating conditions.*

*For operating conditions other than those indicated in the table, refer to the New Hirling calculation software and to the Liebert HPD service manual.*

## Heat Rejections (W version)

Tab. 7d - Technical data and performance of Liebert HPD Dry Coolers

| Standard Model | Performances |                   |                 | Electric data |                |                      | Overall dimensions |       |            |
|----------------|--------------|-------------------|-----------------|---------------|----------------|----------------------|--------------------|-------|------------|
|                | Duty (a)     | Air flow          | Noise level (c) | Supply        | Number of fans | Total absorbed power | Width              | Depth | Height (b) |
|                | kW           | m <sup>3</sup> /h | db(A)           | V/ph/Hz       | n°             | kW                   | mm                 | mm    | mm         |
| <b>ESM018</b>  | 16.1         | 15000             | 49              | 230/1/50      | 2              | 1.56                 | 2236               | 820   | 1030       |
| <b>ESM022</b>  | 22.0         | 14200             | 49              | 230/1/50      | 2              | 1.56                 | 2236               | 820   | 1030       |
| <b>EST028</b>  | 28.0         | 20000             | 49              | 400/3/50      | 2              | 1.38                 | 2866               | 1250  | 1070       |
| <b>EST040</b>  | 36.4         | 19400             | 49              | 400/3/50      | 2              | 1.38                 | 2866               | 1250  | 1070       |
| <b>EST050</b>  | 46.1         | 18400             | 49              | 400/3/50      | 2              | 1.38                 | 2866               | 1250  | 1070       |
| <b>EST060</b>  | 62.8         | 28200             | 51              | 400/3/50      | 3              | 2.07                 | 4066               | 1250  | 1070       |
| <b>EST070</b>  | 69.5         | 27600             | 51              | 400/3/50      | 3              | 2.07                 | 4066               | 1250  | 1070       |

| Low Noise Model | Performances |                   |                 | Electric data |                |                      | Overall dimensions |       |            |
|-----------------|--------------|-------------------|-----------------|---------------|----------------|----------------------|--------------------|-------|------------|
|                 | Duty (a)     | Air flow          | Noise level (c) | Supply        | Number of fans | Total absorbed power | Width              | Depth | Height (b) |
|                 | kW           | m <sup>3</sup> /h | db(A)           | V/ph/Hz       | n°             | kW                   | mm                 | mm    | mm         |
| <b>ELM018</b>   | 17.9         | 9800              | 43              | 230/1/50      | 2              | 0.58                 | 2236               | 820   | 1030       |
| <b>ELM027</b>   | 27.0         | 14700             | 44              | 230/1/50      | 3              | 0.87                 | 3136               | 820   | 1030       |
| <b>ELT040</b>   | 36.9         | 15400             | 43              | 400/3/50      | 2              | 0.96                 | 2866               | 1250  | 1070       |
| <b>ELT047</b>   | 44.5         | 21000             | 44              | 400/3/50      | 3              | 0.99                 | 4066               | 1250  | 1070       |
| <b>ELT055</b>   | 55.7         | 23100             | 45              | 400/3/50      | 3              | 1.44                 | 4066               | 1250  | 1070       |
| <b>ELT065</b>   | 65.6         | 32000             | 46              | 400/3/50      | 4              | 1.92                 | 5266               | 1250  | 1070       |

(a): at the following operative conditions:  
 outdoor temperature = 35°C,  
 inlet/outlet water temperature = 45°C/40°C,  
 fluid is pure water, slm zero meters.  
 For different conditions refer to NewHirating program.  
 Clean exchange surfaces.


(b): vertical flow installation.

(c): sound pressure level, free field, at 10 m distance.

# 8


## Installation drawings

Fig. 8a Overall dimensions / service area

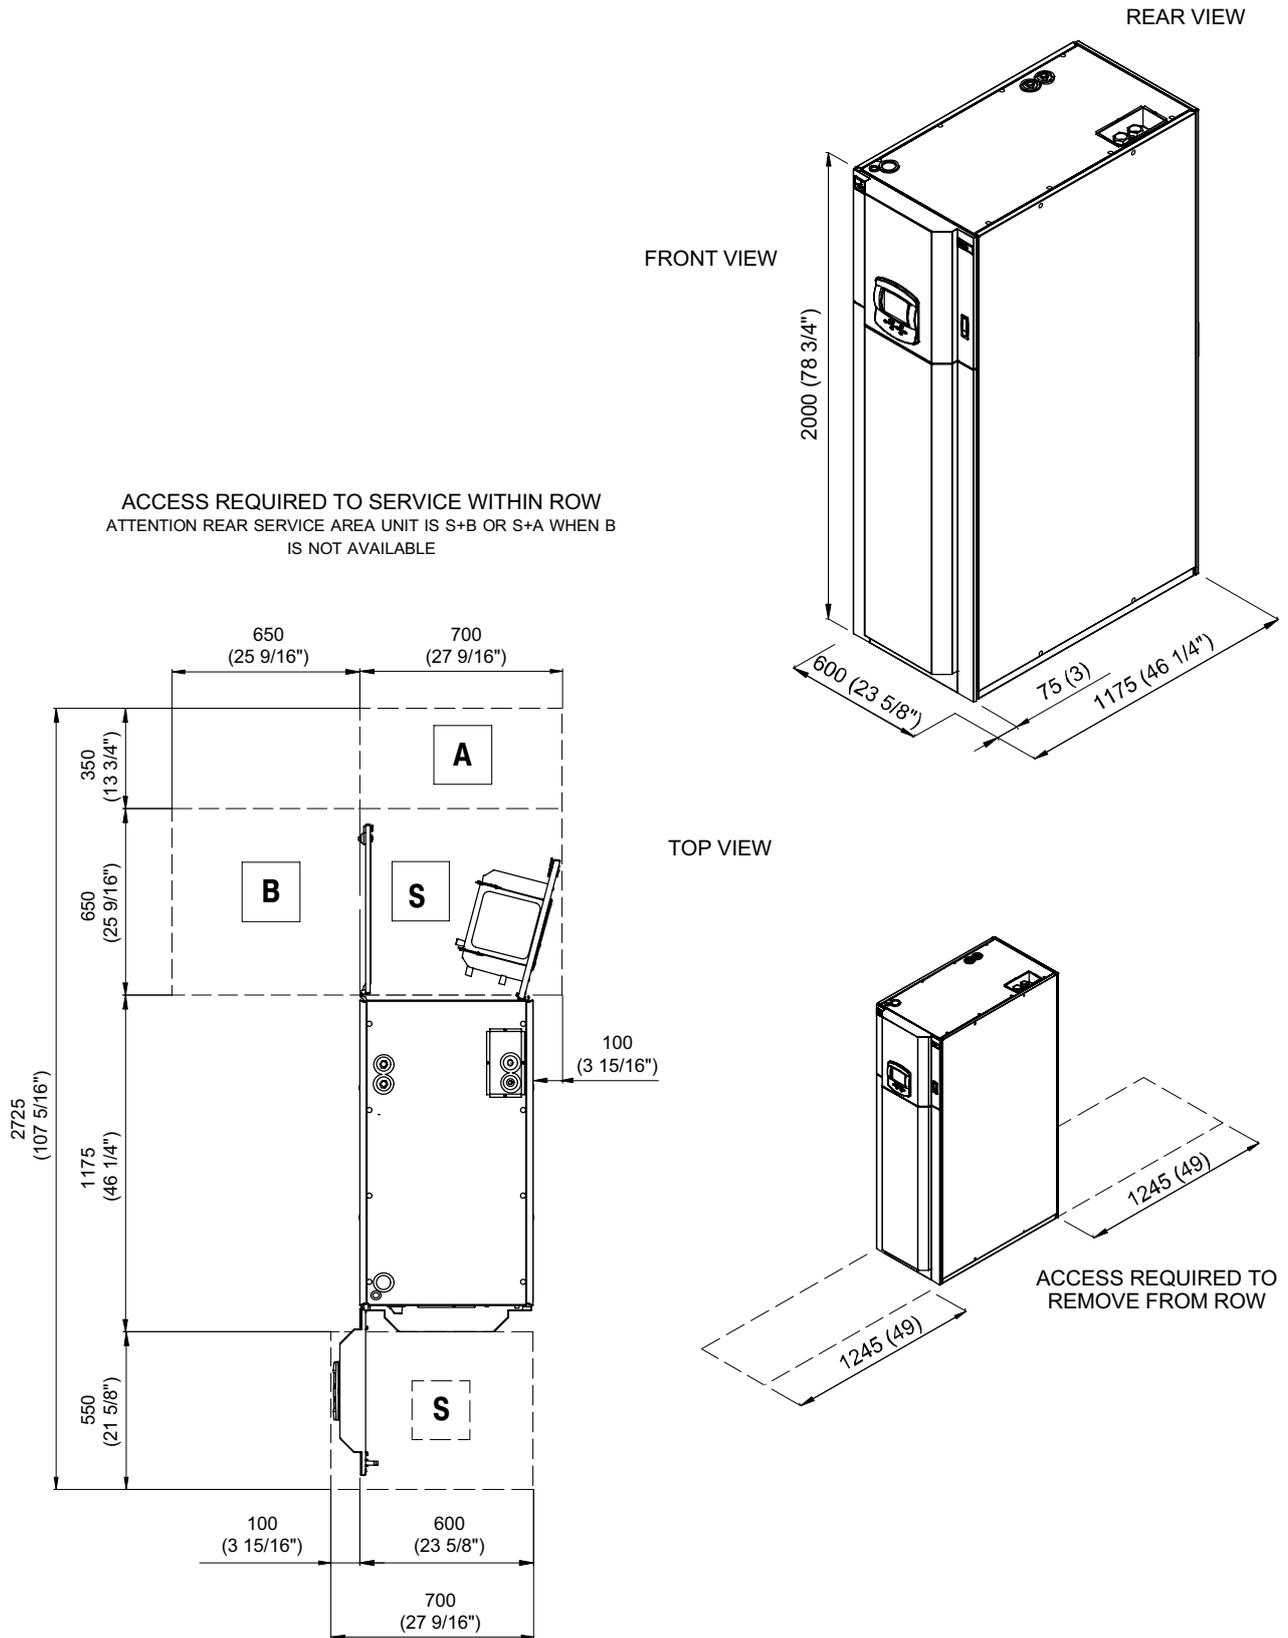

# Installation drawings

Fig. 8b Hole on the raised floor for piping and electrical connections

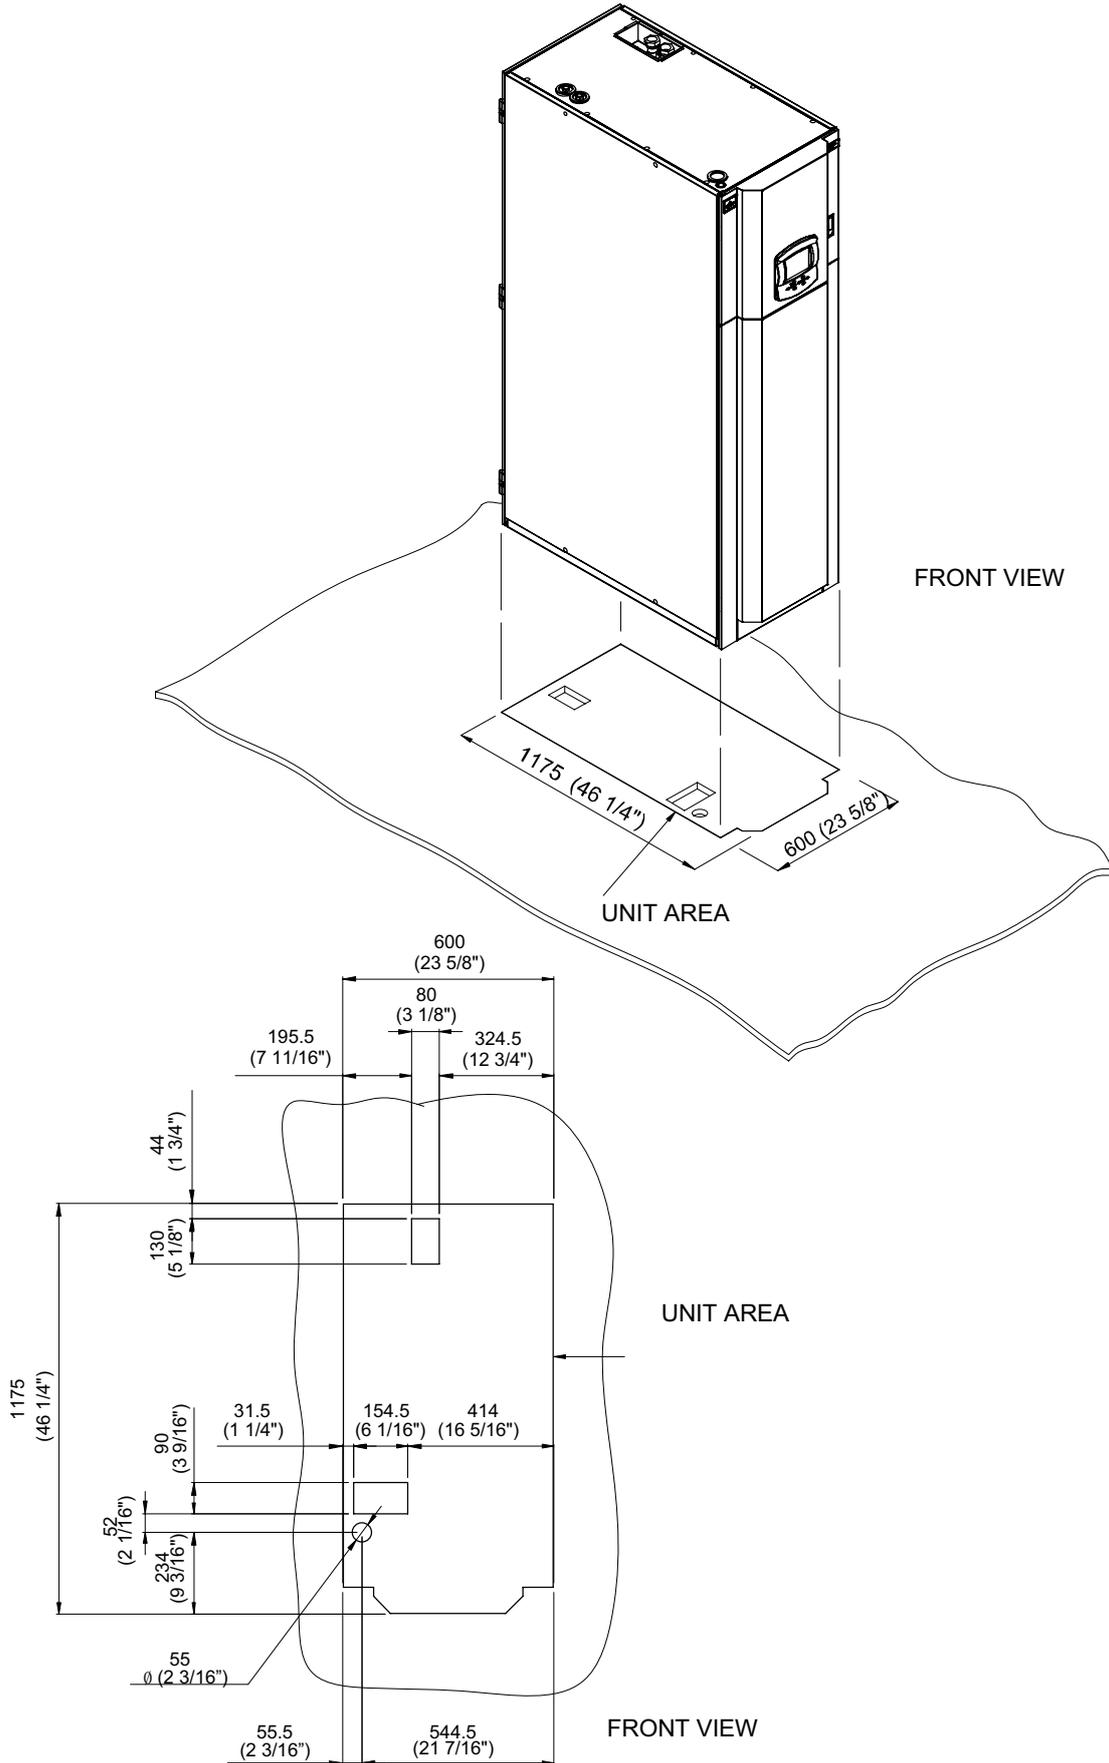

# Installation drawings

Fig. 8c Air bleeding valve position CW


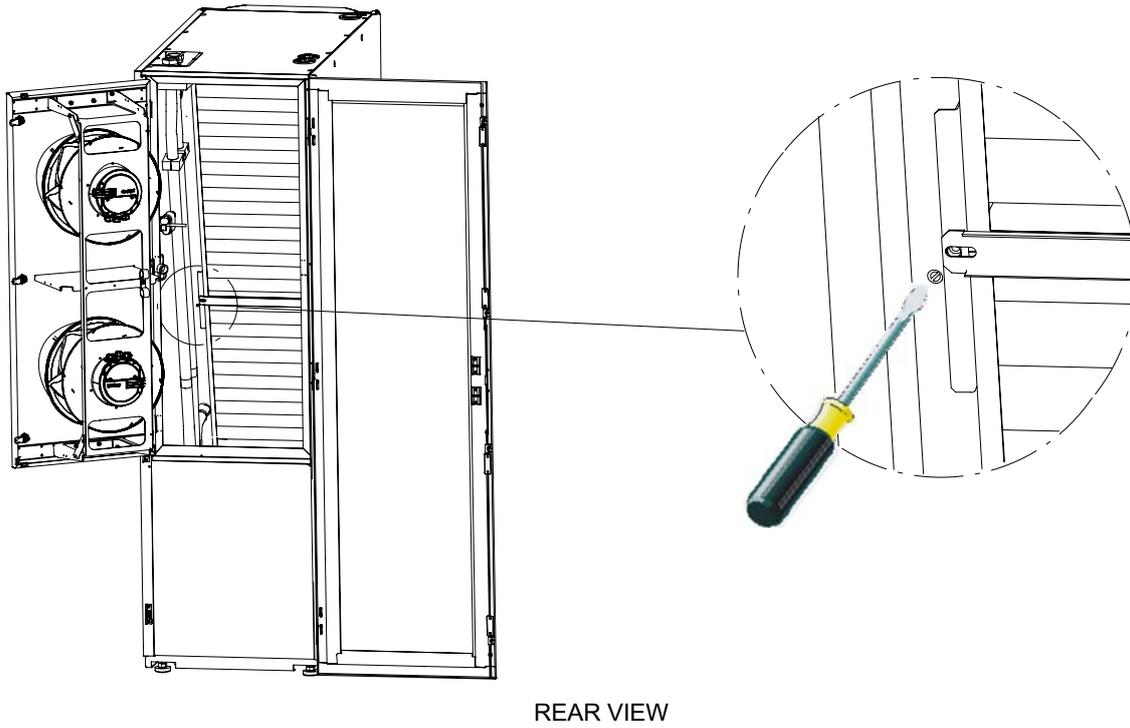



Fig. 8d Electrical connections - entry

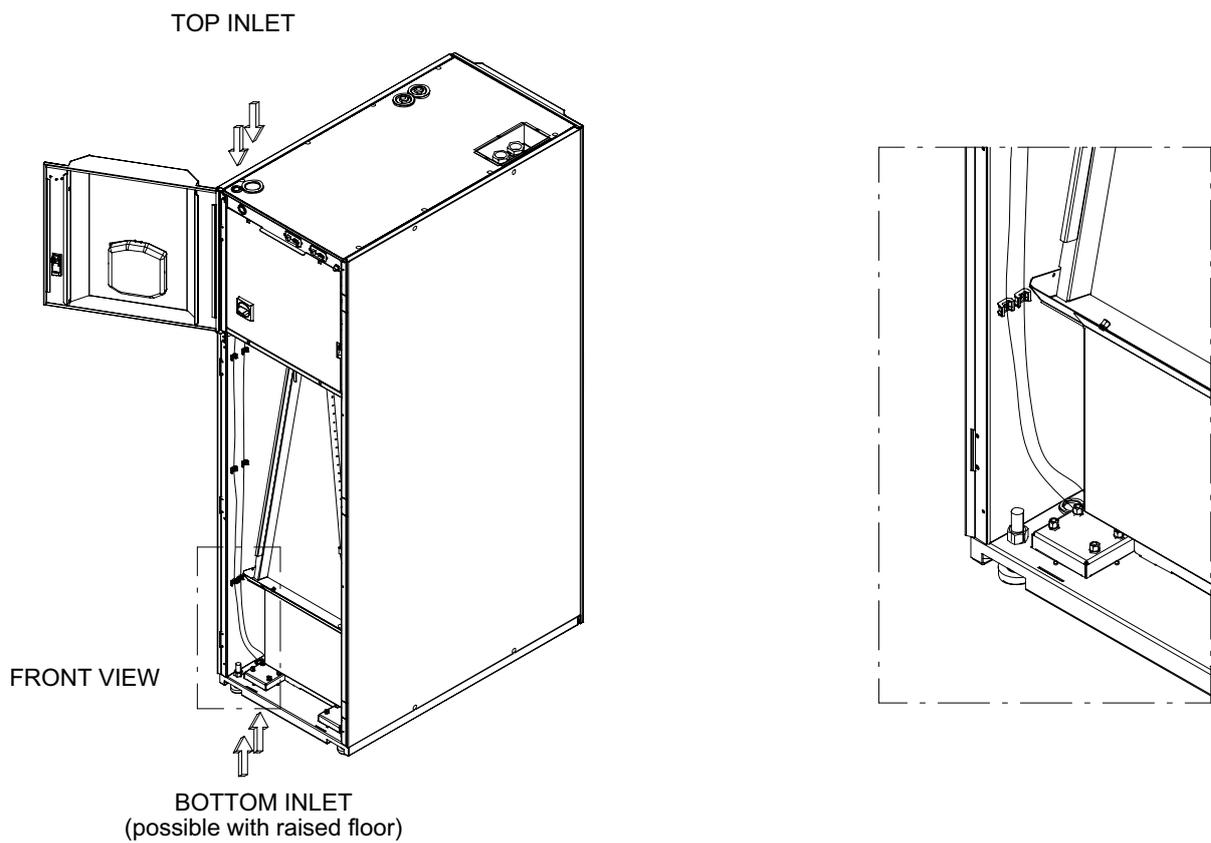

# 9

## Refrigerant, Hydraulic and Electrical Connections


Fig. 9a CR020RA - CR035RA connections

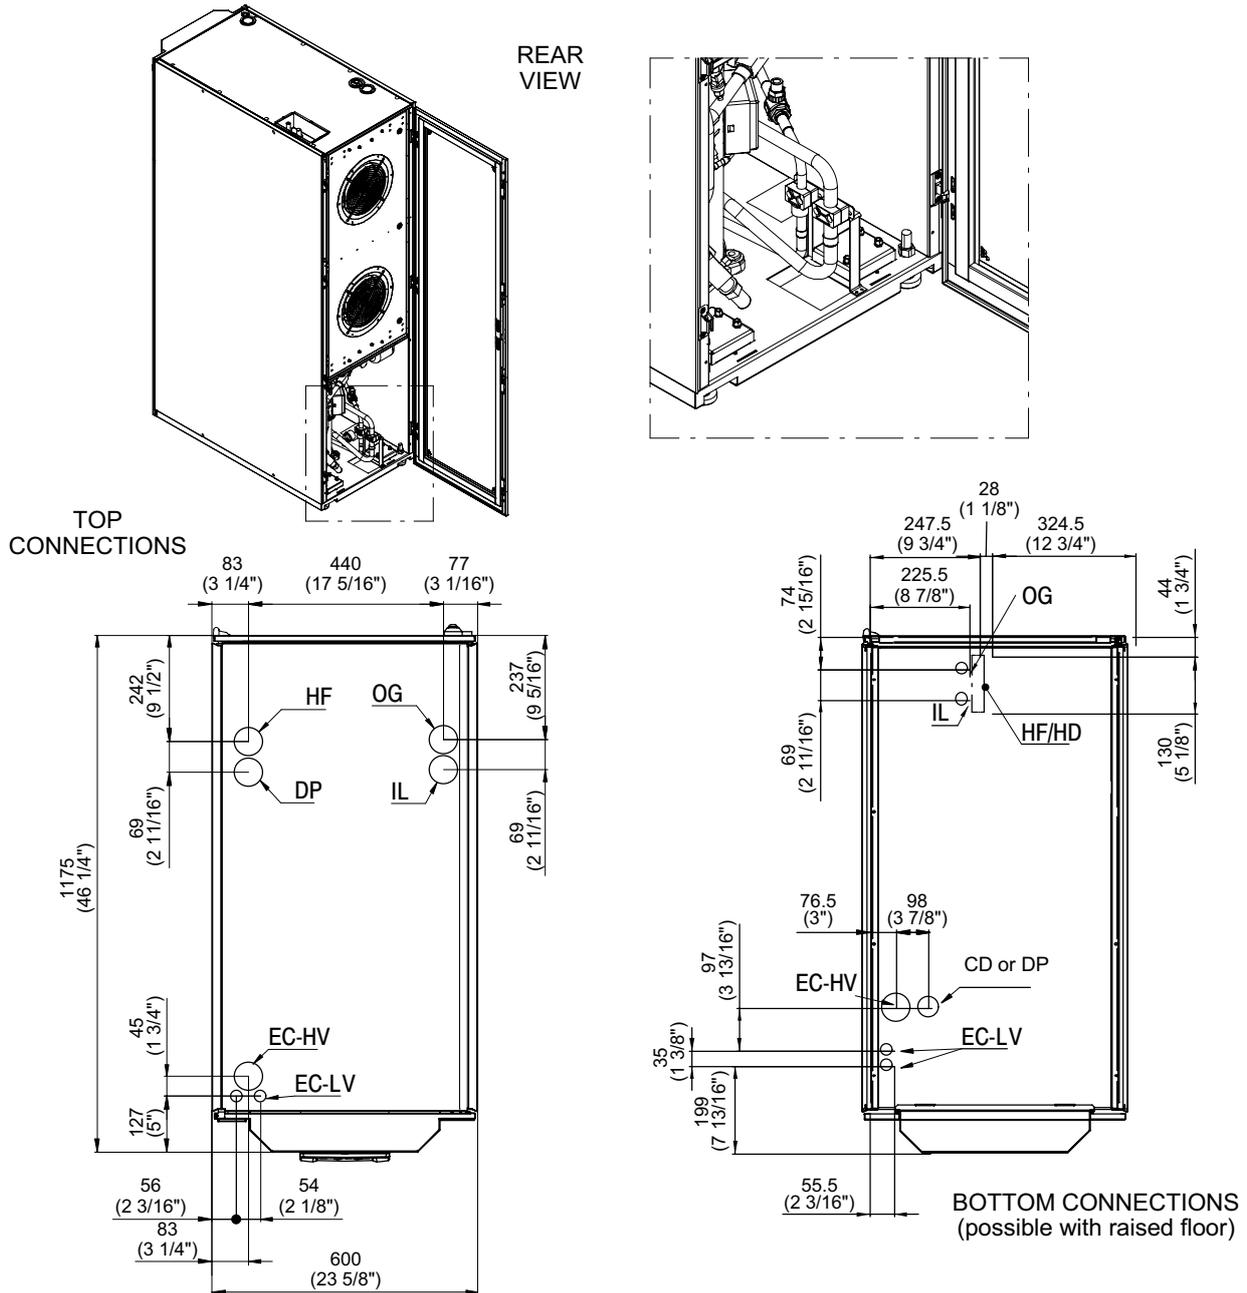

| Unit Connection |   | CR020RA (50Hz)   | CR035RA (50Hz)        | CR020RA (60Hz)   | CR035RA (60Hz)          |
|-----------------|---|--|-----------------------|--|-------------------------|
| IL              | Refrigerant liquid line inlet   | OD 12 (1/2") CU SWEAT  | OD 16 (5/8") CU SWEAT | OD 12.7 (1/2") CU SWEAT  | OD 15.9 (5/8") CU SWEAT |
| OG              | Refrigerant gas line outlet   | OD 16 (5/8") CU SWEAT  | OD 22 (7/8") CU SWEAT | OD 15.9 (5/8") CU SWEAT  | OD 22.2 (7/8") CU SWEAT |
| CD              | Condensate drain.<br>ATTENTION. With pump CD is connected with HD. See DP | ID 20 (3/4")   |                       | 1" MPT   |                         |
| HF              | Humidifier feed   | 1/2" GAS-F for top connections,<br>3/4" GAS F for bottom connections |                       | 1/2" FPT for top connections,<br>3/4" FTP for bottom connections |                         |
| HD              | Humidifier drain<br>ATTENTION. With pump CD is connected with HD. See DP  | ID 22 (7/8")   |                       | 1" MPT   |                         |
| DP              | Pump drain  | 1/2" GAS F   |                       | 1/2" FPT   |                         |
| EC-HV           | Electrical supply - high voltage  | Hole $\emptyset$ 63 (2 1/2")   |                       |  |                         |
| EC-L V          | Electrical supply - low voltage   | Hole $\emptyset$ 28 (1 1/8") TYPICAL 2 PLACES                        |                       |  |                         |

# Refrigerant, Hydraulic and Electrical Connections


Fig. 9b CR020RW - CR035RW connections

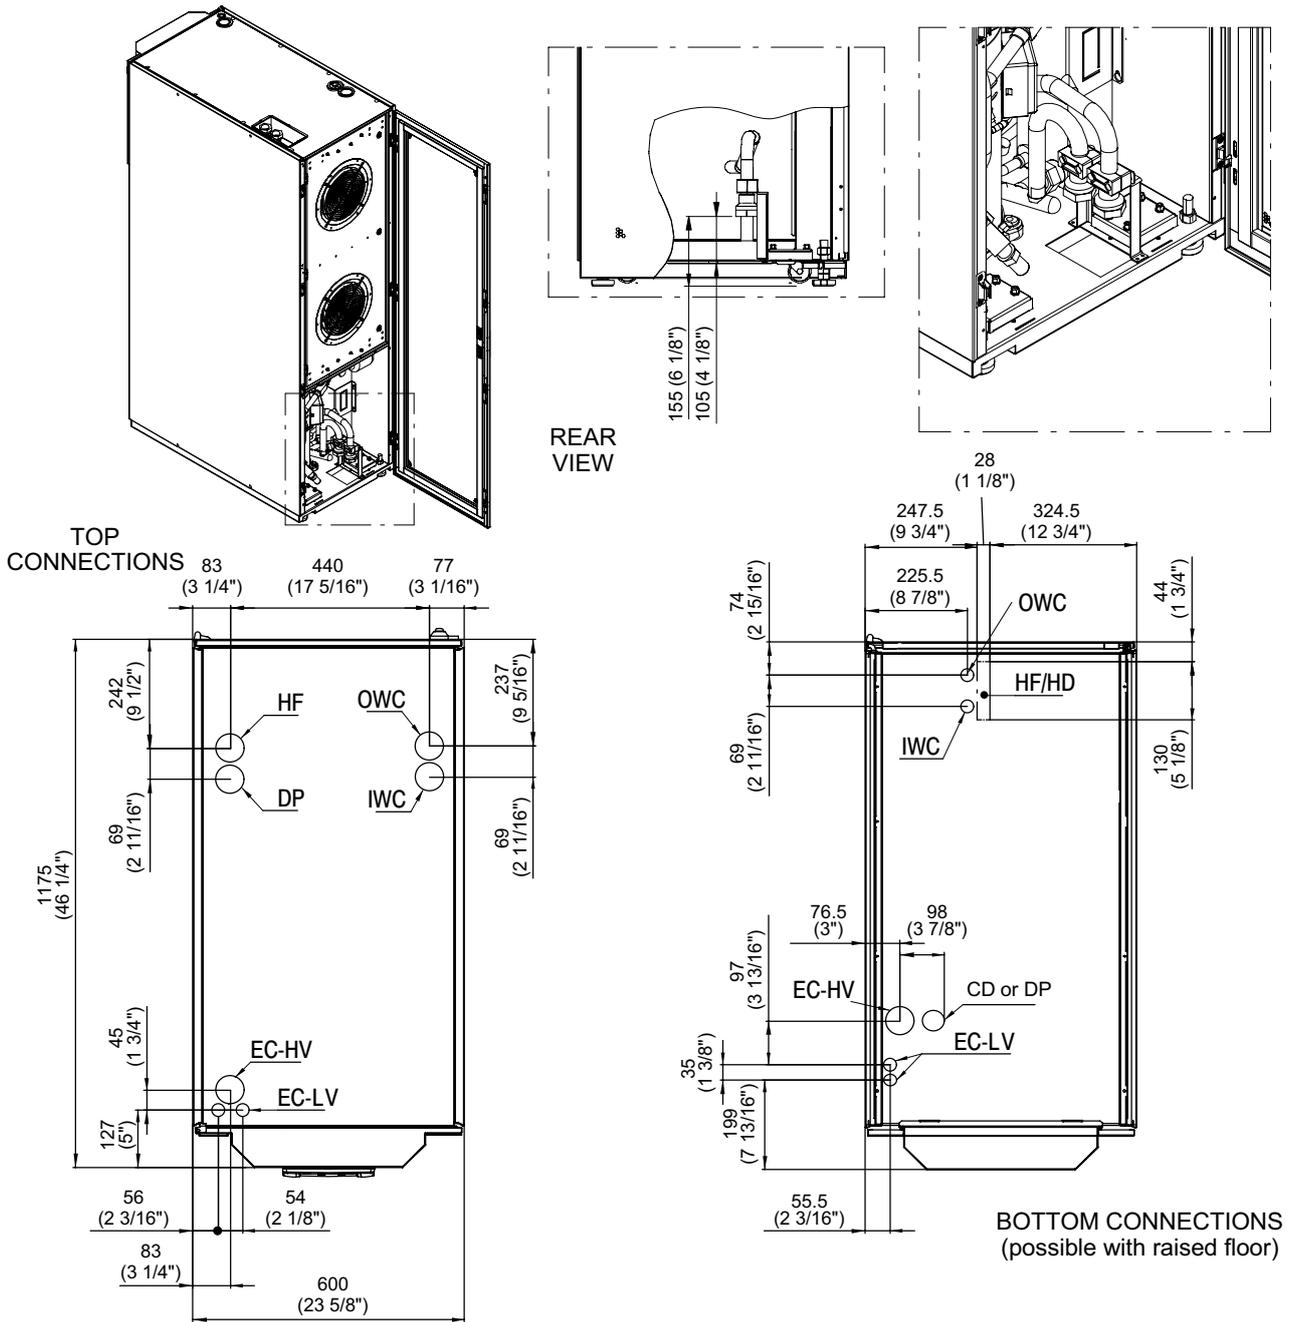

| Unit Connection | CR020RW (50Hz)  | CR035RW (50Hz)   | CR020RW (60Hz) | CR035RW (60Hz)   |
|-----------------|---|--|----------------|--|
| IWC             | Water to condenser inlet  | 1.1/4" GAS F   | 1.1/4" GAS F   | 1.1/4" FPT   |
| OWC             | Water from condenser outlet   | 1.1/4" GAS F   | 1.1/4" GAS F   | 1.1/4" FPT   |
| CD              | Condensate drain.<br>ATTENTION. With pump CD is connected with HD. See DP | ID 20 (3/4")   |                | 1" MPT   |
| HF              | Humidifier feed   | 1/2" GAS-F for top connections,<br>3/4" GAS F for bottom connections |                | 1/2" FPT for top connections,<br>3/4" FTP for bottom connections |
| HD              | Humidifier drain<br>ATTENTION. With pump CD is connected with HD. See DP  | ID 22 (7/8")   |                | 1" MPT   |
| DP              | Pump drain  | 1/2" GAS F   |                | 1/2" FPT   |
| EC-HV           | Electrical supply - high voltage  | Hole Ø 63 (2 1/2")   |                |  |
| EC-L V          | Electrical supply - low voltage   | Hole Ø 28 (1 1/8") TYPICAL 2 PLACES                                  |                |  |

# Refrigerant, Hydraulic and Electrical Connections



Fig. 9c CR040RC connections

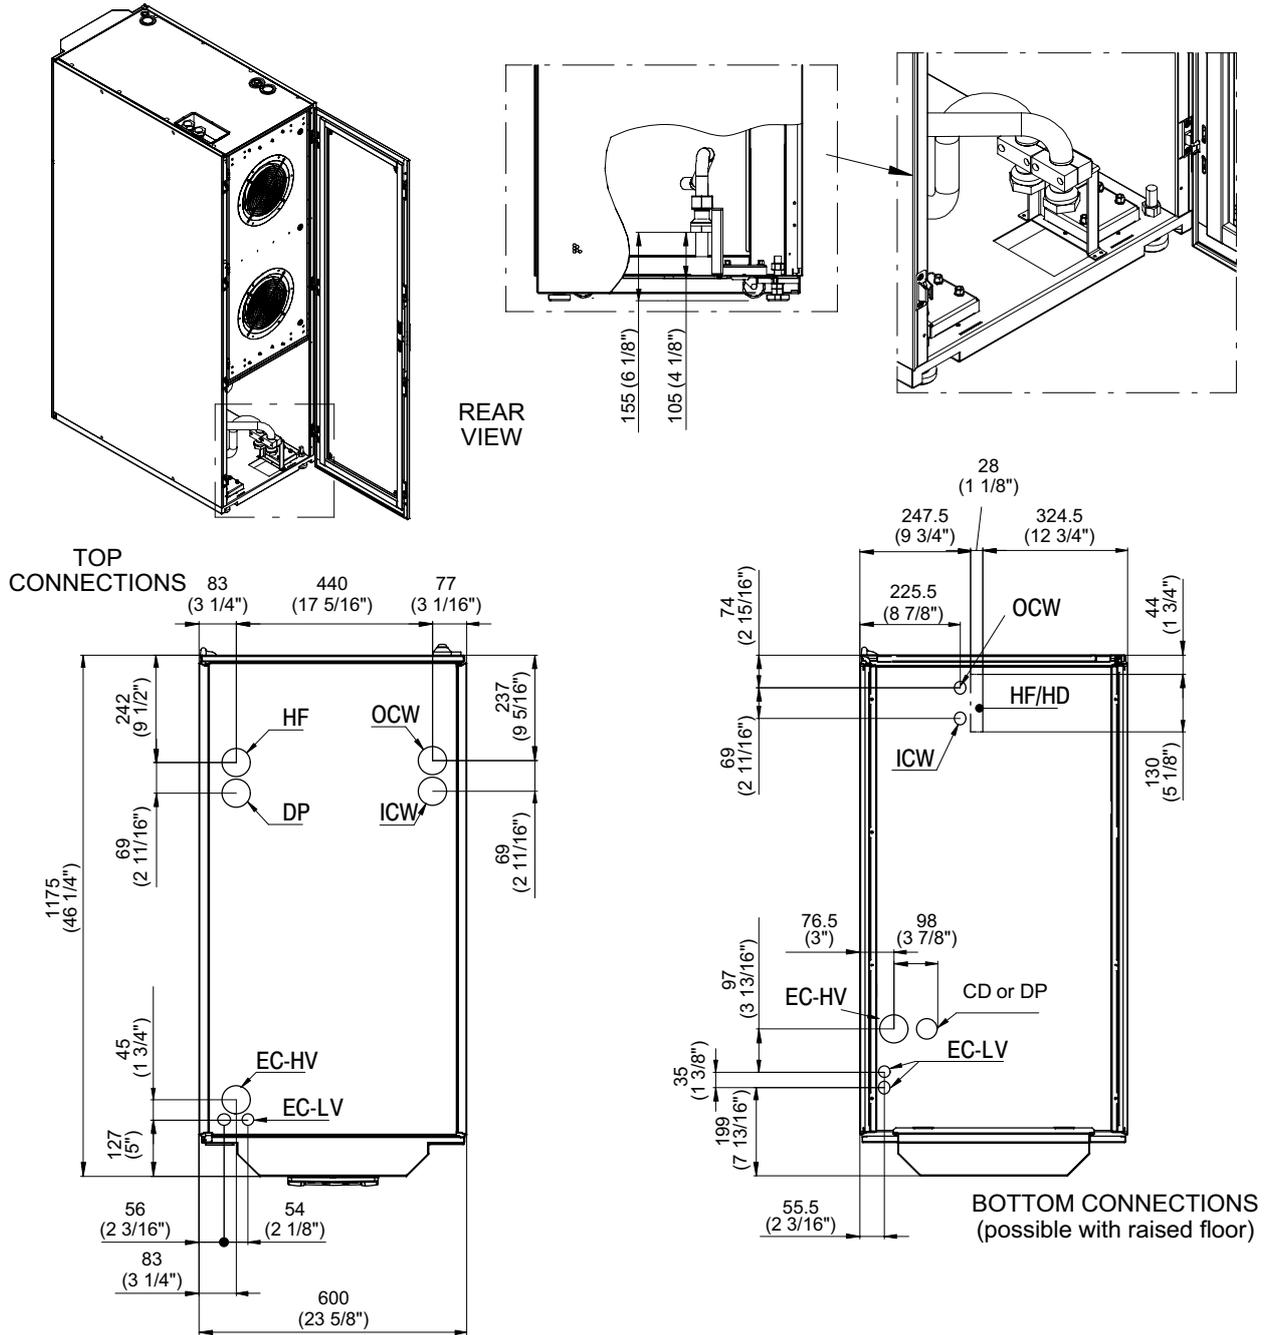

| Unit Connection |   | CR040RC (50Hz)   | CR040RC (60Hz)   |
|-----------------|---|--|--|
| IWC             | Chilled water inlet   | 1.1/4" GAS F   | 1.1/4" FPT   |
| OWC             | Chilled water outlet  | 1.1/4" GAS F   | 1.1/4" FPT   |
| CD              | Condensate drain.<br>ATTENTION. With pump CD is connected with HD. See DP | ID 20 (3/4")   | 1" MPT   |
| HF              | Humidifier feed   | 1/2" GAS-F for top connections,<br>3/4" GAS F for bottom connections | 1/2" FPT for top connections,<br>3/4" FTP for bottom connections |
| HD              | Humidifier drain<br>ATTENTION. With pump CD is connected with HD. See DP  | ID 22 (7/8")   | 1" MPT   |
| DP              | Pump drain  | 1/2" GAS F   | 1/2" FPT   |
| EC-HV           | Electrical supply - hight voltage   | Hole Ø 63 (2 1/2")   |  |
| EC-L V          | Electrical supply - low voltage   | Hole Ø 28 (1 1/8") TYPICAL 2 PLACES                                  |  |

# Refrigerant, Hydraulic and Electrical Connections

Fig. 9d Electrical board layout - 50 Hz

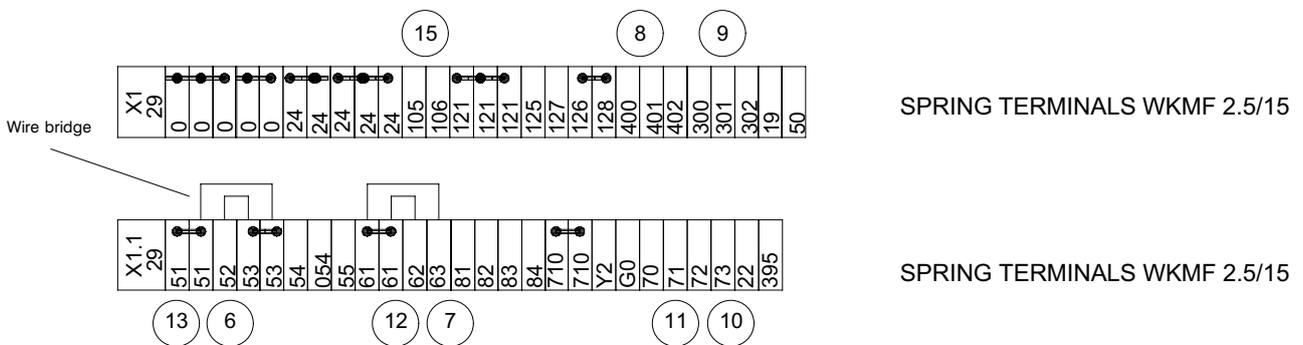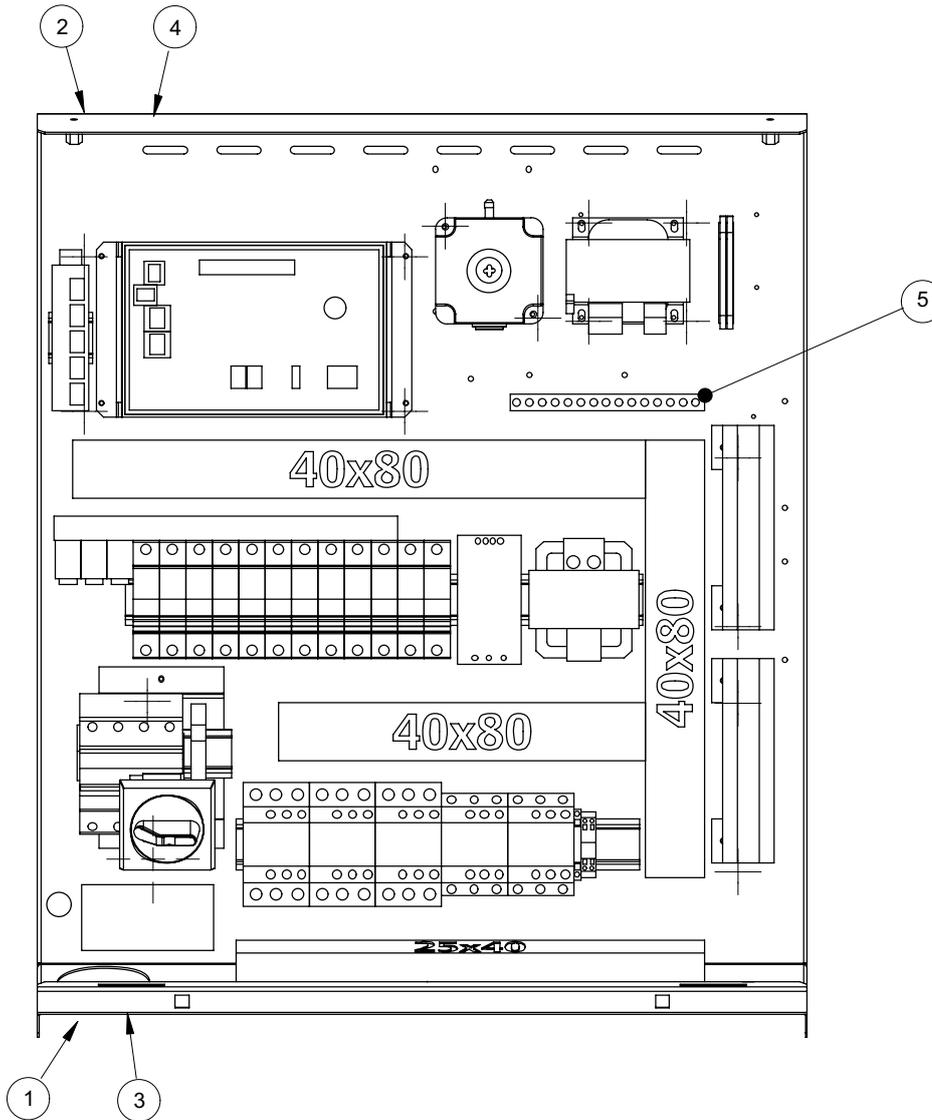

# Refrigerant, Hydraulic and Electrical Connections

---

## 9.1 Electrical field connections descriptions - 50 Hz

### STANDARD ELECTRICAL CONNECTIONS

1. **Primary high voltage entrance** "2.50" (64mm); 1.75" (44mm); 1.375" (35mm) diameter concentric knockouts located in bottom of box
2. **Secondary high voltage entrance** " 2.50" (64mm); 1.75" (44mm); 1.375" (35mm) diameter concentric knockouts located in top of box
3. **Primary low voltage entrance** " Quantity (3) 1.125" (28mm) diameter knockouts located in bottom of unit
4. **Secondary low voltage entrance** " Quantity (3) 1.125" (28mm) diameter knockouts located in top of box
5. **Earth ground** - Terminal for field supplied earth grounding wire.
6. **Remote unit shutdown** - Replace existing jumper between terminals 52 & 53 with field supplied normally closed switch having a minimum 75VA, 24VAC rating. Use field supplied Class 1 wiring.
7. **Customer alarm inputs** - Terminals for field supplied, normally closed contacts, having a minimum 75VA, 24VAC rating, between terminals 61 & 63. Use field supplied Class 1 wiring.
8. **General alarm** - On any alarm, normally open dry contact is closed across terminals 400,401 for remote indication. 2 AMP, 24VAC max load. Use Class 1 field supplied wiring.
9. **Warning alarm** - On any alarm, normally open dry contact is closed across terminals 300,301 for remote indication. 2 AMP, 24VAC max load. Use Class 1 field supplied wiring.
10. **Compressor motor on** - On any call for compressor operation, normally open dry contact is closed across terminals 72 & 73, 2 AMP, 24VAC max load. Use Class 1 field supplied wiring.
11. **Fan motor on** - On any call for fans operation, normally open dry contact is closed across terminals 70 & 71. 2 AMP, 24VAC max load. Use Class 1 field supplied wiring.

### OPTIONAL ELECTRICAL CONNECTIONS


12. **Smoke sensor alarm** (with smoke sensor option)- The smoke sensor is factory installed ,and senses the delivery air;it is connected across terminals 61-62 and send a visual and an audible alarm.  
This smoke sensor is not intended to function as, or replace, any room smoke detection system that may be required by local or national codes. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.
14. **Condensate alarm** (with condensate pump option) - On pump high water indication, normally open dry contact is closed across purple wire for remote indication install inside the box near the pump. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.

### OPTIONAL LOW VOLTAGE TERMINAL PACKAGE CONNECTIONS

15. **Flooding alarm (liquistat)** - The flooding alarm detects the presence of water and activate an alarm. The sensor is connect across terminals 105 & 106 and up to 5 sensors can be connected to the same flooding alarm device,to control many points in the bottom of the unit.

# Refrigerant, Hydraulic and Electrical Connections

Fig. 9e Electrical board layout - 60 Hz

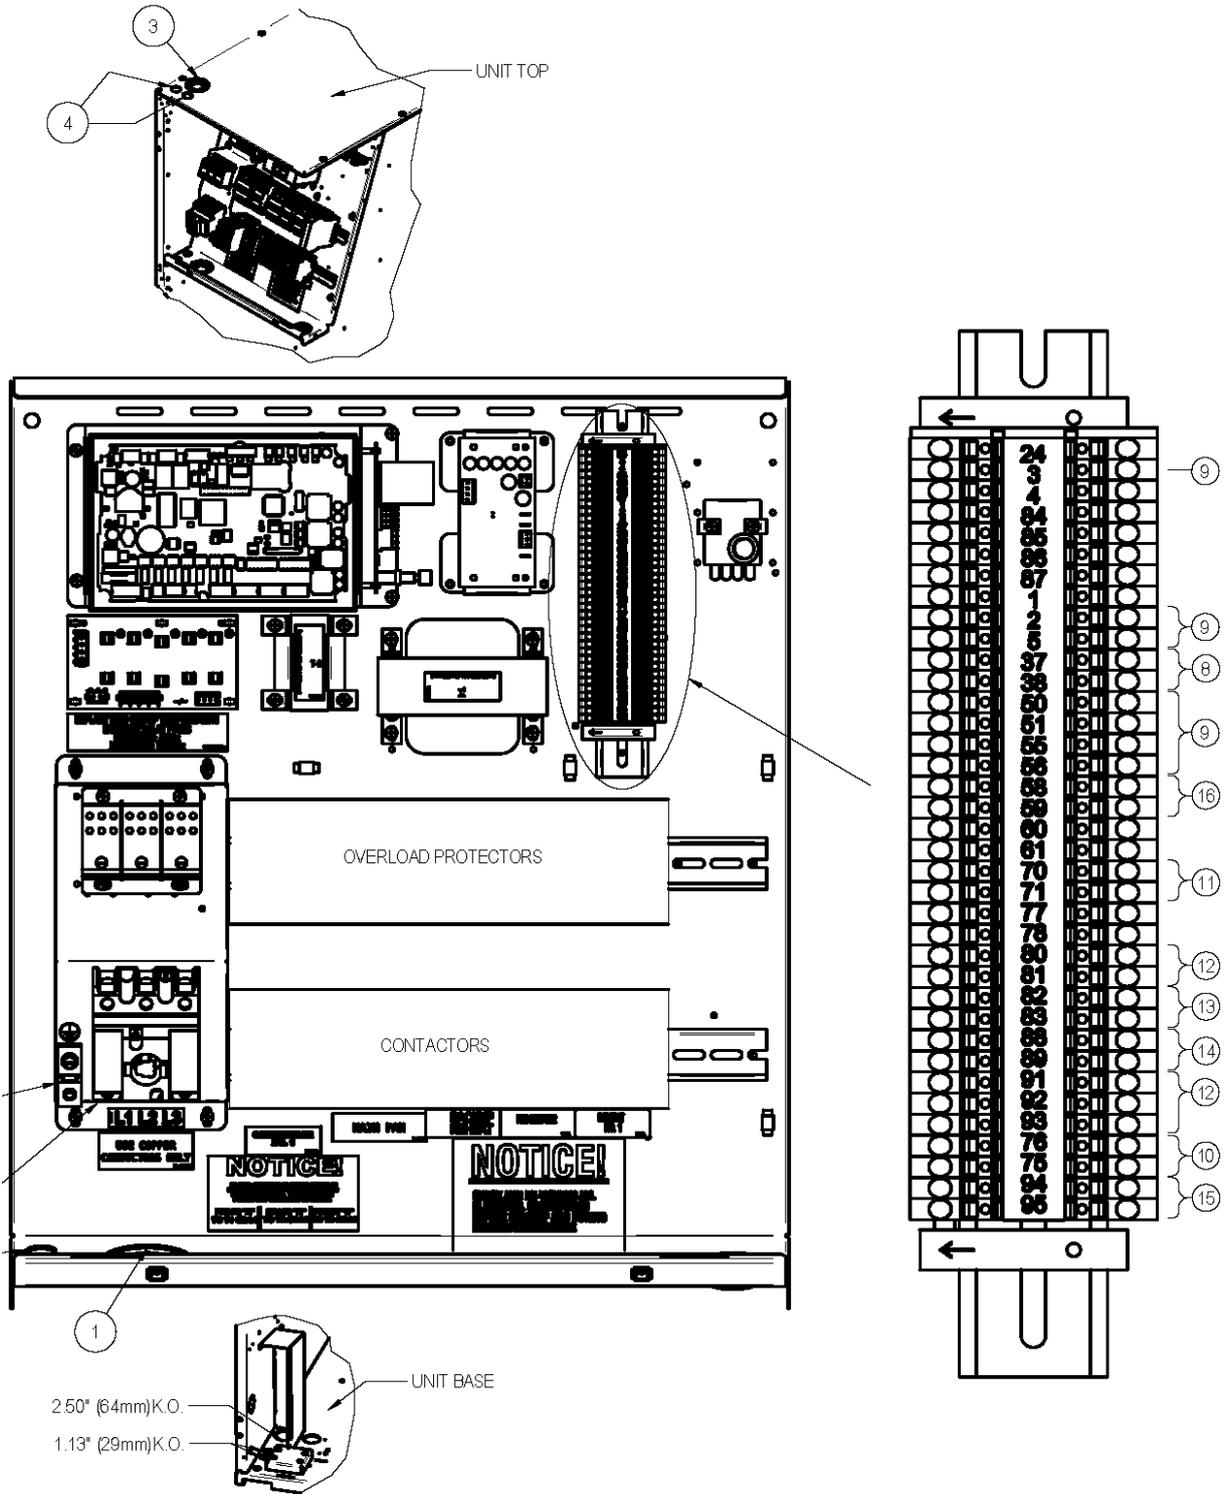

# Refrigerant, Hydraulic and Electrical Connections

---

## 9.2 Electrical field connections descriptions - 60 Hz

### STANDARD ELECTRICAL CONNECTIONS

1. **High voltage entrance through the bottom of the electric panel** - 1.38" (34.9mm), 1.75" (44.5mm) & 2.50" (64mm) diameter concentric knockout.
2. **Low voltage entrance through the bottom of the electric panel** - Quantity (2) 1.125" (28mm) diameter knockouts.
3. **High voltage entrance through the top of the unit** - 1.38" (34.9mm), 1.75" (44.5mm) & 2.50" (64mm) diameter concentric knockout.
4. **Low voltage entrance through the top of the unit** - Quantity (2) 1.125" (28mm) diameter knockouts.
5. **Three phase electrical service** - Connect to terminals on disconnect switch. Three phase service not by Liebert.
6. **Factory Installed locking Disconnect Switch.**
7. **Earth ground** - Terminal for field supplied earth grounding wire.
8. **Remote unit shutdown** - Replace existing jumper between terminals 37 & 38 with field supplied normally closed switch having a minimum 75VA, 24VAC rating. Use field supplied Class 1 wiring.
9. **Customer alarm inputs** - Terminals for field supplied, normally closed contacts, having a minimum 75VA, 24VAC rating, between terminals 3 & 50, 2 & 51, 5 & 55, or 3 & 56. Use field supplied Class 1 wiring.
10. **Common alarm** - On any alarm, normally open dry contact is closed across terminals 75 & 76 for remote indication. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.
11. **Heat rejection interlock** - On any call for compressor operation, normally open dry contact is closed across terminals 70 & 71 to heat rejection equipment. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.

### OPTIONAL ELECTRICAL CONNECTIONS


12. **Smoke sensor alarm** - Factory wired dry contacts from smoke sensor are 91-common, 92-NO, and 93-NC. Supervised contacts, 80 & 81, open on sensor trouble indication. This smoke sensor is not intended to function as, or replace, any room smoke detection system that may be required by local or national codes. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.
13. **Reheat and humidifier lockout** - Remote 24VAC required at terminals 82 & 83 for lockout of reheat and humidifier.
14. **Condensate alarm** (with condensate pump option) - On pump high water indication, normally open dry contact is closed across terminals 88 & 89 for remote indication. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.
15. **Common Alarm** - On any alarm, one additional normally open dry contact is closed across terminals 94 & 95 for remote indication. 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.
16. **LiquiText shutdown and dry contact** - On LiquiText activation, normally open dry contact is closed across terminals 58 & 59 for remote indication (LiquiText sensor ordered separately). 1 AMP, 24VAC max load. Use Class 1 field supplied wiring.

**NOTE:** Refer to specification sheet for total unit full load amps, wire size amps and max overcurrent protective device size.

# 10

## Refrigeration & Hydraulic Circuits

Fig. 10a - LIEBERT CRV: CR020RA, CR035RA

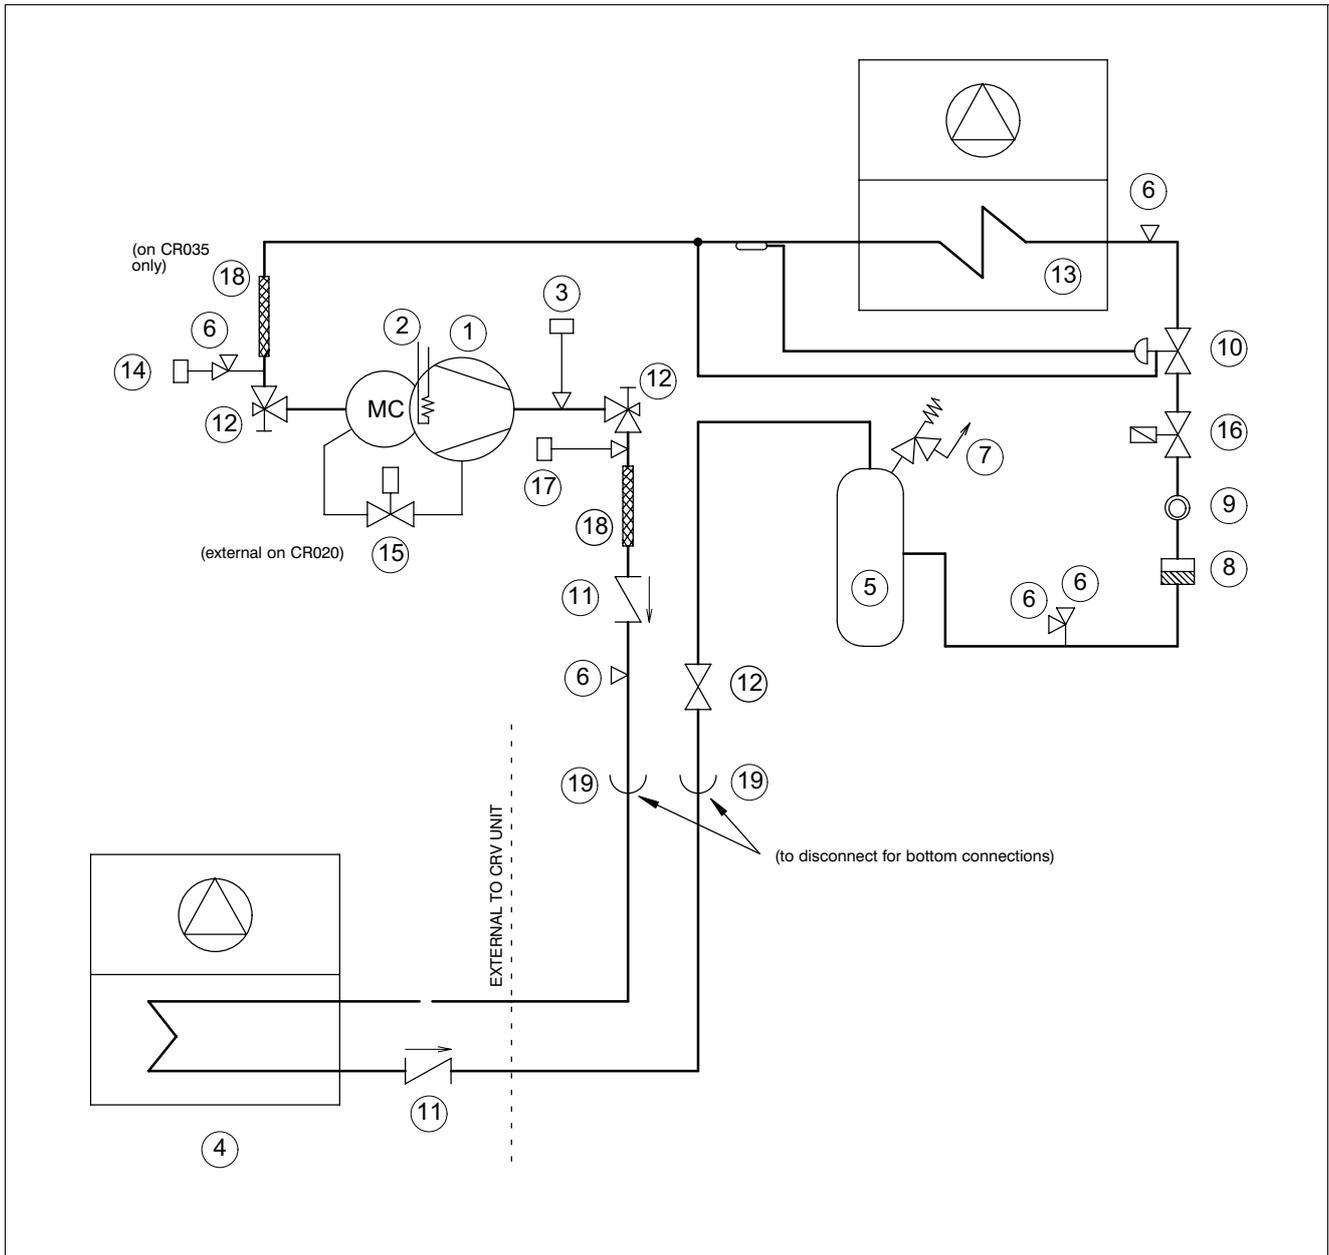


| POS. | DESCRIPTION                  |
|------|------------------------------|
| 1    | Compressor                   |
| 2    | Crankcase heater             |
| 3    | High pressure switch         |
| 4    | Air cooled condenser         |
| 5    | Liquid receiver              |
| 6    | Access valve                 |
| 7    | Safety relief valve          |
| 8    | Filter dryer                 |
| 9    | Sight glass                  |
| 10   | Thermostatic expansion valve |

| POS. | DESCRIPTION                        |
|------|------------------------------------|
| 11   | Check valve                        |
| 12   | Shut-off valve                     |
| 13   | Evaporating coil                   |
| 14   | Low pressure trasducer             |
| 15   | Capacity modulation solenoid valve |
| 16   | Shut-off solenoid valve            |
| 17   | High pressure trasducer            |
| 18   | Vibration absorber                 |
| 19   | Cup and fitting (sweat) joint      |

# Refrigeration & Hydraulic Circuits

Fig. 10b - LIEBERT CRV: CR020RW, CR035RW

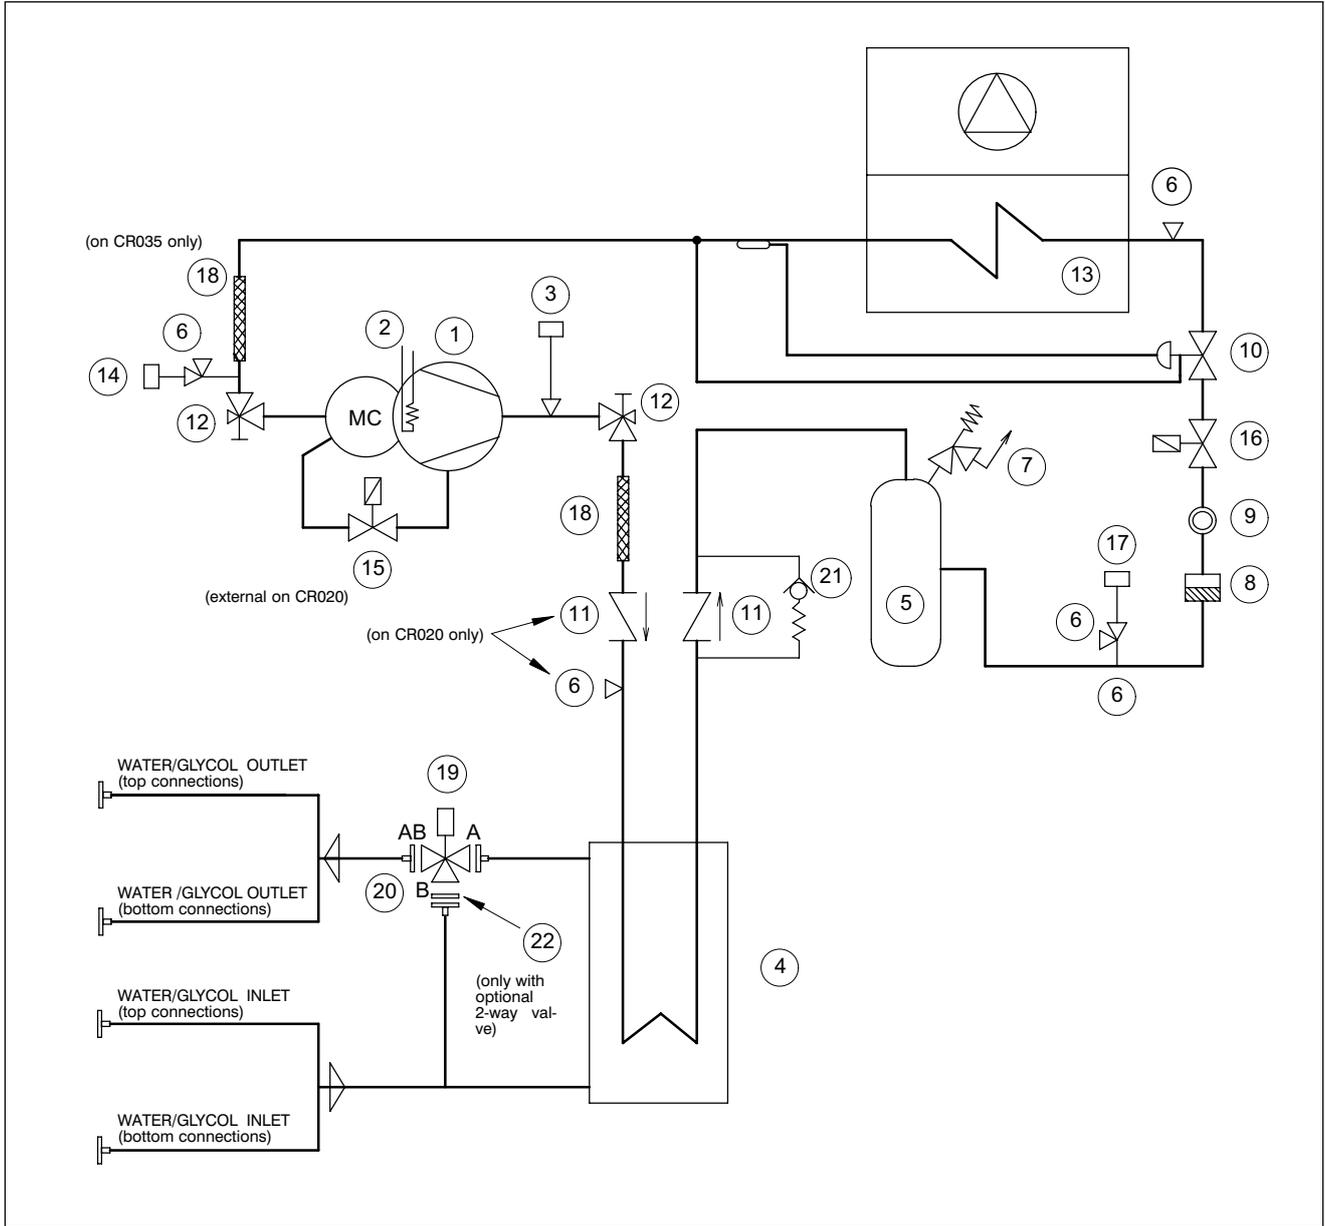


| POS. | DESCRIPTION                  |
|------|------------------------------|
| 1    | Compressor                   |
| 2    | Crankcase heater             |
| 3    | High pressure switch         |
| 4    | Water cooled condenser       |
| 5    | Liquid receiver              |
| 6    | Access valve                 |
| 7    | Safety relief valve          |
| 8    | Filter dryer                 |
| 9    | Sight glass                  |
| 10   | Thermostatic expansion valve |
| 11   | Check valve                  |

| POS. | DESCRIPTION                                 |
|------|---|
| 12   | Rotalock shut-off valve                     |
| 13   | Evaporating coil                            |
| 14   | Low pressure trasducer                      |
| 15   | Capacity modulation solenoid valve          |
| 16   | Shut-off solenoid valve                     |
| 17   | Head pressure trasducer                     |
| 18   | Vibration absorber                          |
| 19   | Head pressure control valve                 |
| 20   | Valve fittings                              |
| 21   | Check valve 10 bar (145 psi)                |
| 22   | Blind disk - only with optional 2-way valve |

# Refrigeration & Hydraulic Circuits


Fig. 10c - LIEBERT CRV: CR040RC

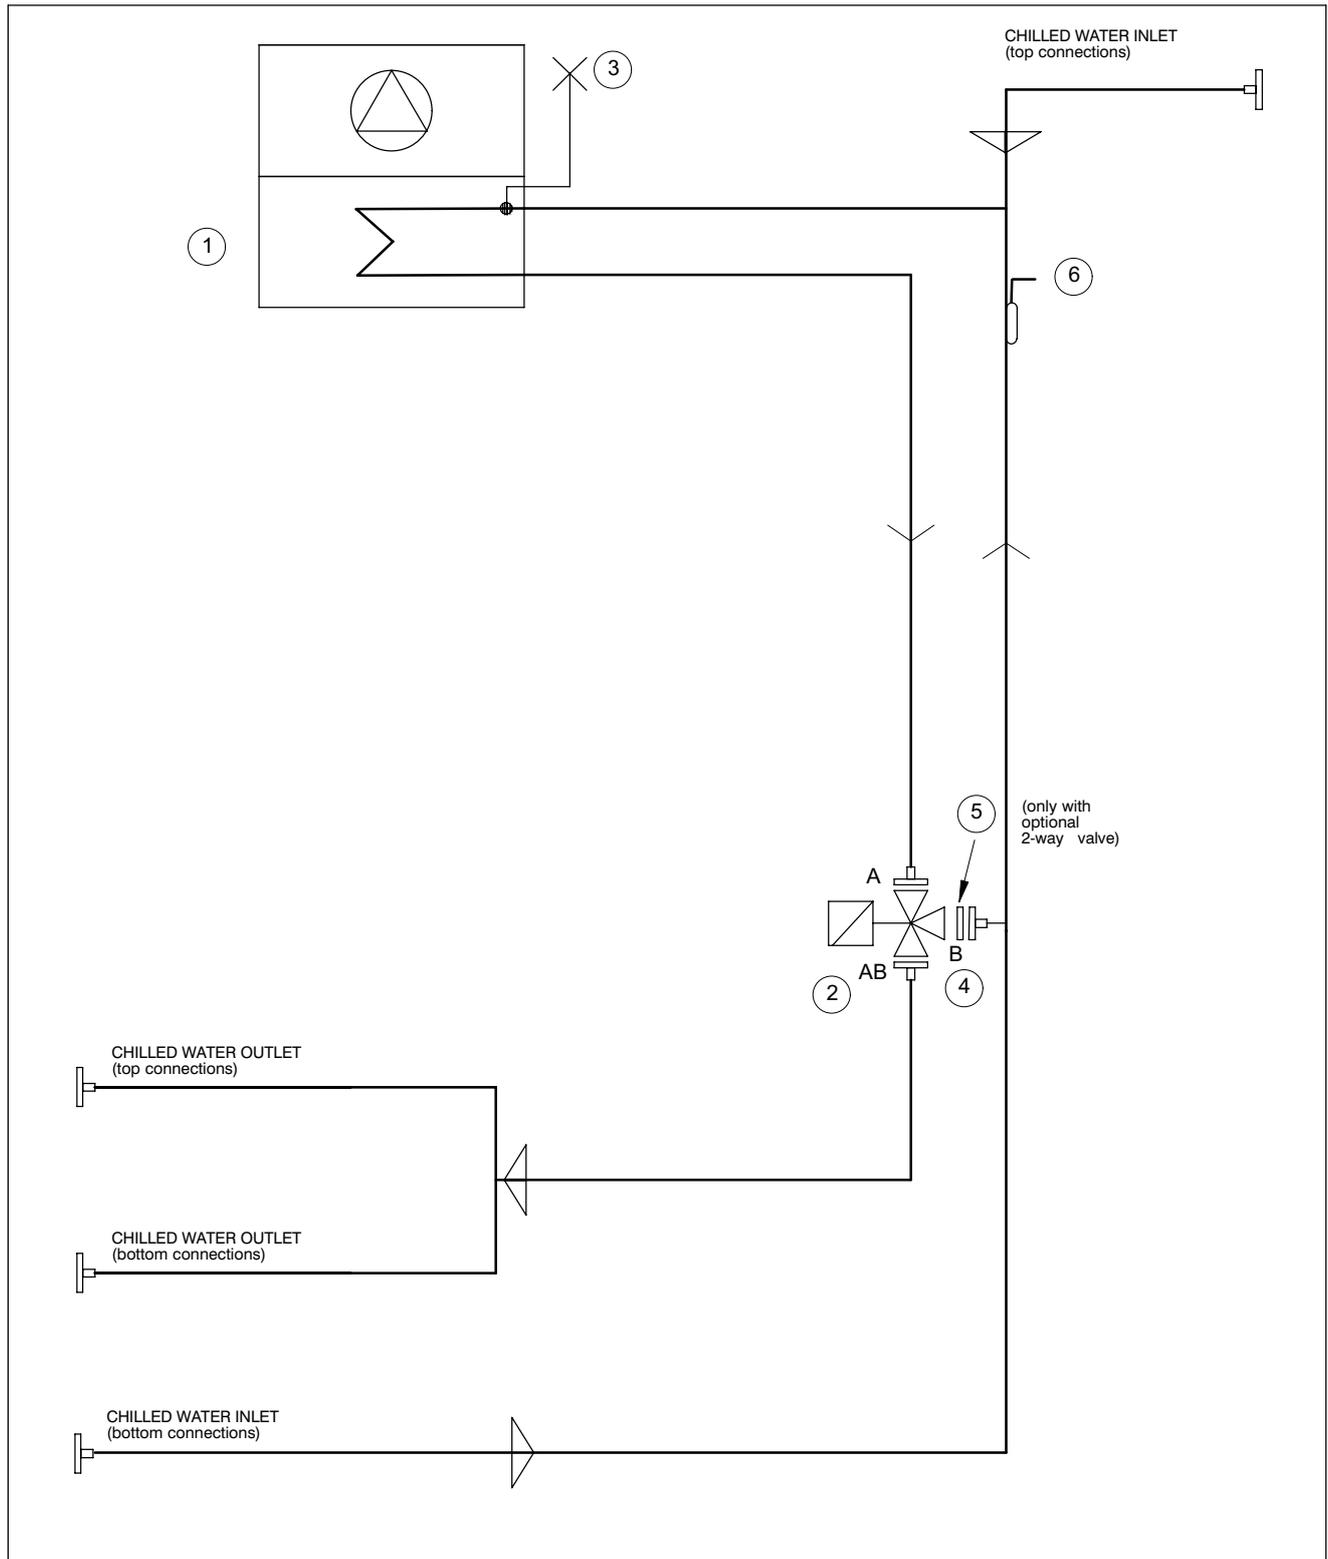

| POS. | Components                 |
|------|----------------------------|
| 1    | Chilled water cooling coil |
| 2    | 3-port water valve         |
| 3    | Air bleeding valve         |

| POS. | Components                                  |
|------|---|
| 4    | Valve fittings                              |
| 5    | Blind disk - only with optional 2-way valve |
| 6    | NTC inlet water sensor                      |



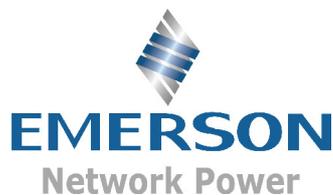

Fabbricante – Manufacturer – Hersteller – Fabricant – Fabricante  
Fabricante – Tillverkare – Fabrikant – Valmistaja – Produsent  
Fabrikant – Κατασκευαστής – Producent

Emerson Network Power S.r.l. – Zona Industriale Tognana  
Via Leonardo da Vinci, 16/18 – 35028 Piove di Sacco – Padova (Italy)

Il Fabbricante dichiara che questo prodotto è conforme alle direttive Europee:

The Manufacturer hereby declares that this product conforms to the European Union directives:

Der Hersteller erklärt hiermit, dass dieses Produkt den Anforderungen der Europäischen Richtlinien gerecht wird:

Le Fabricant déclare que ce produit est conforme aux directives Européennes:

El Fabricante declara que este producto es conforme a las directivas Europeas:

O Fabricante declara que este produto está em conformidade com as directivas Europeias:

Tillverkare försäkrar härmed att denna produkt överensstämmer med Europeiska Unionens direktiv:

De Fabrikant verklaart dat dit produkt conform de Europese richtlijnen is:

Vaimistaja vakuuttaa täten, että tämä tuote täyttää seuraavien EU-direktiivien vaatimukset:

Produsent erklærer herved at dette produktet er i samsvar med EU-direktiver:

Fabrikant erklærer herved, at dette produkt opfylder kravene i EU direktiverne:

Ο Κατασκευαστής δηλώνει ότι το παρόν προϊόν είναι κατασκευασμένο σύμφωνα με τις οδηγίες της Ε.Ε.:

---

**2006/42/EC; 2004/108/EC; 2006/95/EC; 97/23/EC**

---

# Ensuring the High Availability Of Mission-Critical Data and Applications

Emerson Network Power, a business of Emerson (NYSE:EMR), is the global leader in enabling Business-Critical Continuity™ from grid to chip for telecommunication networks, data centers, health care and industrial facilities. Emerson Network Power provides innovative solutions and expertise in areas including AC and DC power and precision cooling systems, embedded computing and power, integrated racks and enclosures, power switching and controls, monitoring, and connectivity. All solutions are supported globally by local Emerson Network Power service technicians. Liebert power, precision cooling and monitoring products and services from Emerson Network Power improve the utilization and management of data center and network technologies by increasing IT system availability, flexibility and efficiency. For more information, visit [www.liebert.com](http://www.liebert.com), [www.emersonnetworkpower.com](http://www.emersonnetworkpower.com) or [www.eu.emersonnetworkpower.com](http://www.eu.emersonnetworkpower.com)

While every precaution has been taken to ensure the accuracy and completeness of this literature, Liebert Corporation assumes no responsibility and accepts no liability for damages resulting from use of this information or for any errors or omissions.

©2008 Liebert Corporation.

All rights reserved throughout the world. Specifications subject to change without notice.

Liebert and the Liebert logo are registered trademarks of Liebert Corporation. All names referred to are trademarks or registered trademarks of their respective owners.

## Emerson Network Power

The global leader in Business-Critical Continuity™

- |                |                      |                             |                              |
|----------------|----------------------|-----------------------------|------------------------------|
| ■ AC Power     | ■ Embedded Computing | ■ Outside Plant             | ■ Rack & Integrated Cabinets |
| ■ Connectivity | ■ Embedded Power     | ■ Power Switching & Control | ■ Services                   |
| ■ DC Power     | ■ Monitoring         | ■ Precision Cooling         | ■ Surge Protection           |

## Locations

### Emerson Network Power - Headquarters EMEA

Via Leonardo Da Vinci 16/18  
Zona Industriale Tognana  
35028 Piove di Sacco (PD) Italy  
Tel: +39 049 9719 111  
Fax: +39 049 5841 257  
[marketing.emea@emersonnetworkpower.com](mailto:marketing.emea@emersonnetworkpower.com)

### Emerson Network Power - Service EMEA

Via Leonardo Da Vinci 16/18  
Zona Industriale Tognana  
35028 Piove di Sacco (PD) Italy  
Tel: +39 049 9719 111  
Fax: +39 049 9719 045  
[service.emea@emersonnetworkpower.com](mailto:service.emea@emersonnetworkpower.com)

### United States

1050 Dearborn Drive  
P.O. Box 29186  
Columbus, OH 43229  
Tel: +1 6148880246

### Asia

29/F The Orient Square Building  
F. Ortigas Jr. Road, Ortigas Centre  
Pasig City 1605 Philippines  
Tel: +63 2 620 3600  
Fax: +63 2 730 9572